



OIL ANALYSIS REPORT

WEAR	<b>NORMAL</b>
CONTAMINATION	<b>NORMAL</b>
FLUID CONDITION	<b>NORMAL</b>

Machine Id  
**20568**  
 Component  
**Compressor**  
 Fluid  
**INGERSOLL-RAND TURBOBLEND 46 (25 GAL)**

**RECOMMENDATION**

Resample at the next service interval to monitor.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		<b>CCSI2014037</b>	CCSI2009938	---
Sample Date		Client Info		<b>10 Jun 2024</b>	22 Apr 2020	---
Machine Age	hrs	Client Info		<b>29097</b>	4872	---
Oil Age	hrs	Client Info		<b>0</b>	4872	---
Filter Age	hrs	Client Info		<b>0</b>	0	---
Oil Changed		Client Info		<b>Not Changd</b>	Not Changd	---
Filter Changed		Client Info		<b>N/A</b>	N/A	---
Sample Status				<b>NORMAL</b>	NORMAL	---

**WEAR**

All component wear rates are normal.

Iron	ppm	ASTM D5185m	>50	<b>0</b>	0	---
Chromium	ppm	ASTM D5185m	>10	<b>0</b>	0	---
Nickel	ppm	ASTM D5185m		<b>0</b>	0	---
Titanium	ppm	ASTM D5185m		<b>&lt;1</b>	0	---
Silver	ppm	ASTM D5185m		<b>0</b>	<1	---
Aluminum	ppm	ASTM D5185m	>25	<b>0</b>	0	---
Lead	ppm	ASTM D5185m	>25	<b>0</b>	0	---
Copper	ppm	ASTM D5185m	>50	<b>&lt;1</b>	<1	---
Tin	ppm	ASTM D5185m	>15	<b>0</b>	0	---
Vanadium	ppm	ASTM D5185m		<b>&lt;1</b>	0	---
White Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE	---
Yellow Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE	---

**CONTAMINATION**










The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil.

Silicon	ppm	ASTM D5185m	>25	<b>&lt;1</b>	<1	---
Potassium	ppm	ASTM D5185m	>20	<b>0</b>	0	---
Water	%	ASTM D6304	>0.1	<b>NEG</b>	NEG	---
Particles >4µm		ASTM D7647	>10000	<b>752</b>	1511	---
Particles >6µm		ASTM D7647	>2500	<b>295</b>	539	---
Particles >14µm		ASTM D7647	>320	<b>26</b>	48	---
Particles >21µm		ASTM D7647	>80	<b>4</b>	13	---
Particles >38µm		ASTM D7647	>20	<b>0</b>	0	---
Particles >71µm		ASTM D7647	>4	<b>0</b>	0	---
Oil Cleanliness		ISO 4406 (c)	>20/18/15	<b>17/15/12</b>	18/16/13	---
Silt	scalar	*Visual	NONE	<b>NONE</b>	NONE	---
Debris	scalar	*Visual	NONE	<b>NONE</b>	NONE	---
Sand/Dirt	scalar	*Visual	NONE	<b>NONE</b>	NONE	---
Appearance	scalar	*Visual	NORML	<b>NORML</b>	NORML	---
Odor	scalar	*Visual	NORML	<b>NORML</b>	NORML	---
Emulsified Water	scalar	*Visual	>0.1	<b>NEG</b>	NEG	---

**FLUID CONDITION**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

Sodium	ppm	ASTM D5185m		<b>1</b>	0	---
Boron	ppm	ASTM D5185m		<b>0</b>	<1	---
Barium	ppm	ASTM D5185m		<b>0</b>	0	---
Molybdenum	ppm	ASTM D5185m		<b>0</b>	0	---
Manganese	ppm	ASTM D5185m		<b>&lt;1</b>	0	---
Magnesium	ppm	ASTM D5185m		<b>0</b>	0	---
Calcium	ppm	ASTM D5185m		<b>0</b>	<1	---
Phosphorus	ppm	ASTM D5185m		<b>16</b>	16	---
Zinc	ppm	ASTM D5185m		<b>1</b>	0	---
Sulfur	ppm	ASTM D5185m		<b>4</b>	52	---
Acid Number (AN)	mg KOH/g	ASTM D8045		<b>0.16</b>	0.103	---
Visc @ 40°C	cSt	ASTM D445	46	<b>44.4</b>	45.0	---

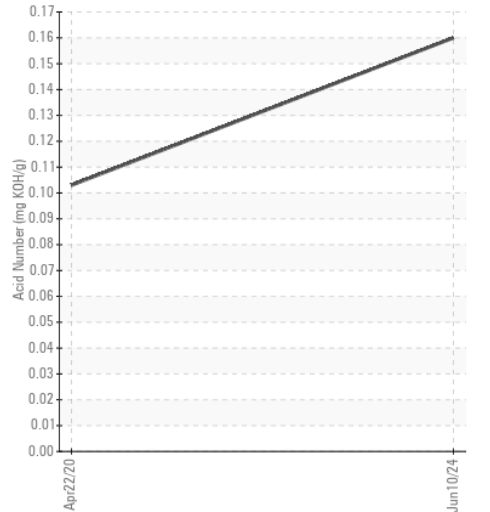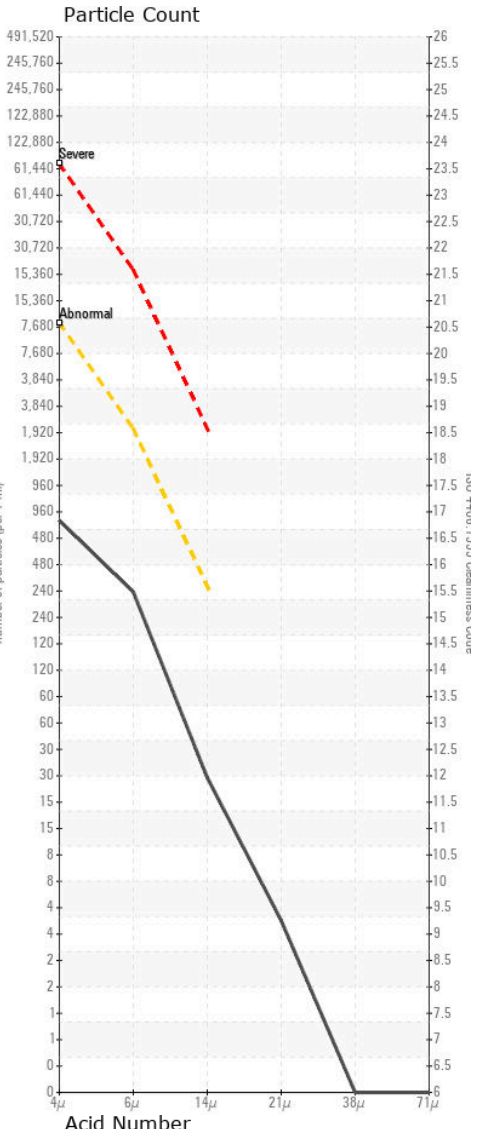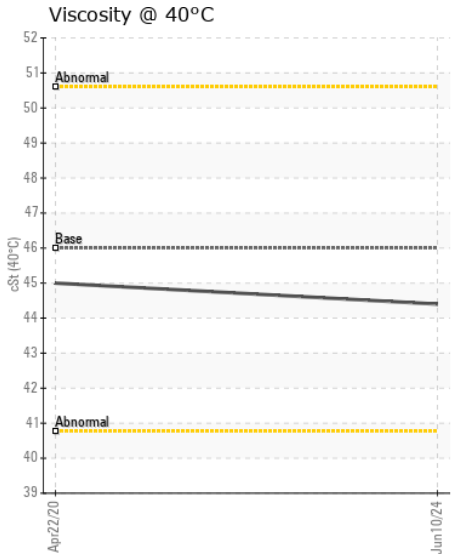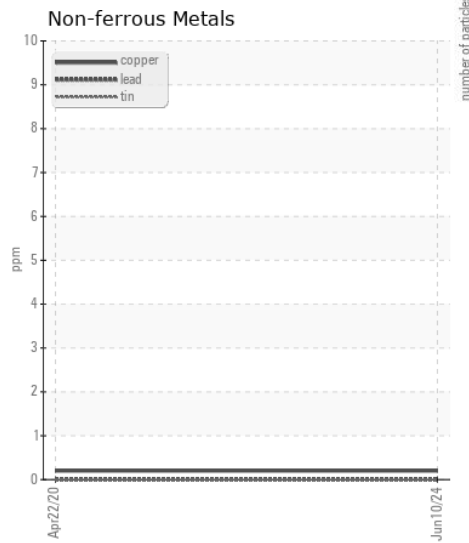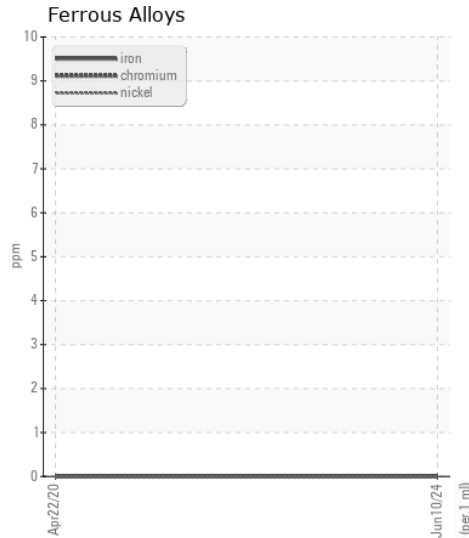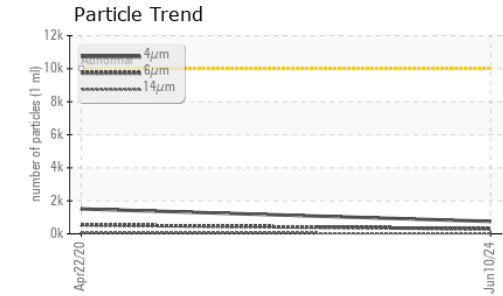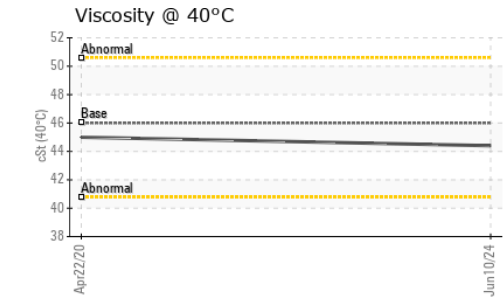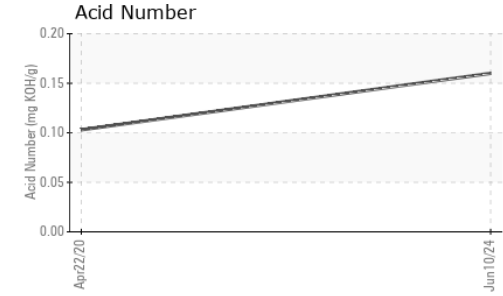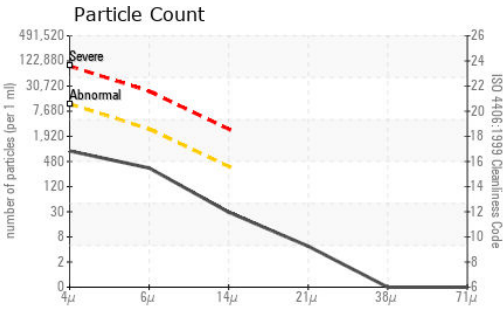

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : CCSI2014037 **Received** : 17 Jun 2024  
**Lab Number** : 06212335 **Tested** : 19 Jun 2024  
**Unique Number** : 11085199 **Diagnosed** : 19 Jun 2024 - Don Baldrige  
**Test Package** : IND 2 ( Additional Tests: KF, PrtCount )

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

**JOHANNA FOODS**  
 20 JOHANNA FARMS RD  
 FLEMINGTON, NJ  
 US 08822  
 Contact: TIM HALL  
 timhall@johannafoods.com  
 T:  
 F: