



OIL ANALYSIS REPORT

WEAR	NORMAL
CONTAMINATION	NORMAL
FLUID CONDITION	ATTENTION

Machine Id
16 (S/N 19884)
 Component
Compressor
 Fluid
PHILLIPS 66 TURBINE OIL ISO 68 (55 GAL)

RECOMMENDATION

Resample at the next service interval to monitor.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		CCSI2013331	---	---
Sample Date		Client Info		04 Jun 2024	---	---
Machine Age	hrs	Client Info		35000	---	---
Oil Age	hrs	Client Info		0	---	---
Filter Age	hrs	Client Info		0	---	---
Oil Changed		Client Info		Not Changd	---	---
Filter Changed		Client Info		N/A	---	---
Sample Status				ATTENTION	---	---

WEAR

All component wear rates are normal.

Iron	ppm	ASTM D5185m	>50	2	---	---
Chromium	ppm	ASTM D5185m	>10	0	---	---
Nickel	ppm	ASTM D5185m		0	---	---
Titanium	ppm	ASTM D5185m		<1	---	---
Silver	ppm	ASTM D5185m		0	---	---
Aluminum	ppm	ASTM D5185m	>25	0	---	---
Lead	ppm	ASTM D5185m	>25	0	---	---
Copper	ppm	ASTM D5185m	>50	<1	---	---
Tin	ppm	ASTM D5185m	>15	0	---	---
Vanadium	ppm	ASTM D5185m		<1	---	---
White Metal	scalar	*Visual	NONE	NONE	---	---
Yellow Metal	scalar	*Visual	NONE	NONE	---	---

CONTAMINATION










There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

Silicon	ppm	ASTM D5185m	>25	<1	---	---
Potassium	ppm	ASTM D5185m	>20	0	---	---
Water	%	ASTM D6304	>0.1	NEG	---	---
Particles >4µm		ASTM D7647	>10000	2875	---	---
Particles >6µm		ASTM D7647	>2500	870	---	---
Particles >14µm		ASTM D7647	>320	74	---	---
Particles >21µm		ASTM D7647	>80	16	---	---
Particles >38µm		ASTM D7647	>20	0	---	---
Particles >71µm		ASTM D7647	>4	0	---	---
Oil Cleanliness		ISO 4406 (c)	>20/18/15	19/17/13	---	---
Silt	scalar	*Visual	NONE	NONE	---	---
Debris	scalar	*Visual	NONE	NONE	---	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---	---
Appearance	scalar	*Visual	NORML	NORML	---	---
Odor	scalar	*Visual	NORML	NORML	---	---
Emulsified Water	scalar	*Visual	>0.1	NEG	---	---

FLUID CONDITION

Viscosity of sample indicates oil is within ISO 46 range, advise investigate. Confirm oil type. The AN level is acceptable for this fluid.

Sodium	ppm	ASTM D5185m		2	---	---
Boron	ppm	ASTM D5185m		0	---	---
Barium	ppm	ASTM D5185m		<1	---	---
Molybdenum	ppm	ASTM D5185m		0	---	---
Manganese	ppm	ASTM D5185m		<1	---	---
Magnesium	ppm	ASTM D5185m		0	---	---
Calcium	ppm	ASTM D5185m		0	---	---
Phosphorus	ppm	ASTM D5185m		2	---	---
Zinc	ppm	ASTM D5185m		<1	---	---
Sulfur	ppm	ASTM D5185m		17	---	---
Acid Number (AN)	mg KOH/g	ASTM D8045	0.04	0.092	---	---
Visc @ 40°C	cSt	ASTM D445	68.0	46.1	---	---

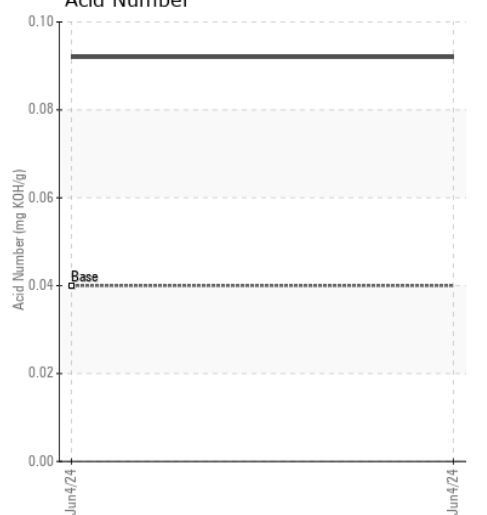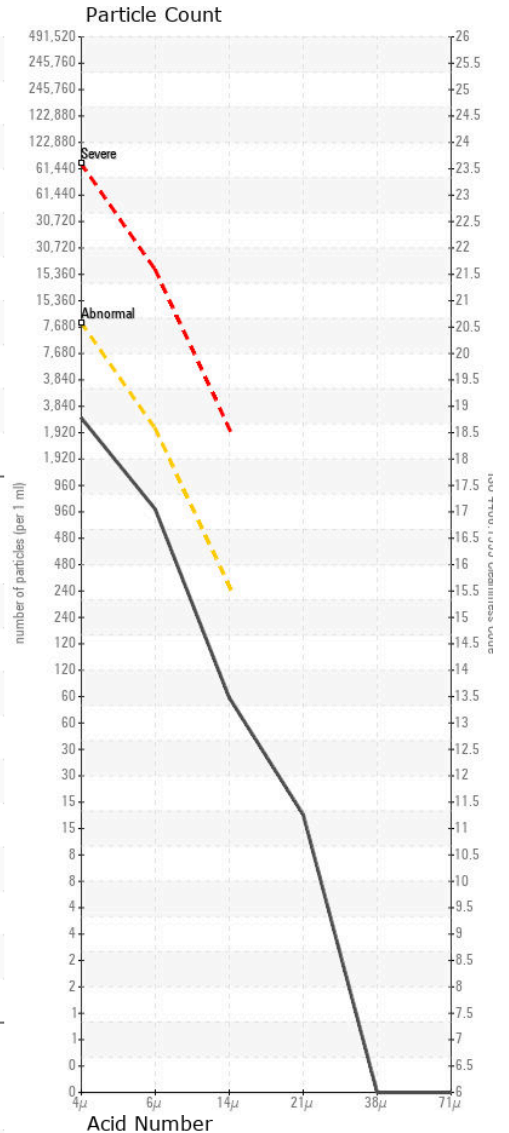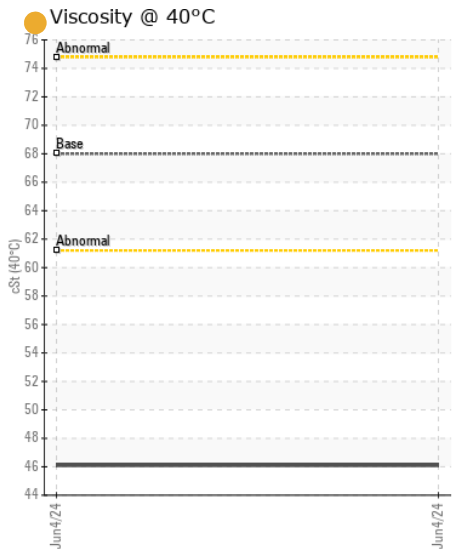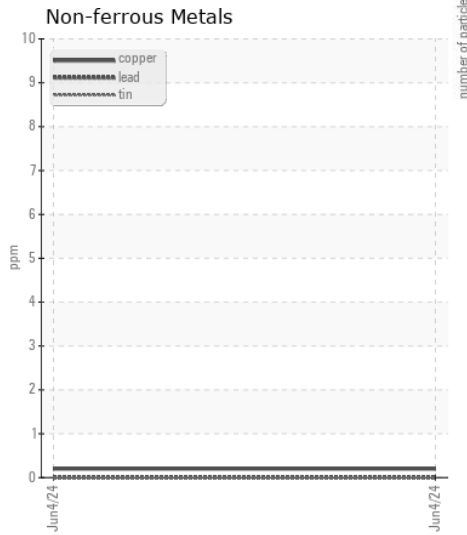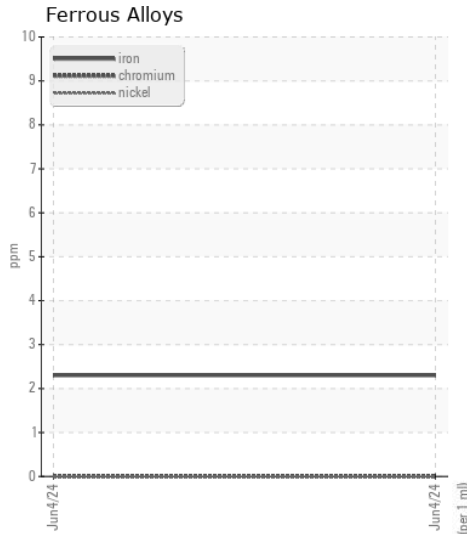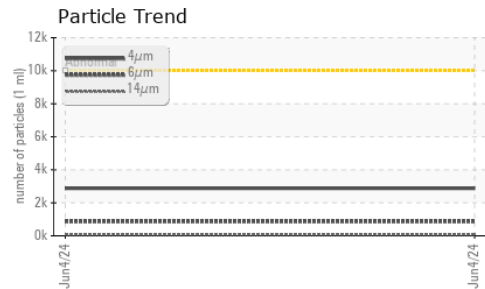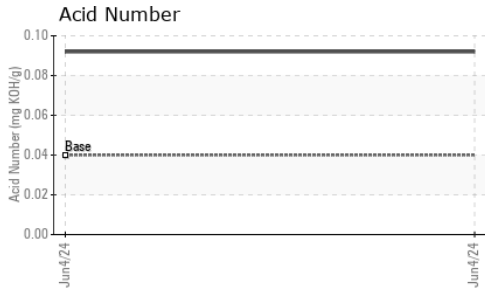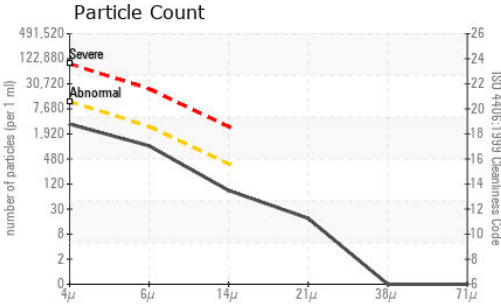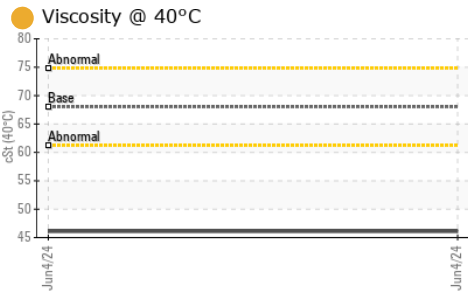

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : CCSI2013331 **Received** : 17 Jun 2024
Lab Number : 062123339 **Tested** : 19 Jun 2024
Unique Number : 11085203 **Diagnosed** : 19 Jun 2024 - Don Baldrige
Test Package : IND 2 (Additional Tests: KF, PrtCount)

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

MOHAWK INDUSTRIES
 106 JOHN BANKSTON DR
 SUMMERVILLE, GA
 US 30747
 Contact: DAVID PAYNE
 dpayne@blakeandpendleton.com
 T: (423)309-1756
 F: (706)891-8049