MAR II

WEAR CHECK Inland Marine Oil Analysis Program

OIL ANALYSIS REPORT

WEAR	NORMAL
CONTAMINATION	NORMAL
FLUID CONDITION	NORMAL

Machine Id
LOUISIANA LAGNIAPPE
Component
Starboard Genset
Fluid
CHEVRON DELO 400 MULTIGRADE 15W40 (3 GAL)

RECOMMENDATION

Resample at the next service interval to monitor.

WEAR

All component wear rates are normal.

CONTAMINATION

There is no indication of any contamination in the oil.

FLUID CONDITION

The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		**MW0064948**	MW0042719	MW0052156
Sample Date		Client Info		**14 Jun 2024**	11 Apr 2024	02 Feb 2024
Machine Age	hrs	Client Info		**50070**	49280	48446
Oil Age	hrs	Client Info		**1787**	708	848
Filter Age	hrs	Client Info		**1787**	708	848
Oil Changed		Client Info		**Changed**	Changed	Changed
Filter Changed		Client Info		**Changed**	Changed	Changed
Sample Status				**NORMAL**	NORMAL	NORMAL
Iron	ppm	ASTM D5185m	>50	**9**	8	0
Chromium	ppm	ASTM D5185m	>4	**<1**	0	0
Nickel	ppm	ASTM D5185m	>2	**0**	0	0
Titanium	ppm	ASTM D5185m		**9**	11	11
Silver	ppm	ASTM D5185m	>5	**0**	0	0
Aluminum	ppm	ASTM D5185m	>12	**2**	1	<1
Lead	ppm	ASTM D5185m	>17	**<1**	1	2
Copper	ppm	ASTM D5185m	>70	**<1**	<1	0
Tin	ppm	ASTM D5185m	>15	**0**	<1	0
Vanadium	ppm	ASTM D5185m		**0**	<1	0
White Metal	scalar	*Visual	NONE	**NONE**	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	**NONE**	NONE	NONE
Silicon	ppm	ASTM D5185m	>25	**4**	3	0
Potassium	ppm	ASTM D5185m	>20	**5**	3	5
Fuel		WC Method	>4.0	**<1.0**	<1.0	<1.0
Water		WC Method	>0.1	**NEG**	NEG	NEG
Glycol		WC Method		**NEG**	NEG	NEG
Soot %	%	*ASTM D7844		**0.1**	0.1	0.1
Nitration	Abs/cm	*ASTM D7624	>20	**10.5**	11.0	10.2
Sulfation	Abs/.1mm	*ASTM D7415	>30	**22.0**	22.4	21.6
Silt	scalar	*Visual	NONE	**NONE**	NONE	NONE
Debris	scalar	*Visual	NONE	**NONE**	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	**NONE**	NONE	NONE
Appearance	scalar	*Visual	NORML	**NORML**	NORML	NORML
Odor	scalar	*Visual	NORML	**NORML**	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	**NEG**	NEG	NEG
Sodium	ppm	ASTM D5185m		**6**	9	10
Boron	ppm	ASTM D5185m	151	**69**	70	77
Barium	ppm	ASTM D5185m	0.4	**0**	0	0
Molybdenum	ppm	ASTM D5185m	250	**27**	26	26
Manganese	ppm	ASTM D5185m		**0**	<1	1
Magnesium	ppm	ASTM D5185m	0	**658**	662	573
Calcium	ppm	ASTM D5185m	2046	**1670**	1823	1571
Phosphorus	ppm	ASTM D5185m	1043	**811**	805	694
Zinc	ppm	ASTM D5185m	943	**987**	918	866
Sulfur	ppm	ASTM D5185m	5012	**3023**	3687	2915
Oxidation	Abs/.1mm	*ASTM D7414	>25	**19.2**	20.6	19.1
Base Number (BN)	mg KOH/g	ASTM D2896	12.5	**7.2**	6.7	7.2
Visc @ 100°C	cSt	ASTM D445	14.4	**15.1**	15.2	14.7

FT-IR (Direct Trend)

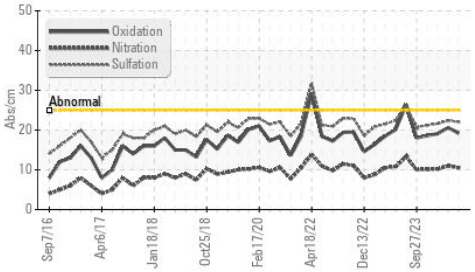

Base Number

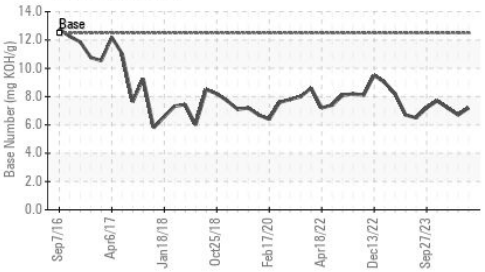

Viscosity @ 100°C

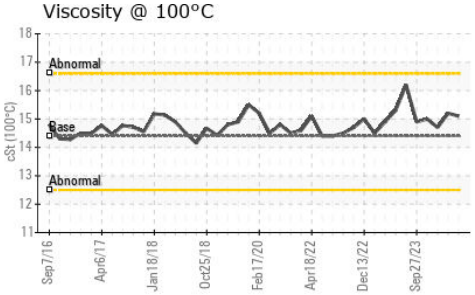

Ferrous Alloys

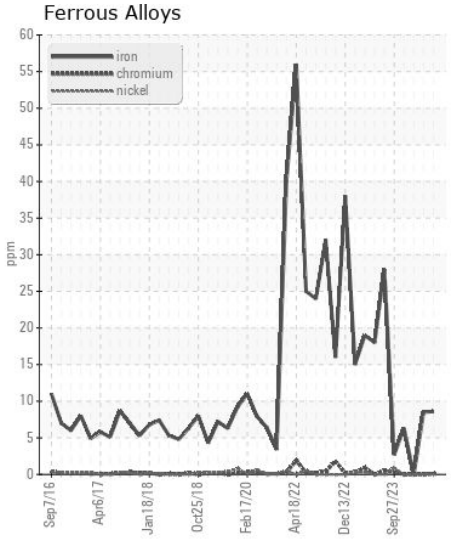

Non-ferrous Metals

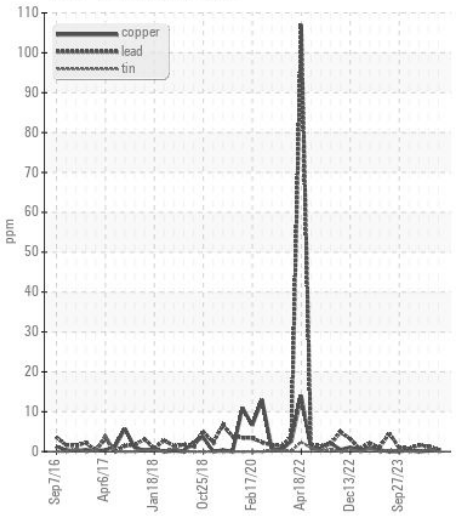

Viscosity @ 100°C

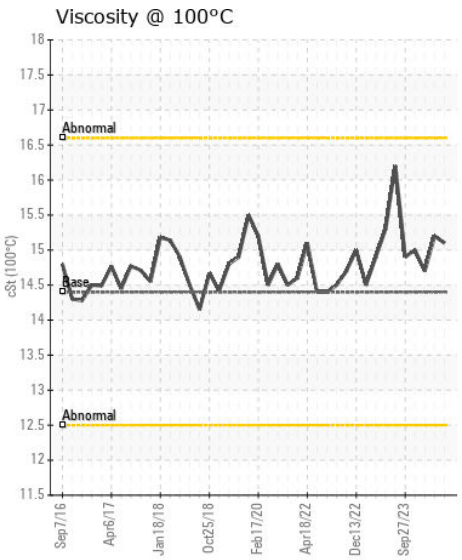

Base Number

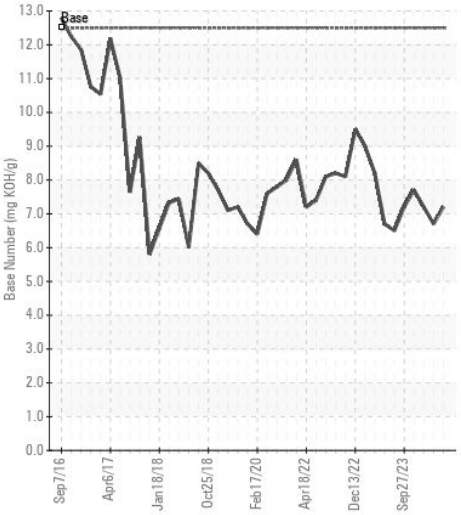

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : MW0064948
Lab Number : 06214202
Unique Number : 11087066
Test Package : MAR 2

Received : 19 Jun 2024
Tested : 20 Jun 2024
Diagnosed : 20 Jun 2024 - Sean Felton

To discuss this sample report, contact Customer Service at 1-800-237-1369.
** - Denotes test methods that are outside of the ISO 17025 scope of accreditation.*
Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

AMERICAN RIVER TRANSPORTATION CO
8400 RIVER RD, PO BOX 656
WESTWEGO, LA
US 70094-2317
Contact: KEVIN CHIASSON
kevin.chiasson@adm.com
T:
F: