



WEAR	NORMAL
CONTAMINATION	ATTENTION
FLUID CONDITION	NORMAL

Area
PALLUBE 32
Machine Id
SULLIVAN PALATEK 23GE004271 - SCHNEIDER
Component
Compressor

RECOMMENDATION

We advise that you follow the water drain-off procedure for this component. We recommend an early resample to monitor this condition.

WEAR

All component wear rates are normal.








CONTAMINATION

There is a high concentration of water present in the oil.

FLUID CONDITION

The AN level is acceptable for this fluid.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		UCS06214824	---	---
Sample Date		Client Info		01 Feb 2024	---	---
Machine Age	hrs	Client Info		434	---	---
Oil Age	hrs	Client Info		434	---	---
Filter Age	hrs	Client Info		434	---	---
Oil Changed		Client Info		Not Changd	---	---
Filter Changed		Client Info		Not Changd	---	---
Sample Status				ATTENTION	---	---
Iron	ppm	ASTM D5185m	>50	0	---	---
Chromium	ppm	ASTM D5185m	>10	0	---	---
Nickel	ppm	ASTM D5185m		0	---	---
Titanium	ppm	ASTM D5185m		0	---	---
Silver	ppm	ASTM D5185m		0	---	---
Aluminum	ppm	ASTM D5185m	>25	<1	---	---
Lead	ppm	ASTM D5185m	>25	0	---	---
Copper	ppm	ASTM D5185m	>50	0	---	---
Tin	ppm	ASTM D5185m	>15	1	---	---
Vanadium	ppm	ASTM D5185m		0	---	---
White Metal	scalar	*Visual	NONE	NONE	---	---
Yellow Metal	scalar	*Visual	NONE	NONE	---	---
Silicon	ppm	ASTM D5185m	>25	1	---	---
Potassium	ppm	ASTM D5185m	>20	5	---	---
Water	%	ASTM D6304	>0.1	1.09	---	---
ppm Water	ppm	ASTM D6304	>1000	10900	---	---
Silt	scalar	*Visual	NONE	NONE	---	---
Debris	scalar	*Visual	NONE	NONE	---	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---	---
Appearance	scalar	*Visual	NORML	NORML	---	---
Odor	scalar	*Visual	NORML	NORML	---	---
Emulsified Water	scalar	*Visual	>0.1	0.2%	---	---
Sodium	ppm	ASTM D5185m		42	---	---
Boron	ppm	ASTM D5185m	1	<1	---	---
Barium	ppm	ASTM D5185m	730	159	---	---
Molybdenum	ppm	ASTM D5185m	0	0	---	---
Manganese	ppm	ASTM D5185m	0.0	<1	---	---
Magnesium	ppm	ASTM D5185m	0	<1	---	---
Calcium	ppm	ASTM D5185m	0	2	---	---
Phosphorus	ppm	ASTM D5185m	0	11	---	---
Zinc	ppm	ASTM D5185m	0	0	---	---
Sulfur	ppm	ASTM D5185m	590	845	---	---
Acid Number (AN)	mg KOH/g	ASTM D8045	0.14	0.137	---	---
Visc @ 40°C	cSt	ASTM D445	42.8	41.7	---	---

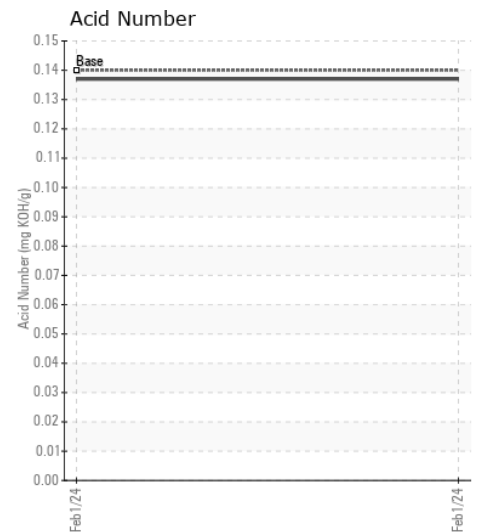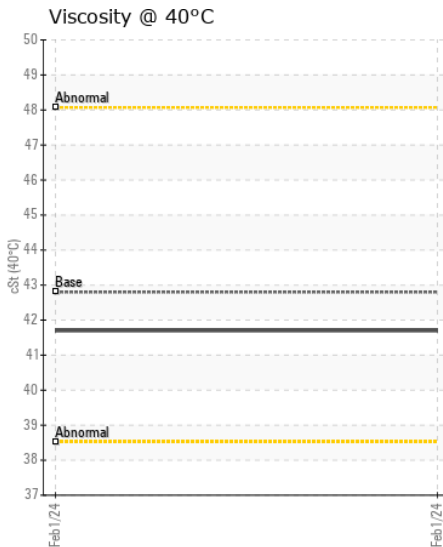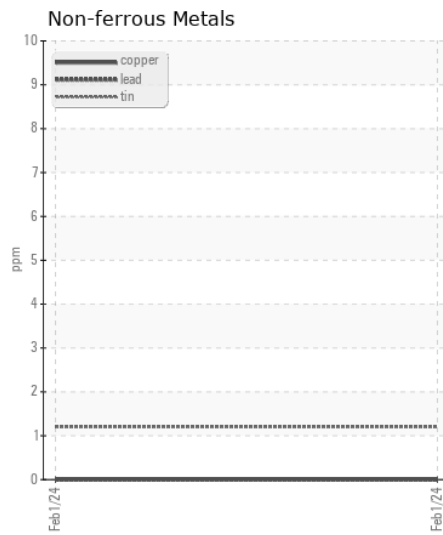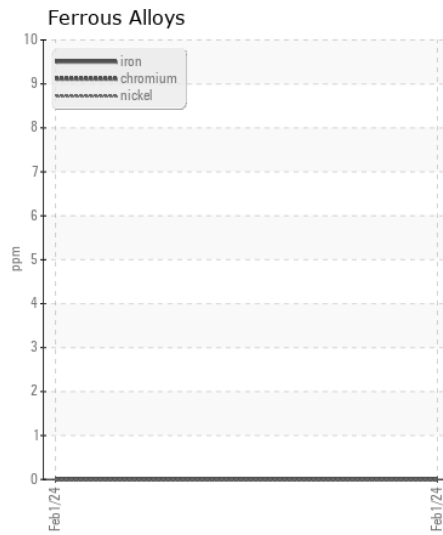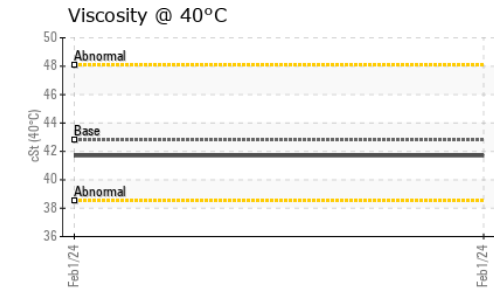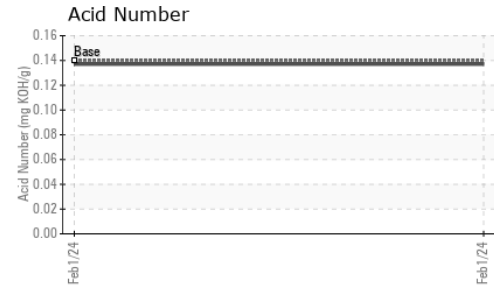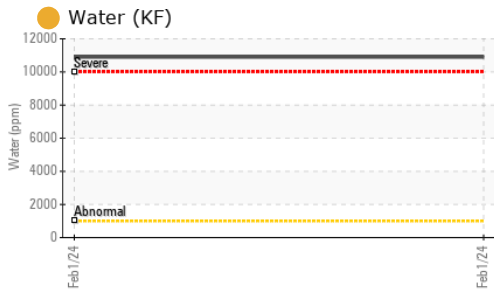

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513

Sample No. : UCS06214824

Lab Number : 06214824

Unique Number : 11087688

Test Package : IND 2 (Additional Tests: KF)

Received : 19 Jun 2024

Tested : 20 Jun 2024

Diagnosed : 21 Jun 2024 - Don Baldrige

ELITE COMPRESSED AIR SYSTEMS INC

MCDONOUGH, GA
US 30252

Contact: RONNY MINNIX
elitecompressed@gmail.com

T: (770)898-9594

F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)