



# OIL ANALYSIS REPORT

|                 |               |
|-----------------|---------------|
| WEAR            | <b>NORMAL</b> |
| CONTAMINATION   | <b>NORMAL</b> |
| FLUID CONDITION | <b>NORMAL</b> |

Area  
**WCLSNC**  
Machine Id  
**QC230801DE**  
Component  
**Diesel Engine**  
Fluid  
**PETRO CANADA DURON SHP 15W40 (--- GAL)**

## RECOMMENDATION

Resample at the next service interval to monitor.

| Test           | UOM | Method      | Limit/Abn | Current            | History1    | History2    |
|----------------|-----|-------------|-----------|--------------------|-------------|-------------|
| Sample Number  |     | Client Info |           | <b>WC0952360</b>   | WC0952359   | WC0952358   |
| Sample Date    |     | Client Info |           | <b>19 Jun 2024</b> | 18 Jun 2024 | 17 Jun 2024 |
| Machine Age    | hrs | Client Info |           | <b>0</b>           | 0           | 0           |
| Oil Age        | hrs | Client Info |           | <b>0</b>           | 0           | 0           |
| Filter Age     | hrs | Client Info |           | <b>0</b>           | 0           | 0           |
| Oil Changed    |     | Client Info |           | <b>N/A</b>         | N/A         | N/A         |
| Filter Changed |     | Client Info |           | <b>N/A</b>         | N/A         | N/A         |
| Sample Status  |     |             |           | <b>NORMAL</b>      | NORMAL      | NORMAL      |

## WEAR

All component wear rates are normal.

|              |        |             |      |              |      |      |
|--------------|--------|-------------|------|--------------|------|------|
| Iron         | ppm    | ASTM D5185m | >11  | <b>9</b>     | 7    | 7    |
| Chromium     | ppm    | ASTM D5185m | >3   | <b>1</b>     | <1   | <1   |
| Nickel       | ppm    | ASTM D5185m | >2   | <b>&lt;1</b> | <1   | <1   |
| Titanium     | ppm    | ASTM D5185m | >2   | <b>&lt;1</b> | 0    | 0    |
| Silver       | ppm    | ASTM D5185m | >2   | <b>&lt;1</b> | <1   | <1   |
| Aluminum     | ppm    | ASTM D5185m | >5   | <b>3</b>     | 3    | 3    |
| Lead         | ppm    | ASTM D5185m | >2   | <b>&lt;1</b> | 0    | 0    |
| Copper       | ppm    | ASTM D5185m | >7   | <b>5</b>     | 4    | 5    |
| Tin          | ppm    | ASTM D5185m | >2   | <b>&lt;1</b> | <1   | 0    |
| Vanadium     | ppm    | ASTM D5185m |      | <b>&lt;1</b> | 0    | 0    |
| White Metal  | scalar | *Visual     | NONE | <b>NONE</b>  | NONE | NONE |
| Yellow Metal | scalar | *Visual     | NONE | <b>NONE</b>  | NONE | NONE |

## CONTAMINATION













There is no indication of any contamination in the oil.

|                  |          |             |       |              |       |       |
|------------------|----------|-------------|-------|--------------|-------|-------|
| Silicon          | ppm      | ASTM D5185m | >14   | <b>4</b>     | 4     | 7     |
| Potassium        | ppm      | ASTM D5185m | >20   | <b>4</b>     | 4     | 4     |
| Fuel             | %        | ASTM D3524  | >4.1  | <b>2.1</b>   | 2.1   | 2.2   |
| Water            |          | WC Method   | >0.2  | <b>NEG</b>   | NEG   | NEG   |
| Glycol           |          | WC Method   |       | <b>NEG</b>   | NEG   | NEG   |
| Soot %           | %        | *ASTM D7844 | >0.3  | <b>0.1</b>   | 0.1   | 0.1   |
| Nitration        | Abs/cm   | *ASTM D7624 | >10.8 | <b>10.4</b>  | 10.3  | 10.4  |
| Sulfation        | Abs/.1mm | *ASTM D7415 | >20.8 | <b>19.8</b>  | 19.9  | 19.8  |
| Silt             | scalar   | *Visual     | NONE  | <b>NONE</b>  | NONE  | NONE  |
| Debris           | scalar   | *Visual     | NONE  | <b>NONE</b>  | NONE  | NONE  |
| Sand/Dirt        | scalar   | *Visual     | NONE  | <b>NONE</b>  | NONE  | NONE  |
| Appearance       | scalar   | *Visual     | NORML | <b>NORML</b> | NORML | NORML |
| Odor             | scalar   | *Visual     | NORML | <b>NORML</b> | NORML | NORML |
| Emulsified Water | scalar   | *Visual     | >0.2  | <b>NEG</b>   | NEG   | NEG   |

## FLUID CONDITION

The BN result indicates that there is suitable alkalinity remaining in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

|                      |          |             |       |              |      |      |
|----------------------|----------|-------------|-------|--------------|------|------|
| Sodium               | ppm      | ASTM D5185m | >13   | <b>7</b>     | 8    | 9    |
| Boron                | ppm      | ASTM D5185m | 0     | <b>7</b>     | 8    | 9    |
| Barium               | ppm      | ASTM D5185m | 0     | <b>1</b>     | 0    | 0    |
| Molybdenum           | ppm      | ASTM D5185m | 60    | <b>50</b>    | 49   | 48   |
| Manganese            | ppm      | ASTM D5185m | 0     | <b>&lt;1</b> | <1   | <1   |
| Magnesium            | ppm      | ASTM D5185m | 1010  | <b>509</b>   | 560  | 527  |
| Calcium              | ppm      | ASTM D5185m | 1070  | <b>1441</b>  | 1484 | 1492 |
| Phosphorus           | ppm      | ASTM D5185m | 1150  | <b>757</b>   | 706  | 699  |
| Zinc                 | ppm      | ASTM D5185m | 1270  | <b>920</b>   | 944  | 910  |
| Sulfur               | ppm      | ASTM D5185m | 2060  | <b>2542</b>  | 2716 | 2688 |
| Oxidation            | Abs/.1mm | *ASTM D7414 | >17.9 | <b>17.1</b>  | 17.2 | 17.0 |
| Acid Number (AN)     | mg KOH/g | ASTM D8045  | 3.2   | <b>0.87</b>  | 0.91 | 0.78 |
| Base Number (BN)     | mg KOH/g | ASTM D2896  | 9.8   | <b>7.24</b>  | 7.19 | 7.66 |
| Visc @ 40°C          | cSt      | ASTM D445   | 113.9 | <b>97.9</b>  | 99.8 | 98.2 |
| Visc @ 100°C         | cSt      | ASTM D445   | 15.4  | <b>13.3</b>  | 13.3 | 13.4 |
| Viscosity Index (VI) | Scale    | ASTM D2270  | 142   | <b>134</b>   | 131  | 135  |

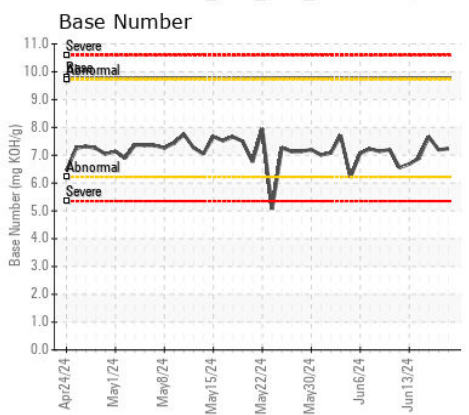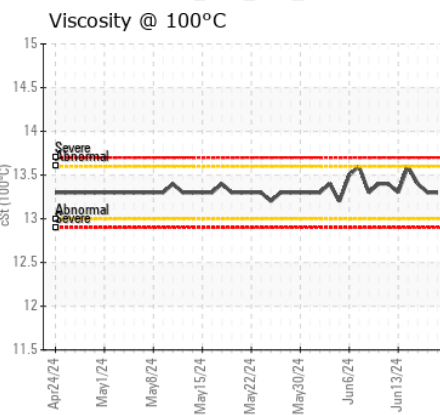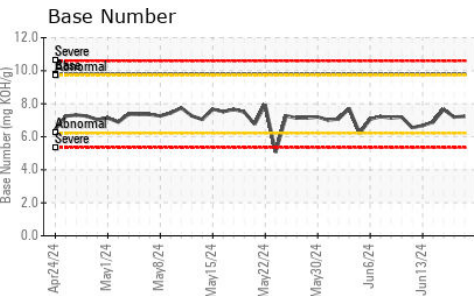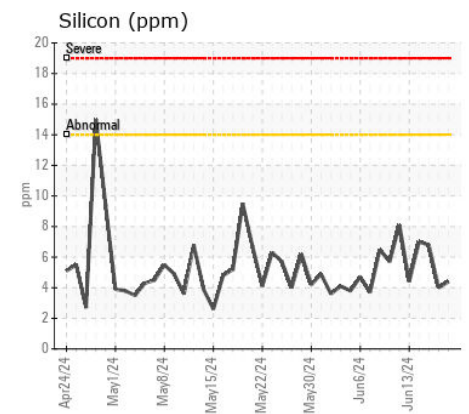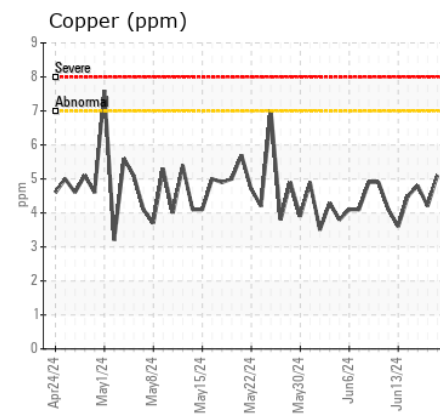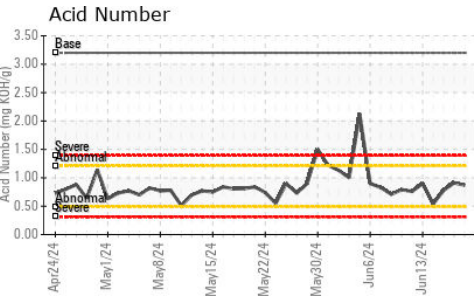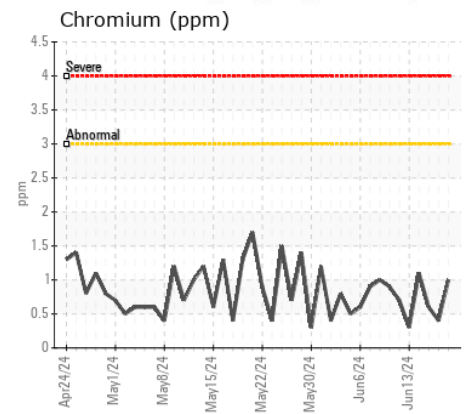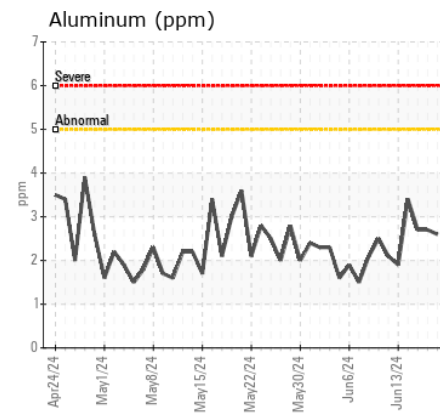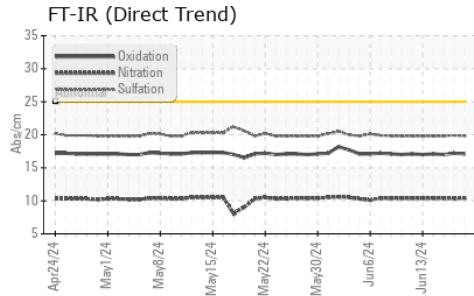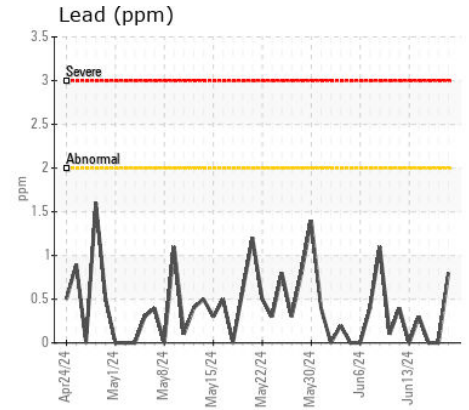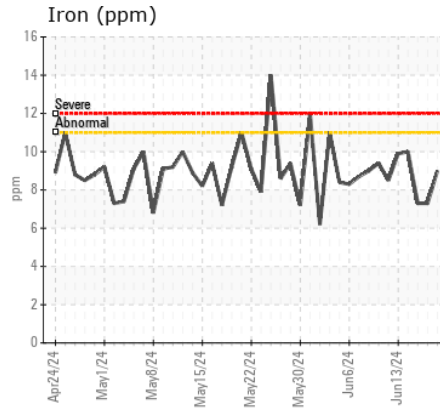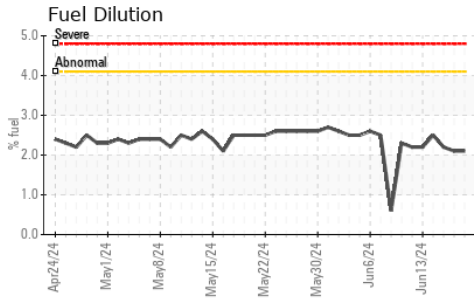

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : WC0952360  
**Lab Number** : 06214917  
**Unique Number** : 11087781  
**Test Package** : MOB 2 ( Additional Tests: FuelDilution, KV40, PercentFuel, VI )

**WEARCHECK LUBRICATION SERVICES QA ACCOUNT**  
 501 Madison Ave  
 Cary, NC  
 US 27513  
 Contact: WCLS CARY NC

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: (919)379-4102

F: (919)379-4050