



OIL ANALYSIS REPORT

WEAR	NORMAL
CONTAMINATION	NORMAL
FLUID CONDITION	NORMAL

Area
ADDITIVES [6156513]
Machine Id
GOULDS 1111-P15A
Component
Pump
Fluid
SHELL OMALA 68 (1 PNT)

RECOMMENDATION

Resample at the next service interval to monitor.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		WC0851082	WC0783960	WC0668704
Sample Date		Client Info		17 Jun 2024	03 Jul 2023	30 Jun 2022
Machine Age	hrs	Client Info		82840	74464	65532
Oil Age	hrs	Client Info		82840	74464	65532
Filter Age	hrs	Client Info		0	0	0
Oil Changed		Client Info		Not Changd	Not Changd	Not Changd
Filter Changed		Client Info		N/A	N/A	N/A
Sample Status				NORMAL	NORMAL	NORMAL

WEAR

All component wear rates are normal.

Iron	ppm	ASTM D5185m	>500	14	5	4
Chromium	ppm	ASTM D5185m	>7	<1	0	0
Nickel	ppm	ASTM D5185m		<1	<1	0
Titanium	ppm	ASTM D5185m		<1	0	0
Silver	ppm	ASTM D5185m		0	<1	0
Aluminum	ppm	ASTM D5185m	>25	2	0	0
Lead	ppm	ASTM D5185m	>35	2	2	2
Copper	ppm	ASTM D5185m	>50	1	2	<1
Tin	ppm	ASTM D5185m	>5	<1	<1	0
Vanadium	ppm	ASTM D5185m		0	0	0
White Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE

CONTAMINATION










There is no indication of any contamination in the oil.

Silicon	ppm	ASTM D5185m	>50	5	<1	3
Potassium	ppm	ASTM D5185m	>20	<1	1	0
Water		WC Method	>.1	NEG	NEG	NEG
Silt	scalar	*Visual	NONE	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>.1	NEG	NEG	NEG

FLUID CONDITION

The condition of the oil is acceptable for the time in service.

Sodium	ppm	ASTM D5185m		<1	0	2
Boron	ppm	ASTM D5185m		0	0	<1
Barium	ppm	ASTM D5185m		<1	0	0
Molybdenum	ppm	ASTM D5185m		<1	0	0
Manganese	ppm	ASTM D5185m		<1	<1	0
Magnesium	ppm	ASTM D5185m		<1	0	0
Calcium	ppm	ASTM D5185m		0	0	0
Phosphorus	ppm	ASTM D5185m		274	271	309
Zinc	ppm	ASTM D5185m		87	129	60
Sulfur	ppm	ASTM D5185m		551	1004	776
Visc @ 40°C	cSt	ASTM D445	68.0	80.2	90.8	83.0

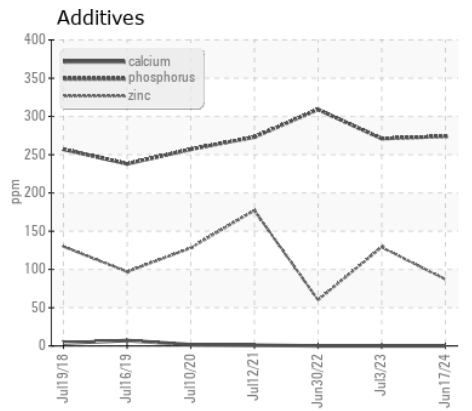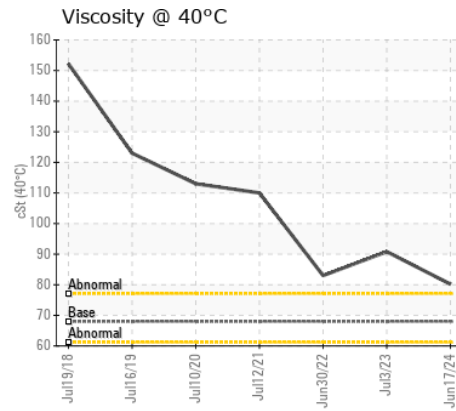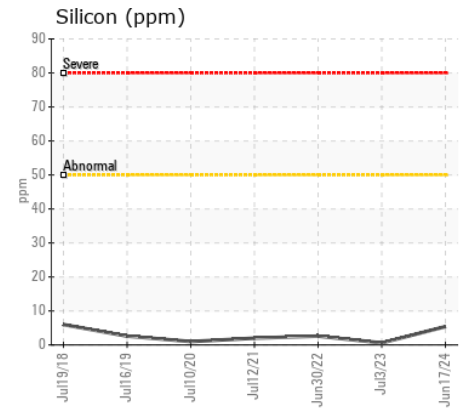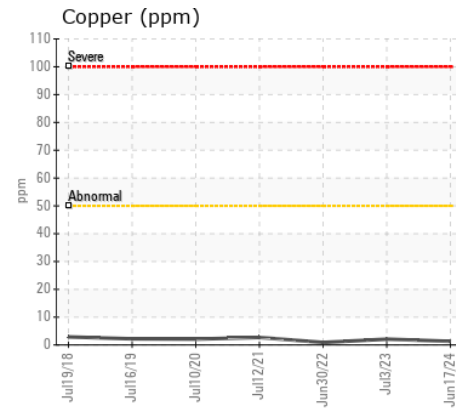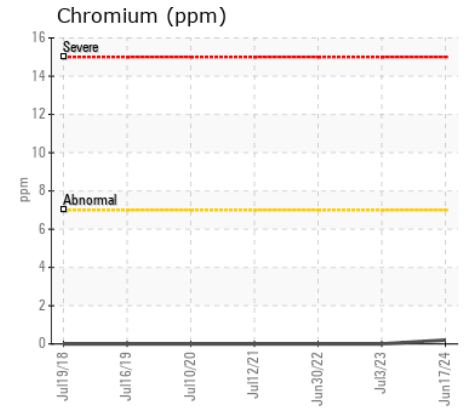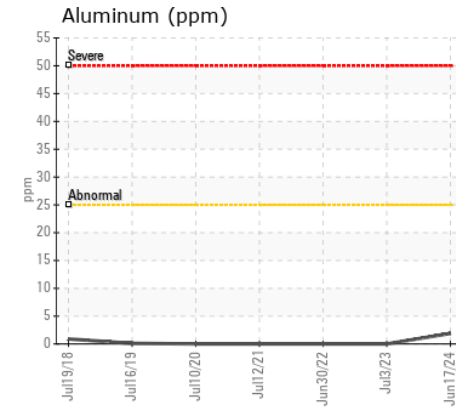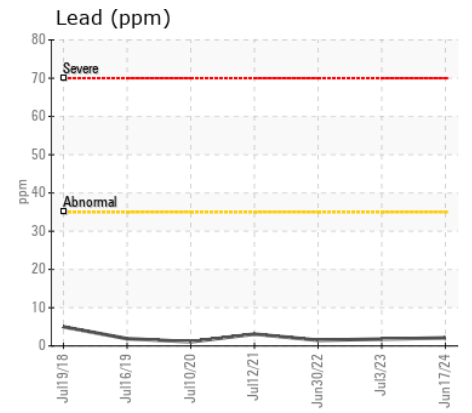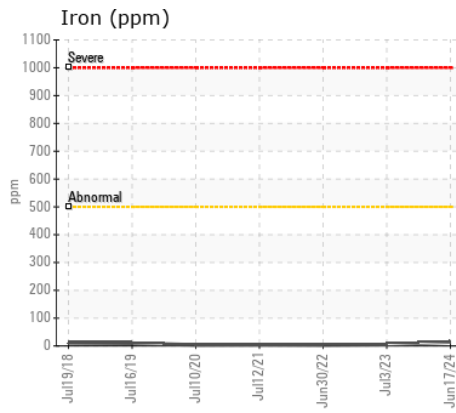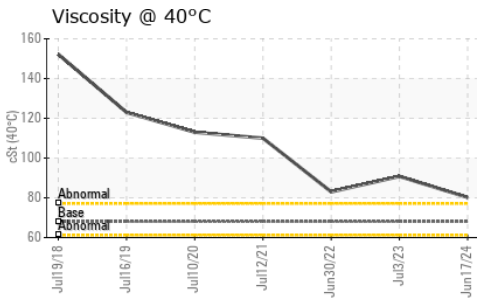

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WC0851082
Lab Number : 06215214
Unique Number : 11088078
Test Package : MOB 1

Received : 19 Jun 2024
Tested : 20 Jun 2024
Diagnosed : 21 Jun 2024 - Sean Felton

DAK AMERICAS LLC
 3216 CEDAR CREEK RD.
 FAYETTEVILLE, NC
 US 28312

Contact: RONNIE HUDSON
 rhudson@alpekpolyester.com
 T: (910)433-8361
 F: (910)433-8218

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)