WEAR CONTAMINATION **FLUID CONDITION**

NORMAL ABNORMAL NORMAL


Machine Id

OK16140 (S/N N20079302)

Component Hydraulic System

LE ISO 68 (1500 GAL)

LE 150 68 (1500 GAL)					.,		
RECOMMENDATION	Test	UOM	Method	Limit/Abn	Current	History1	History2
	Sample Number		Client Info		PH0000067		
No corrective action is recommended at this time. Resample at the next service interval to monitor.	Sample Date		Client Info		27 Apr 2024		
	Machine Age	mths	Client Info		0		
	Oil Age	mths	Client Info		32		
	Filter Age	mths	Client Info		32		
	Oil Changed		Client Info		Changed		
	Filter Changed		Client Info		N/A		
	Sample Status				ABNORMAL		
WEAD							
WEAR All component wear rates are normal.	Iron	ppm	ASTM D5185m		0		
	Chromium	ppm	ASTM D5185m		0		
	Nickel	ppm	ASTM D5185m	>20	0		
	Titanium	ppm	ASTM D5185m		0		
	Silver	ppm	ASTM D5185m	0.0	0		
	Aluminum	ppm	ASTM D5185m		0		
	Lead	ppm	ASTM D5185m		0		
	Copper	ppm	ASTM D5185m		0		
	Tin	ppm	ASTM D5185m	>20	0		
	Vanadium	ppm	ASTM D5185m	NONE	0		
	White Metal	scalar	*Visual	NONE	NONE		
	Yellow Metal	scalar	*Visual	NONE	NONE		
CONTAMINATION	Silicon	ppm	ASTM D5185m	\15	4 0		
CONTAININATION	Potassium	ppm	ASTM D5105m		3		
Elemental level of silicon (Si) above normal. The amount and size of particulates present in the system are acceptable.	Water	ррпп	WC Method		NEG		
	Particles >4µm		ASTM D7647		1699		
	Particles >6µm		ASTM D7647		284		
	Particles >14µm		ASTM D7647		8		
	Particles >21µm		ASTM D7647		1		
	Particles >38µm		ASTM D7647		0		
	Particles >71µm		ASTM D7647		0		
	Oil Cleanliness		ISO 4406 (c)		18/15/10		
	Silt	scalar	*Visual	NONE	NONE		
	Debris	scalar	*Visual	NONE	NONE		
	Sand/Dirt	scalar	*Visual	NONE	NONE		
	Appearance	scalar	*Visual	NORML	NORML		
	Odor	scalar	*Visual	NORML	NORML		
	Emulsified Water		*Visual	>0.05	NEG		
FLUID CONDITION	Sodium	ppm	ASTM D5185m		2		
	Boron	ppm	ASTM D5185m		0		
The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.	Barium	ppm	ASTM D5185m		0		
	Molybdenum	ppm	ASTM D5185m		0		
	Manganese	ppm	ASTM D5185m		<1		
	Magnesium	ppm	ASTM D5185m		0		
	Calcium	ppm	ASTM D5185m		0		
	Phosphorus	ppm	ASTM D5185m		83		
	Zinc	ppm	ASTM D5185m		26		
			ASTM D5185m		254		
	Sulfur	ppm	710 THI DOTOOTT				
	Sulfur Acid Number (AN)	mg KOH/g	ASTM D8045		0.31		

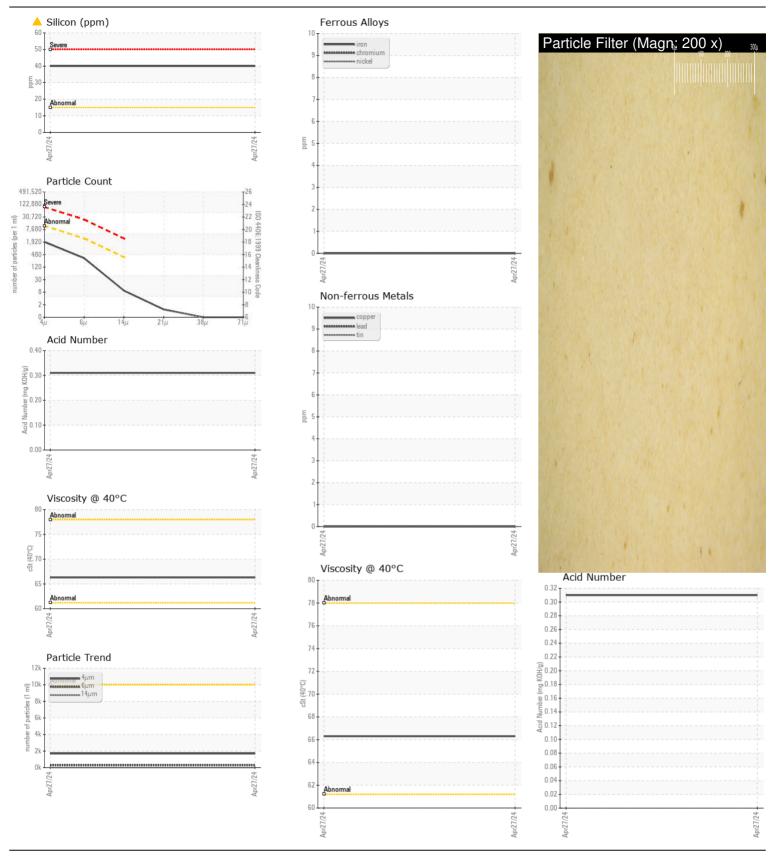



Certificate L2367

Laboratory Sample No.

Lab Number : 06215792 Unique Number : 11088656

: PH0000067

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 Received

: 20 Jun 2024 **Tested** Diagnosed Test Package : PLANT (Additional Tests: PrtFilter)

: 24 Jun 2024 : 24 Jun 2024 - Doug Bogart **SCHWANS PRODUCTS 5 E WALNUT** STILWELL, OK US 74960

Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:

F: