



OIL ANALYSIS REPORT

WEAR	NORMAL
CONTAMINATION	NORMAL
FLUID CONDITION	NORMAL

Machine Id
T-68 SECONDARY CONTAINER - MOBIL TERESSTIC 68

Component
New (Unused) Oil
Fluid
MOBIL TERESSTIC 68 (--- GAL)

RECOMMENDATION

This is a baseline read-out on the submitted sample.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		TO10003288	---	---
Sample Date		Client Info		19 Jun 2024	---	---
Machine Age	hrs	Client Info		0	---	---
Oil Age	hrs	Client Info		0	---	---
Filter Age	hrs	Client Info		0	---	---
Oil Changed		Client Info		N/A	---	---
Filter Changed		Client Info		N/A	---	---
Sample Status				NORMAL	---	---

WEAR











Iron	ppm	ASTM D5185m	>5	0	---	---
Chromium	ppm	ASTM D5185m	>5	0	---	---
Nickel	ppm	ASTM D5185m	>5	0	---	---
Titanium	ppm	ASTM D5185m		0	---	---
Silver	ppm	ASTM D5185m	>5	0	---	---
Aluminum	ppm	ASTM D5185m	>5	0	---	---
Lead	ppm	ASTM D5185m	>5	0	---	---
Copper	ppm	ASTM D5185m	>5	0	---	---
Tin	ppm	ASTM D5185m	>5	0	---	---
Vanadium	ppm	ASTM D5185m		0	---	---
White Metal	scalar	*Visual	NONE	NONE	---	---
Yellow Metal	scalar	*Visual	NONE	NONE	---	---

CONTAMINATION

Silicon	ppm	ASTM D5185m	>15	2	---	---
Potassium	ppm	ASTM D5185m	>20	2	---	---
Water	%	ASTM D6304		0.002	---	---
ppm Water	ppm	ASTM D6304		16	---	---
Particles >4µm		ASTM D7647		1384	---	---
Particles >6µm		ASTM D7647	>1300	279	---	---
Particles >14µm		ASTM D7647	>80	18	---	---
Particles >21µm		ASTM D7647	>20	3	---	---
Particles >38µm		ASTM D7647	>4	0	---	---
Particles >71µm		ASTM D7647	>3	0	---	---
Oil Cleanliness		ISO 4406 (c)	>-/17/13	18/15/11	---	---
Silt	scalar	*Visual	NONE	NONE	---	---
Debris	scalar	*Visual	NONE	NONE	---	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---	---
Appearance	scalar	*Visual	NORML	NORML	---	---
Odor	scalar	*Visual	NORML	NORML	---	---
Emulsified Water	scalar	*Visual		NEG	---	---

FLUID CONDITION

Sodium	ppm	ASTM D5185m		2	---	---
Boron	ppm	ASTM D5185m		0	---	---
Barium	ppm	ASTM D5185m		0	---	---
Molybdenum	ppm	ASTM D5185m		0	---	---
Manganese	ppm	ASTM D5185m		<1	---	---
Magnesium	ppm	ASTM D5185m		0	---	---
Calcium	ppm	ASTM D5185m		0	---	---
Phosphorus	ppm	ASTM D5185m		1	---	---
Zinc	ppm	ASTM D5185m		3	---	---
Sulfur	ppm	ASTM D5185m		1869	---	---
Acid Number (AN)	mg KOH/g	ASTM D8045	0.06	0.047	---	---
Visc @ 40°C	cSt	ASTM D445	68.0	65.42	---	---
Visc @ 100°C	cSt	ASTM D445	8.5	8.66	---	---
Viscosity Index (VI)	Scale	ASTM D2270	95	103	---	---

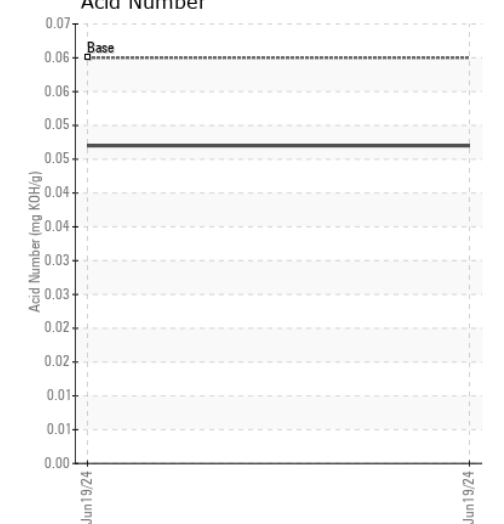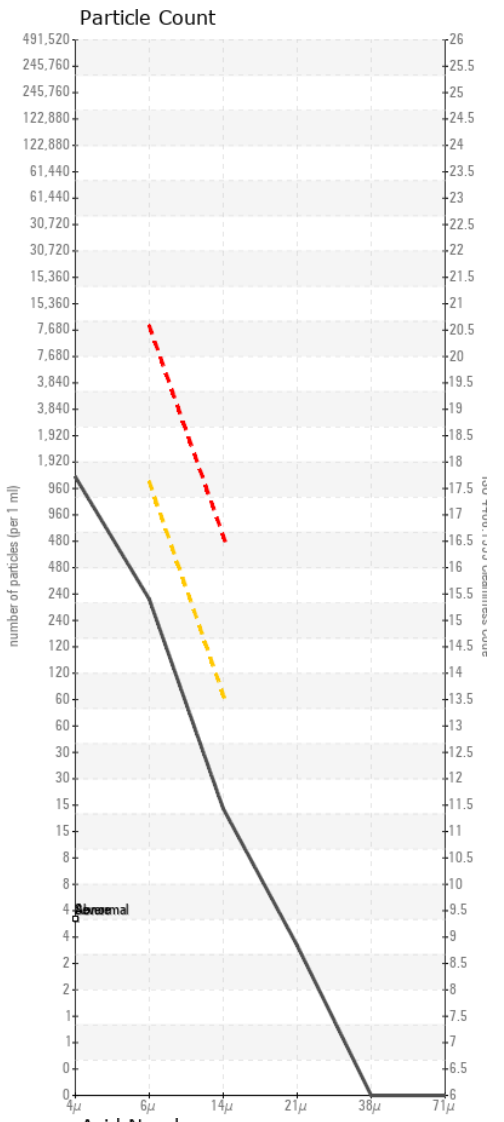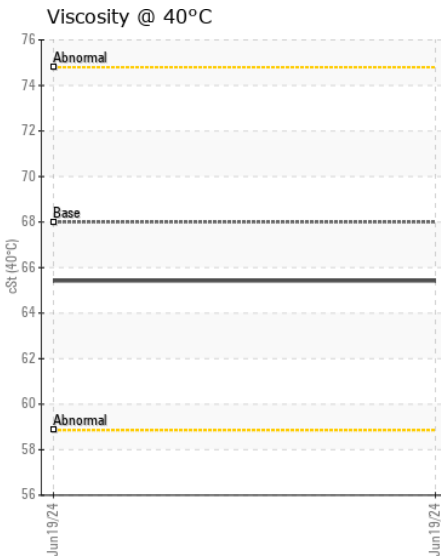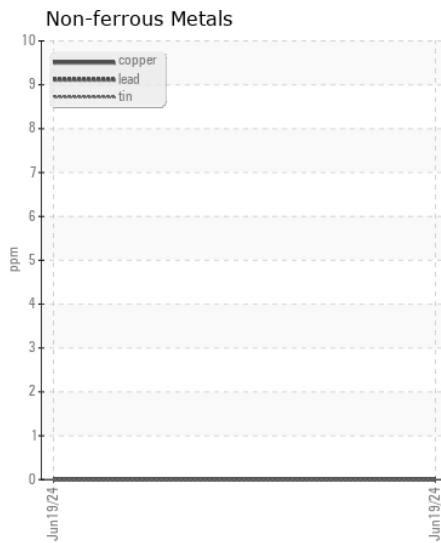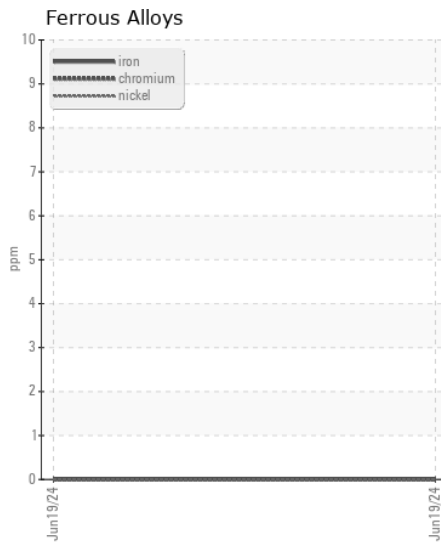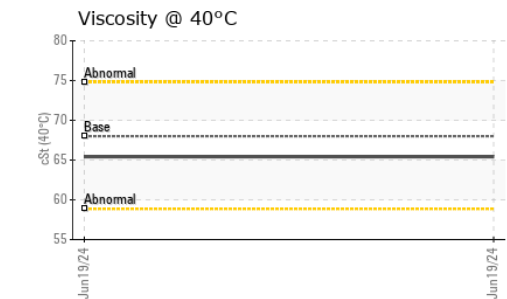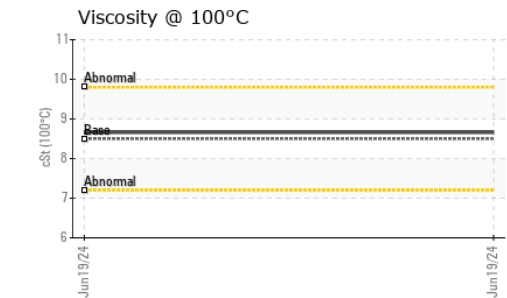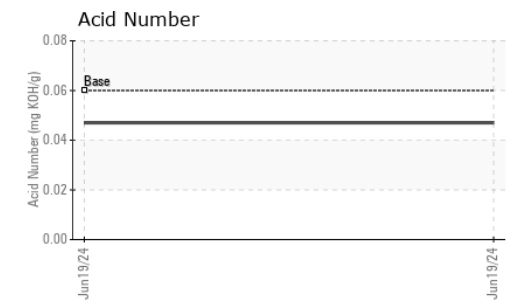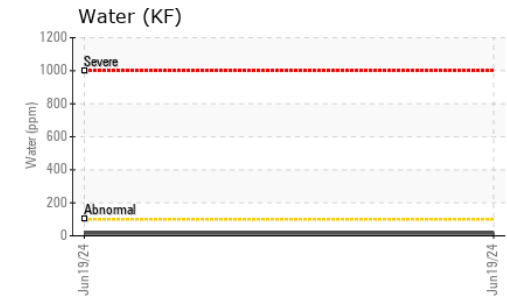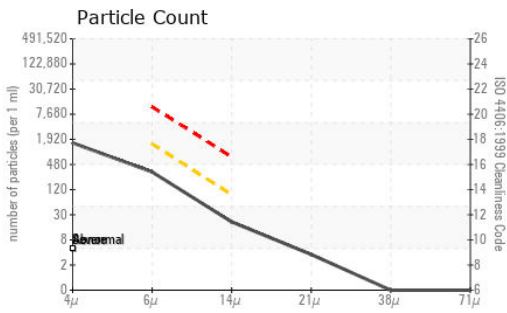

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : TO10003288 **Received** : 20 Jun 2024
Lab Number : 06216234 **Tested** : 24 Jun 2024
Unique Number : 11089098 **Diagnosed** : 24 Jun 2024 - Jonathan Hester
Test Package : IND 2 (Additional Tests: FT-IR, KF, KV100, PrtCount, VI)

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

KOCH INDUSTRIAL FERTILIZER
 1619 S 78TH ST
 ENID, OK
 US 73701
 Contact: ALEX QUERRY
 alexander.querry@kochind.com

T:
F: