



WEAR	NORMAL
CONTAMINATION	NORMAL
FLUID CONDITION	NORMAL



Machine Id
MARK STAAB (S/N SAX00753)
Component
Starboard Genset
Fluid
CHEVRON DELO 400 XLE 15W40 (5 GAL)

RECOMMENDATION

Resample at the next service interval to monitor.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		MW0062248	MW0062268	MW0062266
Sample Date		Client Info		15 Jun 2024	11 Apr 2024	29 Feb 2024
Machine Age	hrs	Client Info		43833	42843	42337
Oil Age	hrs	Client Info		1199	245	425
Filter Age	hrs	Client Info		1199	245	425
Oil Changed		Client Info		Changed	Changed	Changed
Filter Changed		Client Info		Changed	Changed	Changed
Sample Status				NORMAL	NORMAL	NORMAL

WEAR

All component wear rates are normal.

Iron	ppm	ASTM D5185m	>62	6	4	7
Chromium	ppm	ASTM D5185m	>3	0	0	<1
Nickel	ppm	ASTM D5185m	>2	0	0	1
Titanium	ppm	ASTM D5185m		12	15	16
Silver	ppm	ASTM D5185m	>5	0	0	0
Aluminum	ppm	ASTM D5185m	>4	2	2	2
Lead	ppm	ASTM D5185m	>25	0	0	1
Copper	ppm	ASTM D5185m	>274	<1	0	2
Tin	ppm	ASTM D5185m	>2	<1	<1	<1
Vanadium	ppm	ASTM D5185m		<1	0	<1
White Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE

CONTAMINATION








There is no indication of any contamination in the oil.

Silicon	ppm	ASTM D5185m	>15	6	5	7
Potassium	ppm	ASTM D5185m	>20	5	2	4
Fuel		WC Method	>4.0	<1.0	<1.0	<1.0
Water		WC Method	>0.1	NEG	NEG	NEG
Glycol		WC Method		NEG	NEG	NEG
Soot %	%	*ASTM D7844		0.4	0.2	0.2
Nitration	Abs/cm	*ASTM D7624	>20	9.3	8.7	9.2
Sulfation	Abs/.1mm	*ASTM D7415	>30	19.7	18.6	19.1
Silt	scalar	*Visual	NONE	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG	NEG

FLUID CONDITION

The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.

Sodium	ppm	ASTM D5185m		3	<1	1
Boron	ppm	ASTM D5185m		54	78	98
Barium	ppm	ASTM D5185m		0	0	0
Molybdenum	ppm	ASTM D5185m		44	28	33
Manganese	ppm	ASTM D5185m		<1	1	1
Magnesium	ppm	ASTM D5185m		739	716	744
Calcium	ppm	ASTM D5185m		1507	1482	1563
Phosphorus	ppm	ASTM D5185m	760	756	693	695
Zinc	ppm	ASTM D5185m	830	835	781	837
Sulfur	ppm	ASTM D5185m	2770	3501	3358	3102
Oxidation	Abs/.1mm	*ASTM D7414	>25	16.1	13.8	15.5
Base Number (BN)	mg KOH/g	ASTM D2896	10.7	6.7	7.7	7.3
Visc @ 100°C	cSt	ASTM D445	14.9	13.2	13.3	12.9

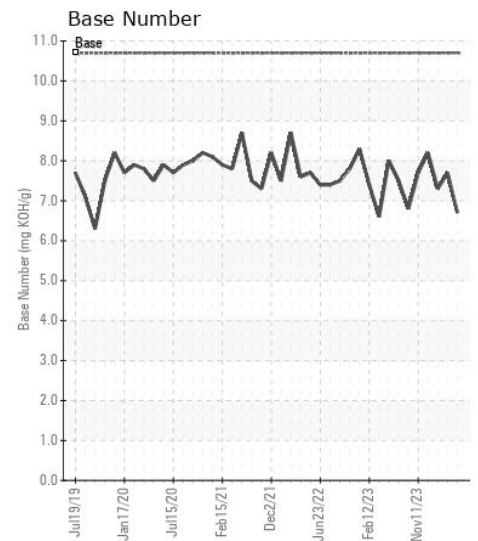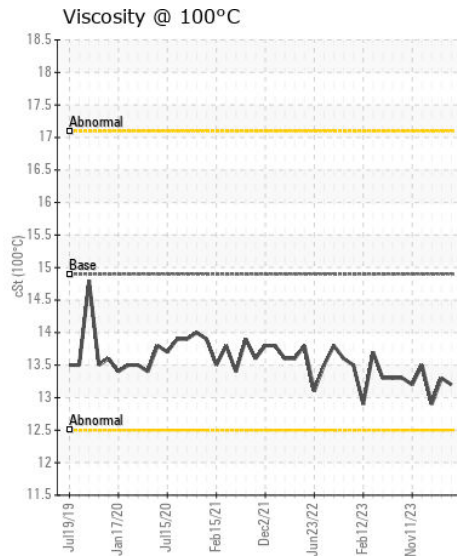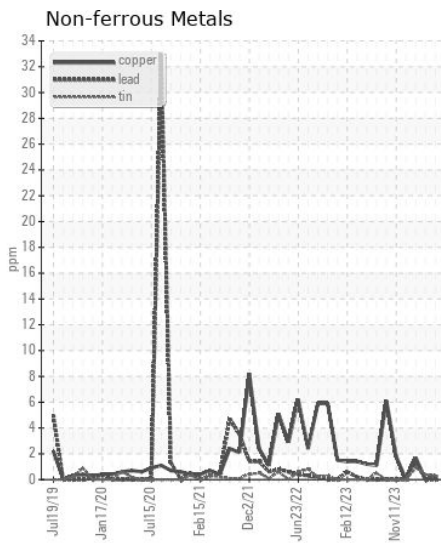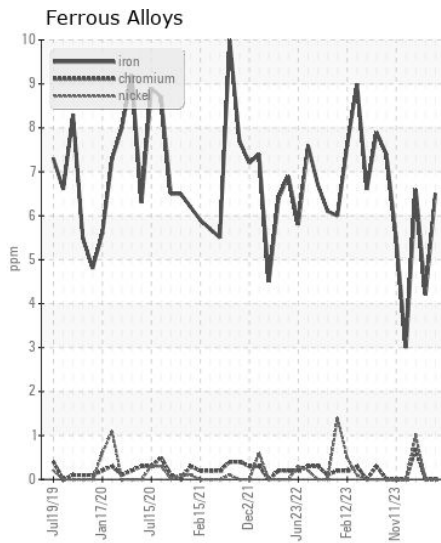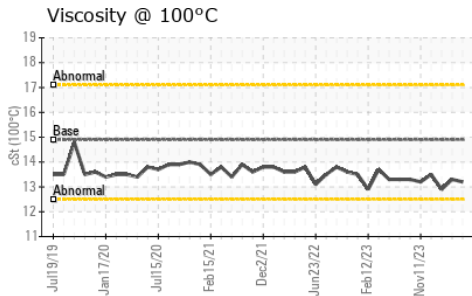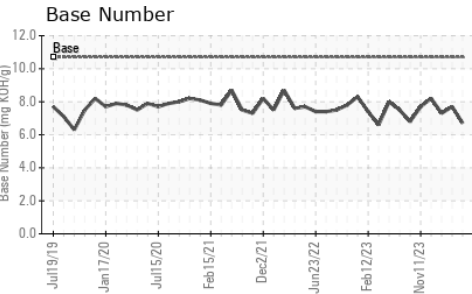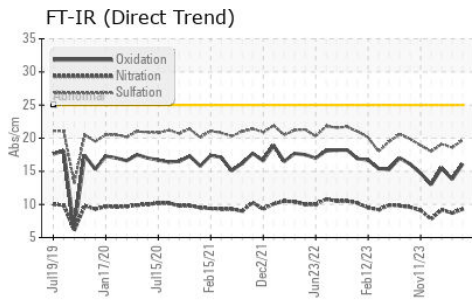

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : MW0062248
Lab Number : 06216652
Unique Number : 11089516
Test Package : MAR 2

Received : 21 Jun 2024
Tested : 24 Jun 2024
Diagnosed : 24 Jun 2024 - Wes Davis

AMERICAN COMMERCIAL LINES
 PO BOX 610, 1701 E. MARKET STREET
 JEFFERSONVILLE, IN
 US 47130
 Contact: RONALD SCHNEIDER
 ronald.schneider@bargaeacbl.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:
 F: (812)288-1644