

Machine Id **5049** Component **Diesel Engine** Filuid **DIESEL ENGINE OIL SAE 40 (--- GAL)**

					~~~~~		
RECOMMENDATION	Test	UOM	Method	Limit/Abn	Current	History1	History2
Resample at the next service interval to monitor. Please specify the brand, type, and viscosity of the oil on your next sample.	Sample Number		Client Info		JR0210463	JR0195169	JR0169491
	Sample Date		Client Info		06 Jun 2024	29 Jan 2024	08 Aug 2023
	Machine Age	hrs	Client Info		2118	1385	617
	Oil Age	hrs	Client Info		1385	1000	617
	Filter Age	hrs	Client Info		1385	1000	617
	Oil Changed		Client Info		Changed	Changed	Changed
	Filter Changed		Client Info		Changed	Changed	Changed
	Sample Status				NORMAL	NORMAL	ATTENTION
WEAR	Iron	ppm	ASTM D5185m	>100	10	14	17
All component wear rates are normal.	Chromium	ppm	ASTM D5185m	>20	<1	<1	1
	Nickel	ppm	ASTM D5185m	>4	<1	<1	<1
	Titanium	ppm	ASTM D5185m		0	<1	<1
	Silver	ppm	ASTM D5185m	>3	0	0	0
	Aluminum	ppm	ASTM D5185m	>20	2	3	6
	Lead	ppm	ASTM D5185m	>40	0	1	<1
	Copper	ppm	ASTM D5185m	>330	6	10	13
	Tin	ppm	ASTM D5185m	>15	<1	<1	<1
	Vanadium	ppm	ASTM D5185m		0	<1	0
	White Metal	scalar	*Visual	NONE	NONE	NONE	NONE
	Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE
CONTAMINATION	Silicon	ppm	ASTM D5185m	>25	5	9	34
CONTAMINATION	Potassium	ppm	ASTM D5185m		4	6	16
There is no indication of any contamination in the oil.	Fuel	ppiii	WC Method		<1.0	<1.0	0.2
	Water		WC Method		NEG	NEG	NEG
	Glycol		WC Method		NEG	NEG	NEG
	Soot %	%	*ASTM D7844	>3	0.1	0.1	0.1
	Nitration	Abs/cm	*ASTM D7624	>20	9.2	8.7	9.6
	Sulfation	Abs/.1mm	*ASTM D7415	>30	23.0	22.1	20.2
	Silt	scalar	*Visual	NONE	NONE	NONE	NONE
	Debris	scalar	*Visual	NONE	NONE	NONE	NONE
	Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
	Appearance	scalar	*Visual	NORML	NORML	NORML	NORML
	Odor	scalar	*Visual	NORML	NORML	NORML	NORML
	Emulsified Water	scalar	*Visual	>0.2	NEG	NEG	NEG
FLUID CONDITION	Sodium	ppm	ASTM D5185m	>216	2	2	2
	Boron		ASTM D5185m		3	6	31
The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.	Barium	ppm ppm	ASTM D5185m		0	0	2
	Molybdenum	ppm	ASTM D5185m		3	8	39
	Manganese	ppm	ASTM D5185m		<1	1	2
	Magnesium	ppm	ASTM D5185m	450	67	112	480
	Calcium	ppm	ASTM D5185m		2535	2344	1652
	Phosphorus	ppm	ASTM D5185m		974	1022	779
	Zinc	ppm	ASTM D5185m		1192	1186	946
	Sulfur	ppm	ASTM D5185m		4397	3801	2739
	Oxidation	Abs/.1mm	*ASTM D7414	>25	15.1	14.9	21.0
		1/011/	LOTUDADA	o =		= 4	= 0

Base Number (BN) mg KOH/g ASTM D2896 8.5

ASTM D445 14.4

Visc @ 100°C cSt


13.3

5.4 7.9

11.5

5.0

13.6

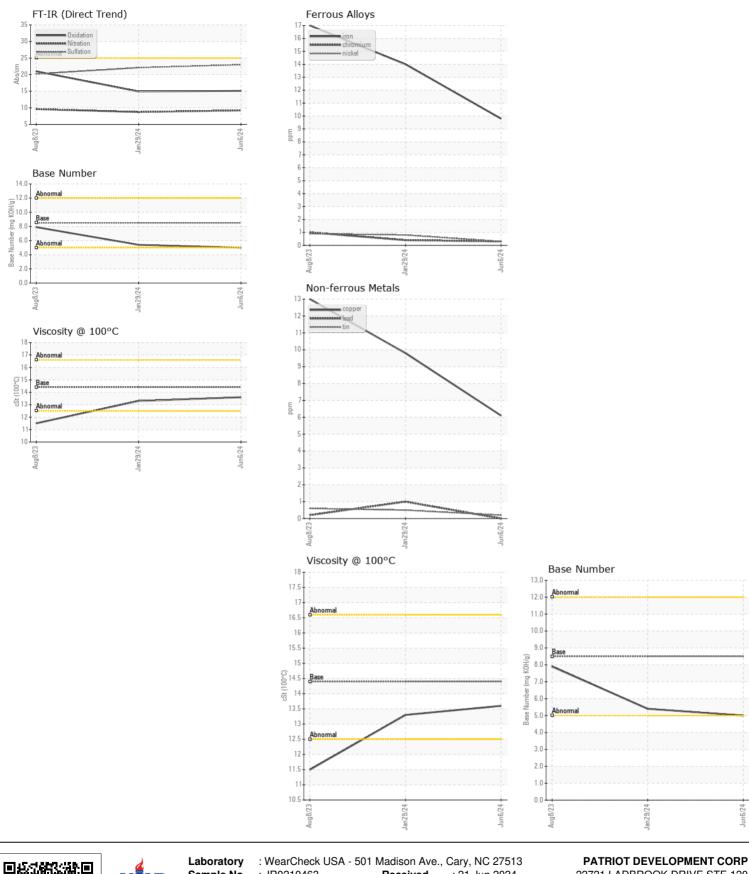

Sample No. : JR0210463 Received : 21 Jun 2024 22721 LADBROOK DRIVE STE 120 Lab Number : 06216729 Tested : 24 Jun 2024 STERLING, VA Unique Number : 11089593 Diagnosed : 24 Jun 2024 - Wes Davis US 20166 Test Package : CONST (Additional Tests: TBN) Contact: ROBERT MOSS Certificate L2367 To discuss this sample report, contact Customer Service at 1-800-237-1369. robert.moss@patriotdev.net * - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Т: F: Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Submitted By: BRANDON STEVENS Page 2 of 2