



OIL ANALYSIS REPORT

WEAR	NORMAL
CONTAMINATION	NORMAL
FLUID CONDITION	NORMAL

Area

TE-PAO 46

Machine Id

KAESER 01114256 - CALIBER FACILITIES 1741

Component

Compressor

RECOMMENDATION

Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		UCH06216952	---	---
Sample Date		Client Info		09 May 2024	---	---
Machine Age	hrs	Client Info		38703	---	---
Oil Age	hrs	Client Info		0	---	---
Filter Age	hrs	Client Info		0	---	---
Oil Changed		Client Info		Changed	---	---
Filter Changed		Client Info		Changed	---	---
Sample Status				NORMAL	---	---

WEAR

All component wear rates are normal.

Iron	ppm	ASTM D5185m	>50	0	---	---
Chromium	ppm	ASTM D5185m	>10	0	---	---
Nickel	ppm	ASTM D5185m	>3	0	---	---
Titanium	ppm	ASTM D5185m	>3	0	---	---
Silver	ppm	ASTM D5185m	>2	0	---	---
Aluminum	ppm	ASTM D5185m	>10	<1	---	---
Lead	ppm	ASTM D5185m	>10	0	---	---
Copper	ppm	ASTM D5185m	>50	0	---	---
Tin	ppm	ASTM D5185m	>10	0	---	---
Vanadium	ppm	ASTM D5185m		<1	---	---
White Metal	scalar	*Visual	NONE	NONE	---	---
Yellow Metal	scalar	*Visual	NONE	NONE	---	---

CONTAMINATION







Moderate concentration of visible dirt/debris present in the oil.

Silicon	ppm	ASTM D5185m	>25	<1	---	---
Potassium	ppm	ASTM D5185m	>20	<1	---	---
Water		WC Method	>0.05	NEG	---	---
Silt	scalar	*Visual	NONE	NONE	---	---
Debris	scalar	*Visual	NONE	MODER	---	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---	---
Appearance	scalar	*Visual	NORML	NORML	---	---
Odor	scalar	*Visual	NORML	NORML	---	---
Emulsified Water	scalar	*Visual	>0.05	NEG	---	---

FLUID CONDITION

The AN level is acceptable for this fluid. The condition of the oil is acceptable for the time in service.

Sodium	ppm	ASTM D5185m		1	---	---
Boron	ppm	ASTM D5185m		0	---	---
Barium	ppm	ASTM D5185m		1	---	---
Molybdenum	ppm	ASTM D5185m		0	---	---
Manganese	ppm	ASTM D5185m		<1	---	---
Magnesium	ppm	ASTM D5185m		<1	---	---
Calcium	ppm	ASTM D5185m		0	---	---
Phosphorus	ppm	ASTM D5185m		529	---	---
Zinc	ppm	ASTM D5185m		6	---	---
Sulfur	ppm	ASTM D5185m		145	---	---
Acid Number (AN)	mg KOH/g	ASTM D8045		0.20	---	---
Visc @ 40°C	cSt	ASTM D445		46.0	---	---

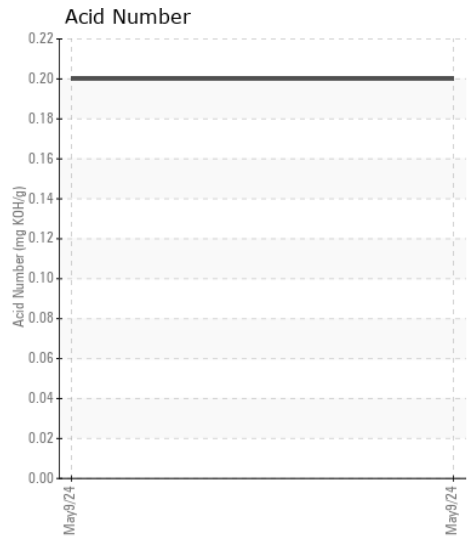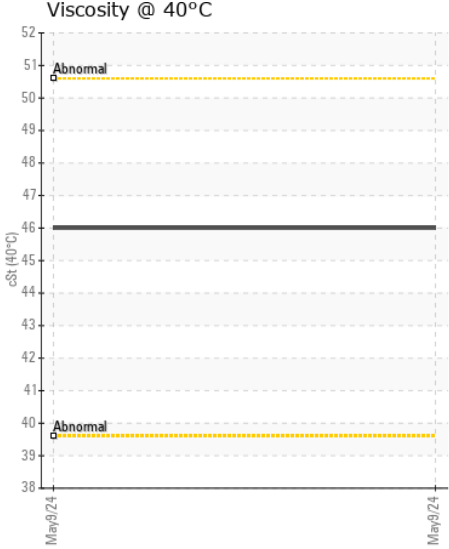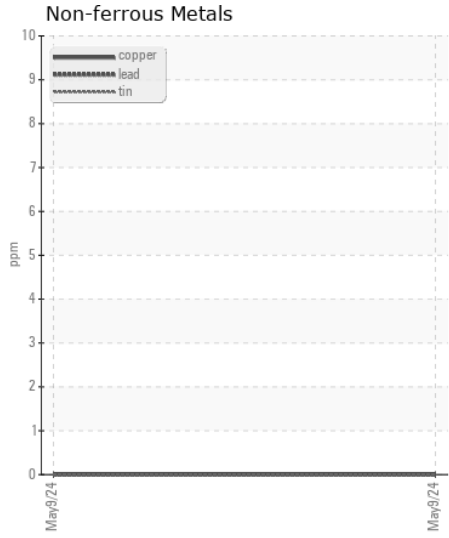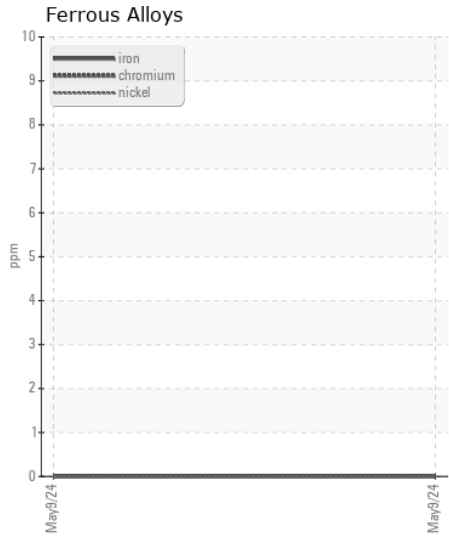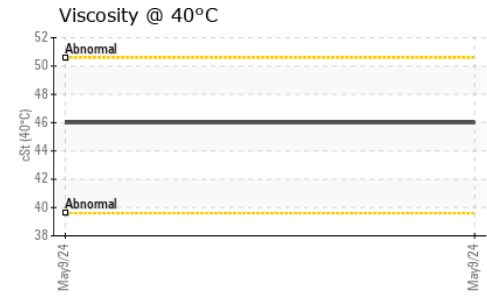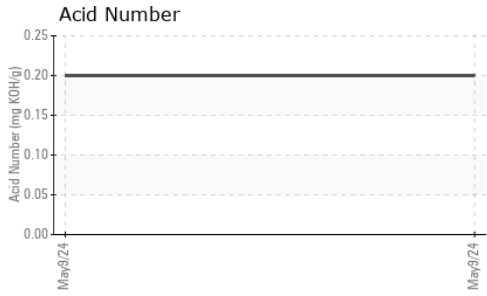

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : UCH06216952 **Received** : 21 Jun 2024
Lab Number : 06216952 **Tested** : 24 Jun 2024
Unique Number : 11089816 **Diagnosed** : 24 Jun 2024 - Sean Felton
Test Package : IND 2

TATE ENGINEERING
 8131 VIRGINIA PINE CT
 RICHMOND, VA
 US 23237

Contact: RANDY BEAUCHAMP
 randy.beauchamp@tate.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: (757)214-6541
 F: (804)743-0415