

WEAR NORMAL CONTAMINATION NORMAL FLUID CONDITION NORMAL


PALASYN 45 Machine Id SULLIVAN PALATEK 1803290003 - JET SPECIALTY Component Compressor

RECOMMENDATION	Test	UOM	Method	Limit/Abn	Current	History1	History2
Resample at the next service interval to monitor.	Sample Number		Client Info		UCS06217016		
	Sample Date		Client Info		18 Jun 2024		
	Machine Age	hrs	Client Info		53443		
	Oil Age	hrs	Client Info		922		
	Filter Age	hrs	Client Info		922		
	Oil Changed		Client Info		N/A		
	Filter Changed		Client Info		N/A		
	Sample Status				NORMAL		
WEAR	Iron	ppm	ASTM D5185m	>50	0		
All component wear rates are normal.	Chromium	ppm	ASTM D5185m	>10	0		
	Nickel	ppm	ASTM D5185m		0		
	Titanium	ppm	ASTM D5185m		0		
	Silver	ppm	ASTM D5185m		0		
	Aluminum	ppm	ASTM D5185m	>25	<1		
	Lead	ppm	ASTM D5185m	>25	0		
	Copper	ppm	ASTM D5185m	>50	0		
	Tin	ppm	ASTM D5185m	>15	0		
	Vanadium	ppm	ASTM D5185m		<1		
	White Metal	scalar	*Visual	NONE	NONE		
	Yellow Metal	scalar	*Visual	NONE	NONE		
CONTAMINATION	Silicon	ppm	ASTM D5185m	>25	2		
	Potassium	ppm	ASTM D5185m		<1		
There is no indication of any contamination in the oil.	Water	le le	WC Method	>0.1	NEG		
	Silt	scalar	*Visual	NONE	NONE		
	Debris	scalar	*Visual	NONE	NONE		
	Sand/Dirt	scalar	*Visual	NONE	NONE		
	Appearance	scalar	*Visual	NORML	NORML		
	Odor	scalar	*Visual	NORML	NORML		
	Emulsified Water	scalar	*Visual	>0.1	NEG		
FLUID CONDITION	Sodium		ASTM D5185m		<1		
	Sodium Boron	ppm	ASTM D5185m	0.0	0		
The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.	Barium	ppm ppm	ASTM D5185m		0		
	Molybdenum	ppm	ASTM D5185m		0		
	Manganese	ppm	ASTM D5185m		ہ <1		
	Magnesium	ppm	ASTM D5185m		0		
	Calcium	ppm	ASTM D5185m		0		
	Phosphorus	ppm	ASTM D5185m		676		
	Zinc	ppm	ASTM D5185m		0		
	Sulfur	ppm	ASTM D5185m		297		
	Acid Number (AN)	mg KOH/g			0.18		
	()	00		_			

Contact/Location: NOEMI TREVINO - UCAIRGRETX

43.7

Visc @ 40°C cSt ASTM D445 39.9

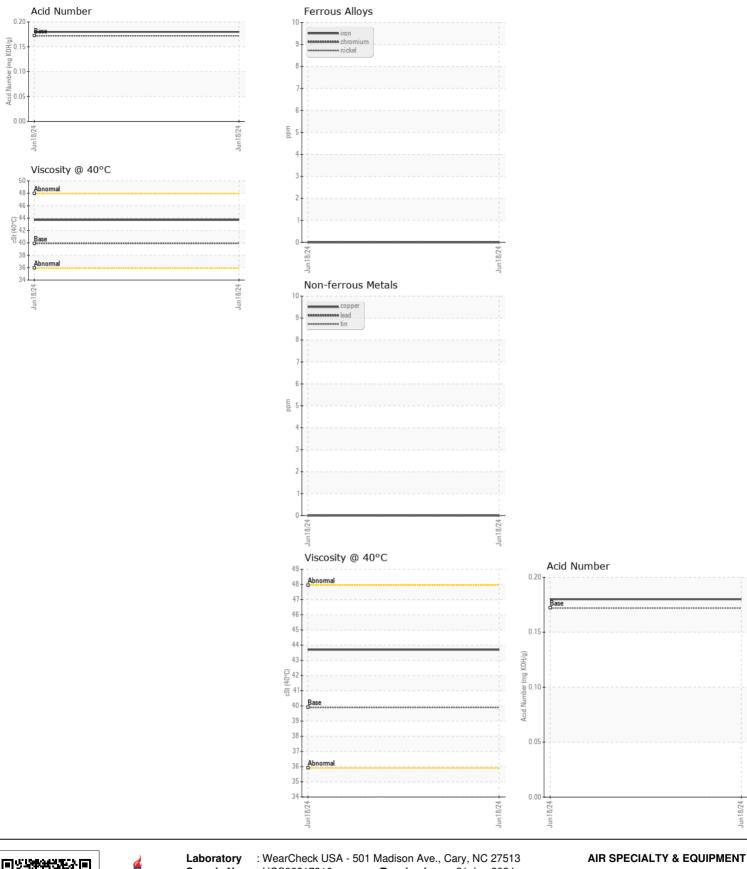

Sample No. : UCS06217016 Received : 21 Jun 2024 Lab Number : 06217016 Tested : 24 Jun 2024 GREGORY, TX Unique Number : 11089880 Diagnosed : 24 Jun 2024 - Wes Davis US 78359 Test Package : IND 2 Contact: NOEMI TREVINO Certificate L2367 To discuss this sample report, contact Customer Service at 1-800-237-1369. service@airspecialty.com * - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Т: Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012) F: