



Area

PALEXTRA 44 [8018199]

Machine Id

SULLIVAN PALATEK 1808230009 - DEDGEEST STEEL WORKS

Component

Compressor

RECOMMENDATION

We advise that you check for a possible overheat condition. We recommend that you drain the oil from the component if this has not already been done. We recommend an early resample to monitor this condition.

WEAR

The copper level is abnormal. All other component wear rates are normal.








CONTAMINATION

There is no indication of any contamination in the oil.

FLUID CONDITION

The AN level is above the recommended limit.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		UCS06217017	UCS06132756	UCS05720653
Sample Date		Client Info		14 Jun 2024	22 Mar 2024	14 Dec 2022
Machine Age	hrs	Client Info		10931	9405	5511
Oil Age	hrs	Client Info		1527	9405	5511
Filter Age	hrs	Client Info		1527	2074	1180
Oil Changed		Client Info		Not Changed	Changed	Not Changed
Filter Changed		Client Info		Changed	Changed	Changed
Sample Status				ABNORMAL	SEVERE	NORMAL
Iron	ppm	ASTM D5185m	>50	2	<1	2
Chromium	ppm	ASTM D5185m	>10	0	0	0
Nickel	ppm	ASTM D5185m		0	0	0
Titanium	ppm	ASTM D5185m		0	0	0
Silver	ppm	ASTM D5185m		0	0	0
Aluminum	ppm	ASTM D5185m	>25	<1	0	0
Lead	ppm	ASTM D5185m	>25	8	0	0
Copper	ppm	ASTM D5185m	>50	44	0	<1
Tin	ppm	ASTM D5185m	>15	0	0	0
Vanadium	ppm	ASTM D5185m		<1	0	0
White Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Silicon	ppm	ASTM D5185m	>25	3	3	10
Potassium	ppm	ASTM D5185m	>20	1	<1	0
Water		WC Method	>0.1	NEG	NEG	NEG
Silt	scalar	*Visual	NONE	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	LIGHT	NONE	VLITE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG	NEG
Sodium	ppm	ASTM D5185m		1	<1	2
Boron	ppm	ASTM D5185m	0	0	4	<1
Barium	ppm	ASTM D5185m	0.3	0	0	0
Molybdenum	ppm	ASTM D5185m	0	<1	0	<1
Manganese	ppm	ASTM D5185m	0.3	<1	0	<1
Magnesium	ppm	ASTM D5185m	0.4	0	0	<1
Calcium	ppm	ASTM D5185m	0	0	0	0
Phosphorus	ppm	ASTM D5185m	689	483	314	416
Zinc	ppm	ASTM D5185m	0	28	0	0
Sulfur	ppm	ASTM D5185m	1237	321	153	80
Acid Number (AN)	mg KOH/g	ASTM D8045	0.135	2.46	6.656	0.46
Visc @ 40°C	cSt	ASTM D445	44.62	50.1	66.0	45.2

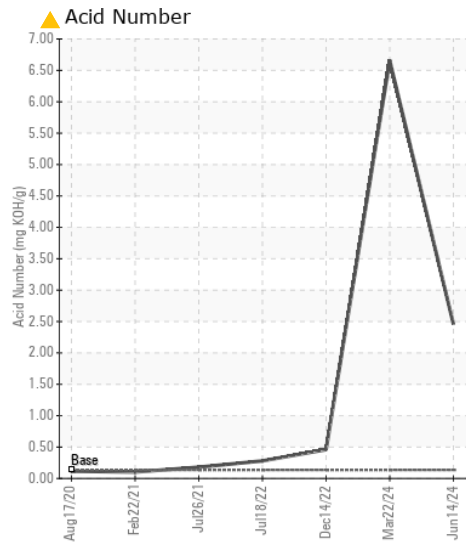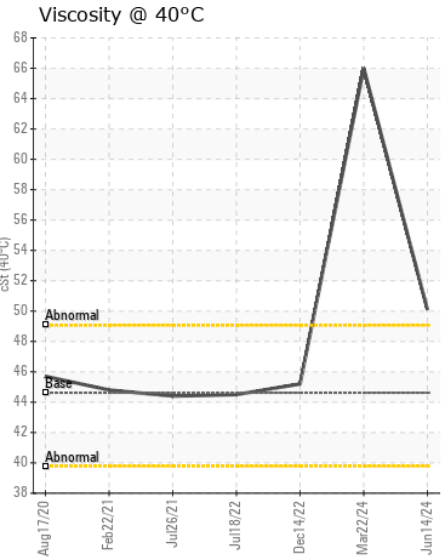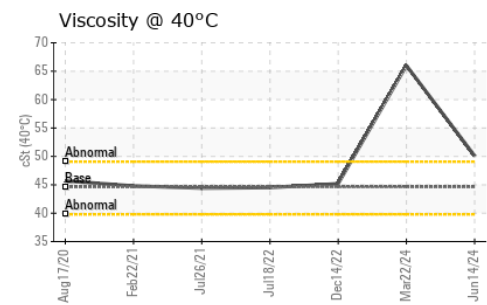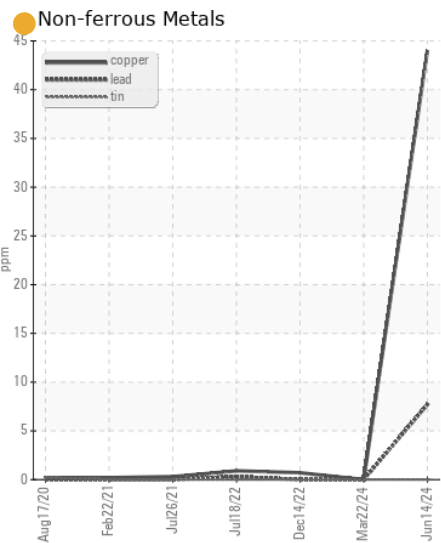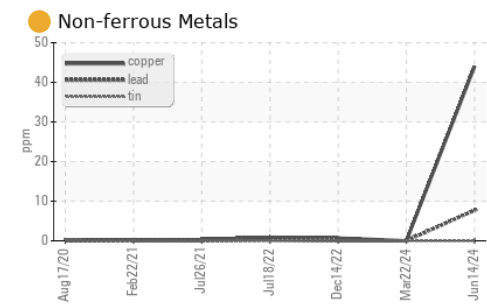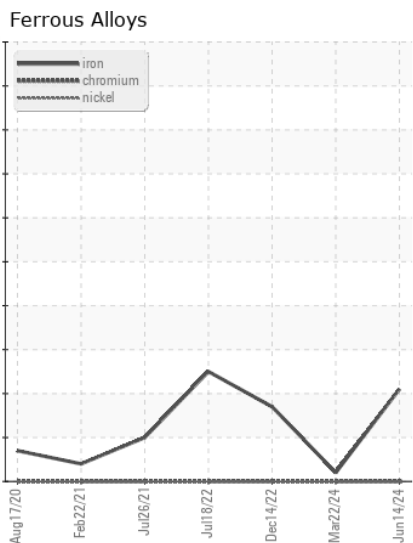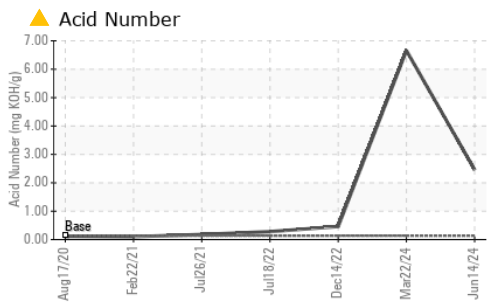

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : UCS06217017 **Received** : 21 Jun 2024
Lab Number : 06217017 **Tested** : 24 Jun 2024
Unique Number : 11089881 **Diagnosed** : 24 Jun 2024 - Don Baldrige
Test Package : IND 2

LIFT PRO EQUIPMENT CO
 SIOUX FALLS, SD
 US 57104
 Contact: REUBEN
 tim@liftproequipment.com
 T: (605)339-6494
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)