



WEAR	NORMAL
CONTAMINATION	NORMAL
FLUID CONDITION	NORMAL

Machine Id
1082
Component
Diesel Engine
Fluid
DIESEL ENGINE OIL SAE 15W40 (--- GAL)

RECOMMENDATION

Resample at the next service interval to monitor.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		A00000412	---	---
Sample Date		Client Info		28 May 2024	---	---
Machine Age	hrs	Client Info		22583	---	---
Oil Age	hrs	Client Info		399	---	---
Filter Age	hrs	Client Info		0	---	---
Oil Changed		Client Info		N/A	---	---
Filter Changed		Client Info		N/A	---	---
Sample Status				NORMAL	---	---

WEAR

All component wear rates are normal.

Iron	ppm	ASTM D5185m	>100	30	---	---
Chromium	ppm	ASTM D5185m	>20	4	---	---
Nickel	ppm	ASTM D5185m	>4	0	---	---
Titanium	ppm	ASTM D5185m		<1	---	---
Silver	ppm	ASTM D5185m	>3	0	---	---
Aluminum	ppm	ASTM D5185m	>20	1	---	---
Lead	ppm	ASTM D5185m	>40	6	---	---
Copper	ppm	ASTM D5185m	>330	2	---	---
Tin	ppm	ASTM D5185m	>15	3	---	---
Vanadium	ppm	ASTM D5185m		<1	---	---
White Metal	scalar	*Visual	NONE	NONE	---	---
Yellow Metal	scalar	*Visual	NONE	NONE	---	---

CONTAMINATION














There is no indication of any contamination in the oil.

Silicon	ppm	ASTM D5185m	>25	5	---	---
Potassium	ppm	ASTM D5185m	>20	4	---	---
Fuel	%	ASTM D3524	>5	<1.0	---	---
Water		WC Method	>0.2	NEG	---	---
Glycol		WC Method		NEG	---	---
Soot %	%	*ASTM D7844	>3	0.7	---	---
Nitration	Abs/cm	*ASTM D7624	>20	8.1	---	---
Sulfation	Abs/.1mm	*ASTM D7415	>30	20.4	---	---
Silt	scalar	*Visual	NONE	NONE	---	---
Debris	scalar	*Visual	NONE	NONE	---	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---	---
Appearance	scalar	*Visual	NORML	NORML	---	---
Odor	scalar	*Visual	NORML	NORML	---	---
Emulsified Water	scalar	*Visual	>0.2	NEG	---	---

FLUID CONDITION

The BN result indicates that there is suitable alkalinity remaining in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

Sodium	ppm	ASTM D5185m	>158	3	---	---
Boron	ppm	ASTM D5185m	250	15	---	---
Barium	ppm	ASTM D5185m	10	0	---	---
Molybdenum	ppm	ASTM D5185m	100	68	---	---
Manganese	ppm	ASTM D5185m		<1	---	---
Magnesium	ppm	ASTM D5185m	450	844	---	---
Calcium	ppm	ASTM D5185m	3000	1505	---	---
Phosphorus	ppm	ASTM D5185m	1150	1199	---	---
Zinc	ppm	ASTM D5185m	1350	1363	---	---
Sulfur	ppm	ASTM D5185m	4250	4493	---	---
Oxidation	Abs/.1mm	*ASTM D7414	>25	16.0	---	---
Acid Number (AN)	mg KOH/g	ASTM D8045		1.26	---	---
Base Number (BN)	mg KOH/g	ASTM D2896	8.5	8.7	---	---
Visc @ 40°C	cSt	ASTM D445	115	99.4	---	---
Visc @ 100°C	cSt	ASTM D445	14.4	13.65	---	---
Viscosity Index (VI)	Scale	ASTM D2270	126	137	---	---

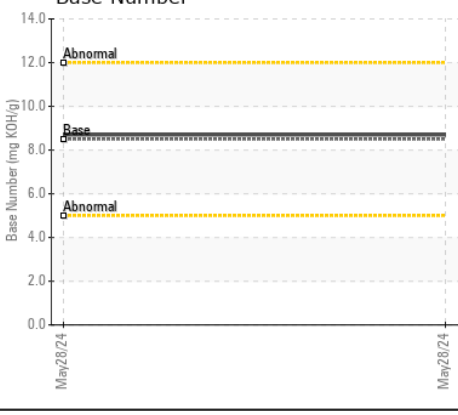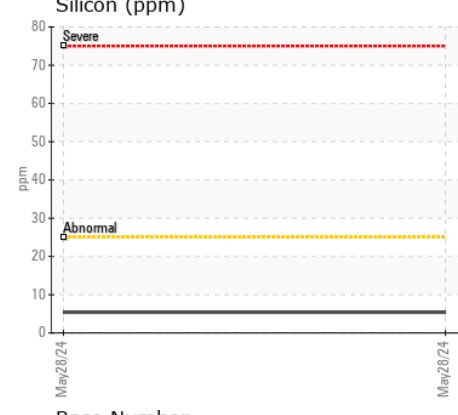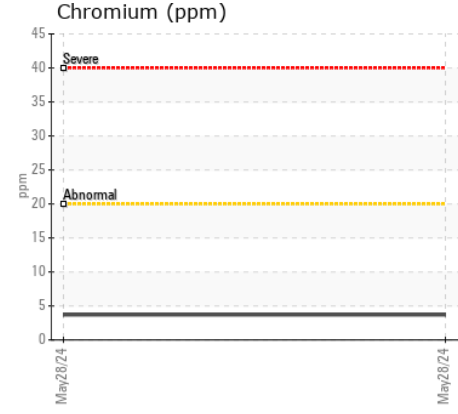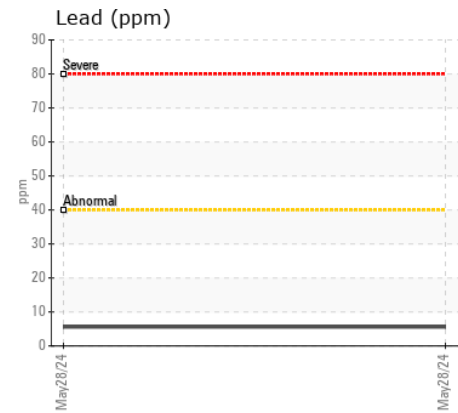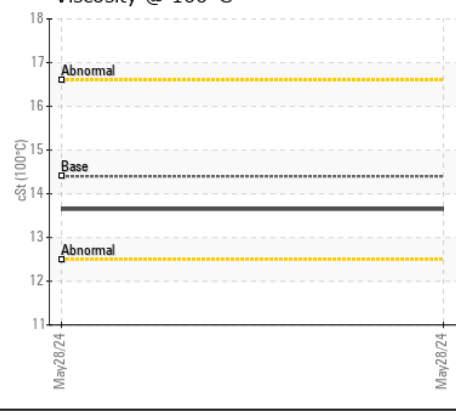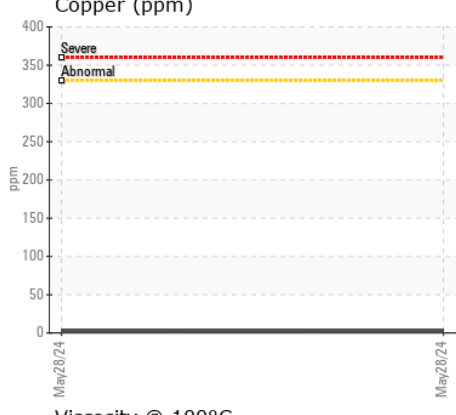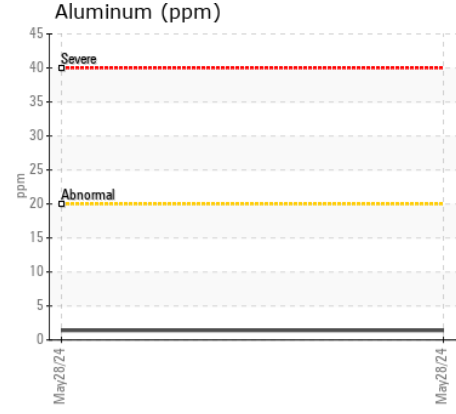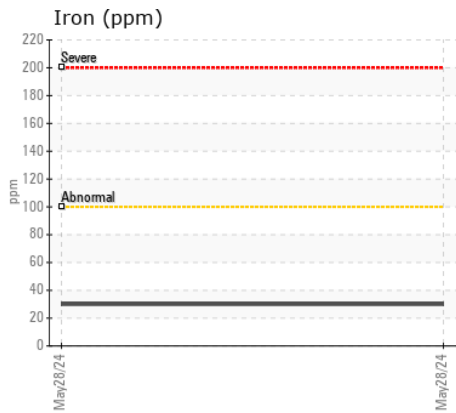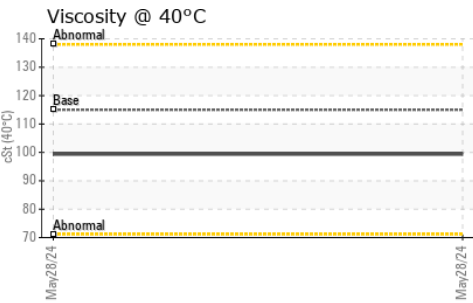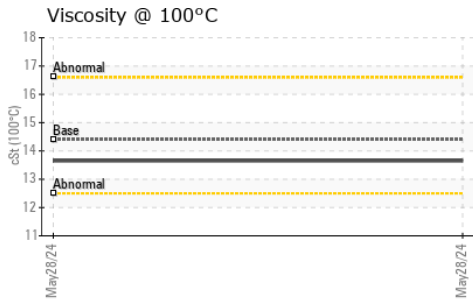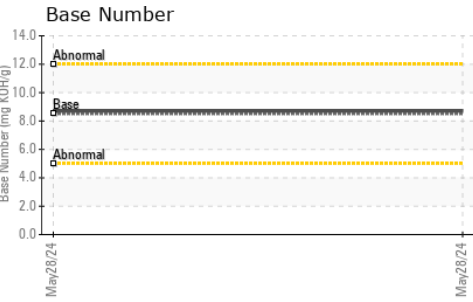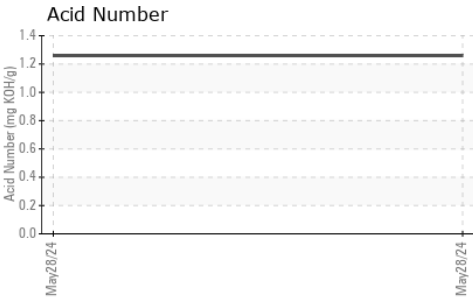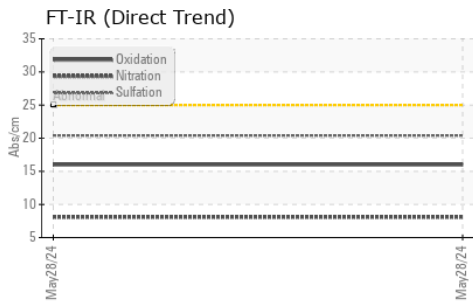

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : AO0000412
Lab Number : 06217026
Unique Number : 11089890
Test Package : MOB 2 (Additional Tests: FuelDilution, KV40, PercentFuel, VI)

Received : 21 Jun 2024
Tested : 24 Jun 2024
Diagnosed : 24 Jun 2024 - Jonathan Hester

FORTIS ENERGY
 1268 MAGNOLIA RD
 WASKOM, TX
 US 75692
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:
F: