



OIL ANALYSIS REPORT

WEAR	ABNORMAL
CONTAMINATION	NORMAL
FLUID CONDITION	NORMAL

Machine Id
16K-3B
 Component
Compressor
 Fluid
HP R&O ISO 150 (--- GAL)

RECOMMENDATION

No corrective action is recommended at this time. Resample at the next service interval to monitor.

WEAR

The iron level is abnormal. Bearing and/or bushing wear is indicated.

CONTAMINATION

There is no indication of any contamination in the oil.

FLUID CONDITION

The AN level is acceptable for this fluid. The condition of the oil is acceptable for the time in service.


Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		HPL0004823	HPL0005078	HPL0004529
Sample Date		Client Info		18 Jun 2024	15 Apr 2024	13 Mar 2024
Machine Age	hrs	Client Info		0	0	0
Oil Age	hrs	Client Info		0	0	0
Filter Age	hrs	Client Info		0	0	0
Oil Changed		Client Info		N/A	N/A	N/A
Filter Changed		Client Info		N/A	N/A	N/A
Sample Status				ABNORMAL	ABNORMAL	ABNORMAL

Iron	ppm	ASTM D5185m	>50	▲ 116	▲ 84	▲ 71
Chromium	ppm	ASTM D5185m	>10	<1	<1	0
Nickel	ppm	ASTM D5185m		<1	0	0
Titanium	ppm	ASTM D5185m		<1	0	0
Silver	ppm	ASTM D5185m		<1	0	0
Aluminum	ppm	ASTM D5185m	>25	3	0	1
Lead	ppm	ASTM D5185m	>25	2	2	2
Copper	ppm	ASTM D5185m	>50	▲ 65	36	29
Tin	ppm	ASTM D5185m	>15	▲ 21	19	19
Vanadium	ppm	ASTM D5185m		<1	0	0
White Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE


Silicon	ppm	ASTM D5185m	>25	3	1	2
Potassium	ppm	ASTM D5185m	>20	2	<1	1
Water		WC Method	>0.1	NEG	NEG	NEG
Silt	scalar	*Visual	NONE	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG	NEG

Sodium	ppm	ASTM D5185m		0	1	<1
Boron	ppm	ASTM D5185m		0	0	0
Barium	ppm	ASTM D5185m		<1	1	0
Molybdenum	ppm	ASTM D5185m		<1	0	0
Manganese	ppm	ASTM D5185m		<1	1	<1
Magnesium	ppm	ASTM D5185m		<1	1	<1
Calcium	ppm	ASTM D5185m		0	4	1
Phosphorus	ppm	ASTM D5185m		257	194	187
Zinc	ppm	ASTM D5185m		39	24	16
Sulfur	ppm	ASTM D5185m		20663	17393	17710
Acid Number (AN)	mg KOH/g	ASTM D8045		0.54	0.55	0.64
Visc @ 40°C	cSt	ASTM D445		101	101	101


▲ Non-ferrous Metals

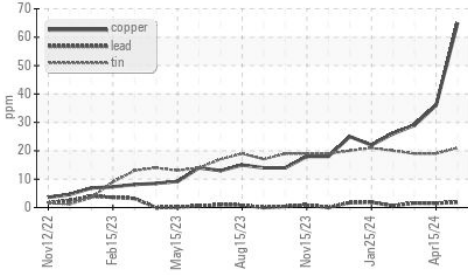


▲ Ferrous Alloys

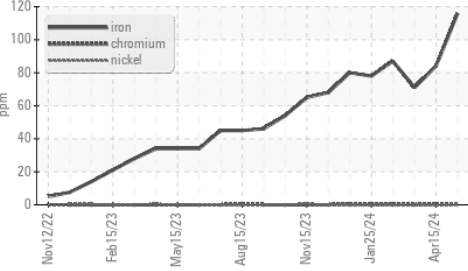


Acid Number

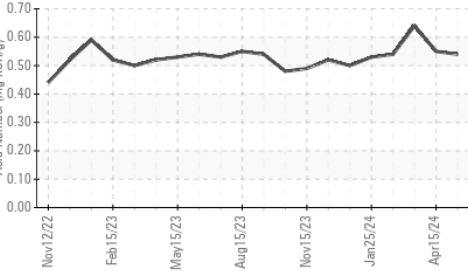


Viscosity @ 40°C

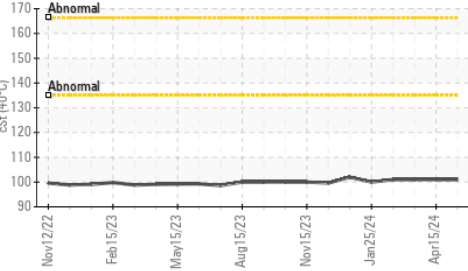


▲ Iron (ppm)

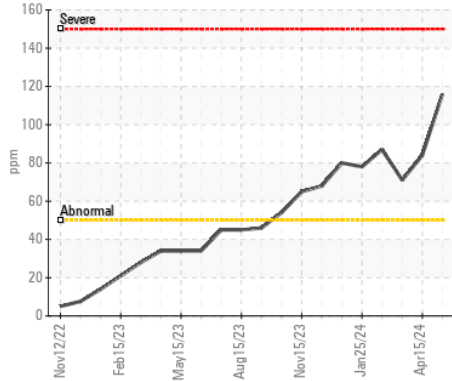


Aluminum (ppm)

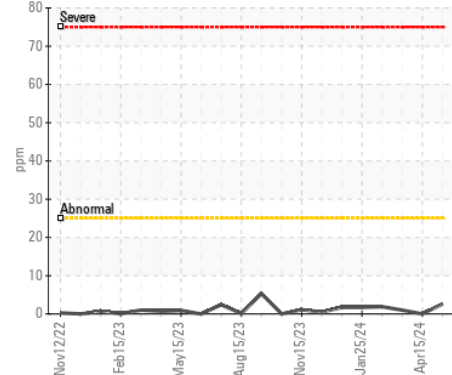


▲ Copper (ppm)

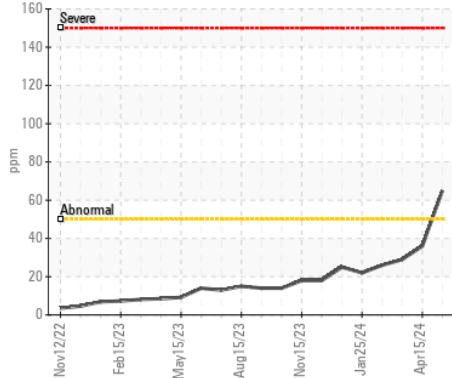


Viscosity @ 40°C

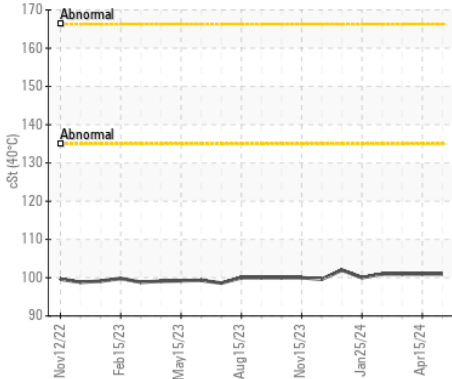


Lead (ppm)

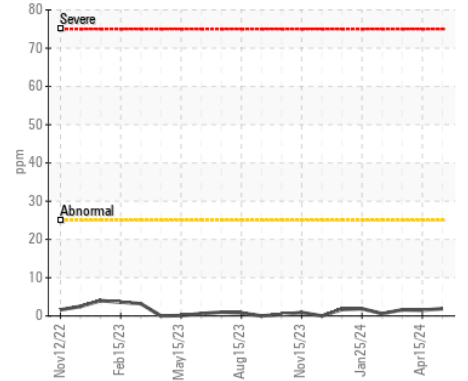


Chromium (ppm)

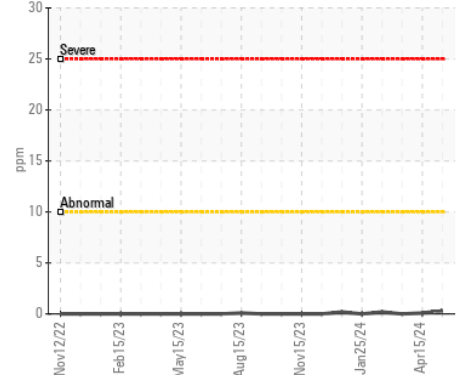

Silicon (ppm)

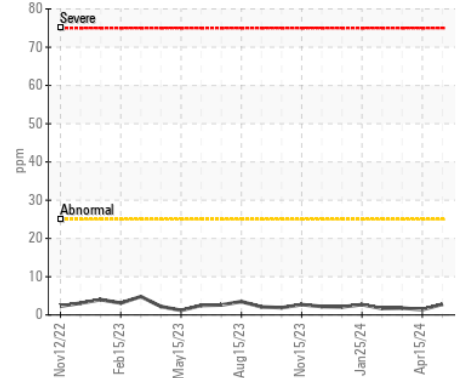

Acid Number

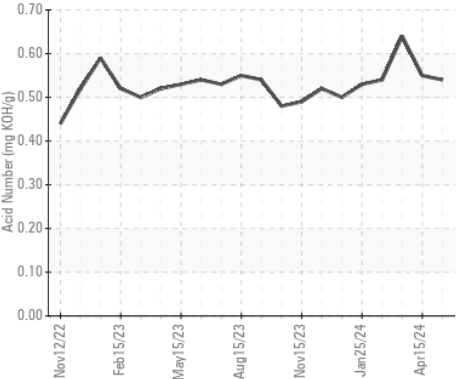

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513

Sample No. : HPL0004823

Lab Number : 06218846

Unique Number : 11097043

Test Package : MOB 2

Received : 24 Jun 2024

Tested : 25 Jun 2024

Diagnosed : 26 Jun 2024 - Don Baldrige

MARATHON PETROLEUM CO.

IL. REFINING DIVISION, 400 S MARATHON AVE

ROBINSON, IL

US 62454

Contact: M.S. MANHART

mmanhart@marathonpetroleum.com

T: (618)544-2121

F: x:

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)