James River Equipment

OIL ANALYSIS REPORT

WEAR	ABNORMAL
CONTAMINATION	NORMAL
FLUID CONDITION	NORMAL

Machine Id
NOT GIVEN JR0220018 (S/N NO INFO ON SIF/BOTTLE)
Component
Diesel Engine
Fluid
{not provided} (--- GAL)

RECOMMENDATION

No corrective action is recommended at this time. Resample at the next service interval to monitor. Please specify the brand, type, and viscosity of the oil on your next sample.

WEAR

The nickel level is abnormal. All other component wear rates are normal.

CONTAMINATION

Fuel content negligible. There is no indication of any contamination in the oil.

FLUID CONDITION

The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		JR0220018	---	---
Sample Date		Client Info		24 Jun 2024	---	---
Machine Age	hrs	Client Info		0	---	---
Oil Age	hrs	Client Info		0	---	---
Filter Age	hrs	Client Info		0	---	---
Oil Changed		Client Info		N/A	---	---
Filter Changed		Client Info		N/A	---	---
Sample Status				ABNORMAL	---	---
Iron	ppm	ASTM D5185m	>100	37	---	---
Chromium	ppm	ASTM D5185m	>20	1	---	---
Nickel	ppm	ASTM D5185m	>4	▲ 12	---	---
Titanium	ppm	ASTM D5185m		<1	---	---
Silver	ppm	ASTM D5185m	>3	<1	---	---
Aluminum	ppm	ASTM D5185m	>20	5	---	---
Lead	ppm	ASTM D5185m	>40	2	---	---
Copper	ppm	ASTM D5185m	>330	276	---	---
Tin	ppm	ASTM D5185m	>15	3	---	---
Vanadium	ppm	ASTM D5185m		<1	---	---
White Metal	scalar	*Visual	NONE	NONE	---	---
Yellow Metal	scalar	*Visual	NONE	NONE	---	---
Silicon	ppm	ASTM D5185m	>25	13	---	---
Potassium	ppm	ASTM D5185m	>20	6	---	---
Fuel	%	ASTM D3524	>5	0.2	---	---
Water		WC Method	>0.2	NEG	---	---
Glycol		WC Method		NEG	---	---
Soot %	%	*ASTM D7844	>3	0.5	---	---
Nitration	Abs/cm	*ASTM D7624	>20	9.3	---	---
Sulfation	Abs/.1mm	*ASTM D7415	>30	23.7	---	---
Silt	scalar	*Visual	NONE	NONE	---	---
Debris	scalar	*Visual	NONE	NONE	---	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---	---
Appearance	scalar	*Visual	NORML	NORML	---	---
Odor	scalar	*Visual	NORML	NORML	---	---
Emulsified Water	scalar	*Visual	>0.2	NEG	---	---
Sodium	ppm	ASTM D5185m		4	---	---
Boron	ppm	ASTM D5185m		202	---	---
Barium	ppm	ASTM D5185m		4	---	---
Molybdenum	ppm	ASTM D5185m		261	---	---
Manganese	ppm	ASTM D5185m		6	---	---
Magnesium	ppm	ASTM D5185m		811	---	---
Calcium	ppm	ASTM D5185m		1395	---	---
Phosphorus	ppm	ASTM D5185m		846	---	---
Zinc	ppm	ASTM D5185m		1082	---	---
Sulfur	ppm	ASTM D5185m		2895	---	---
Oxidation	Abs/.1mm	*ASTM D7414	>25	16.6	---	---
Base Number (BN)	mg KOH/g	ASTM D2896		8.3	---	---
Visc @ 100°C	cSt	ASTM D445		10.7	---	---

Ferrous Alloys

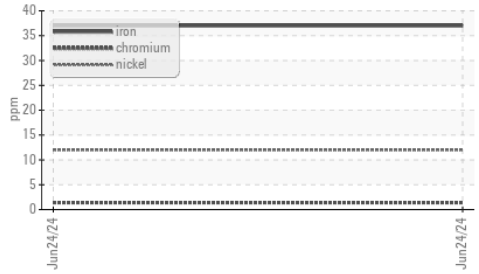

Fuel Dilution

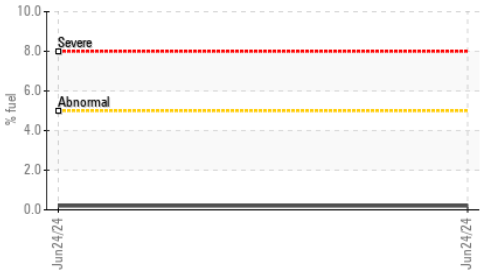

FT-IR (Direct Trend)

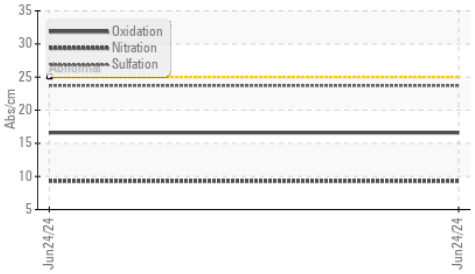

Base Number

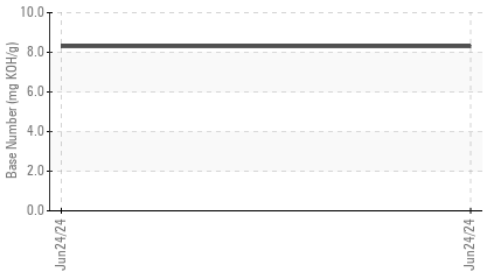

Viscosity @ 100°C

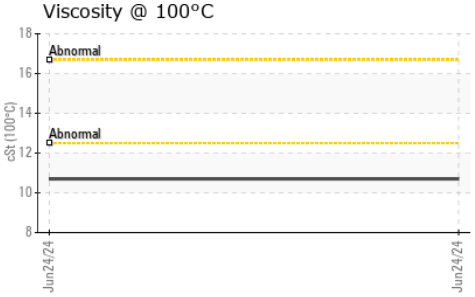

Ferrous Alloys

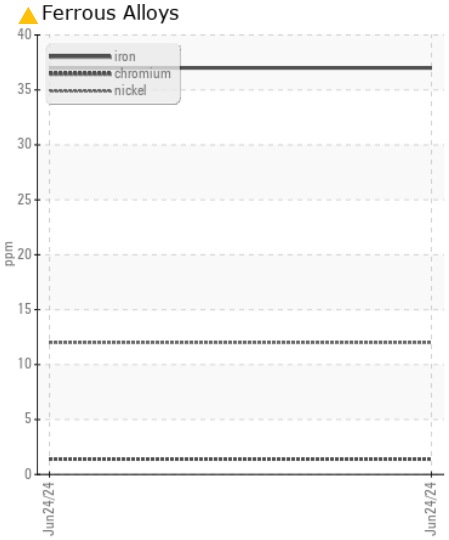

Non-ferrous Metals

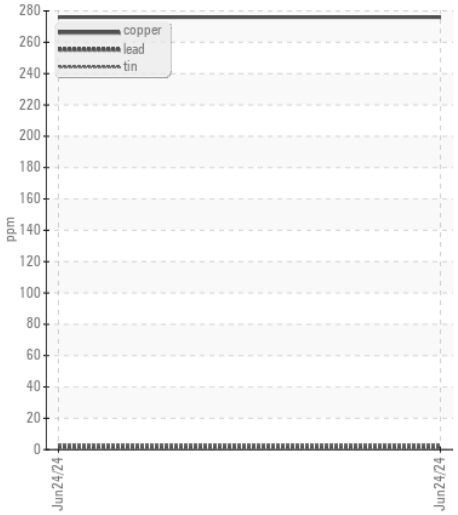

Viscosity @ 100°C

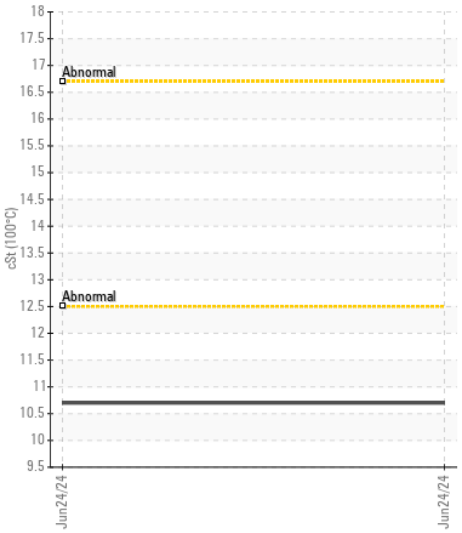

Base Number

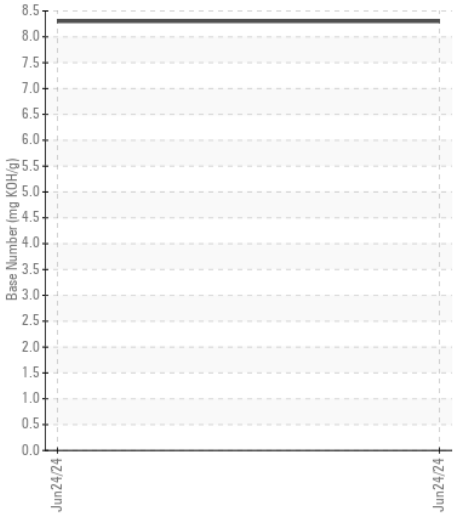

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : JR0220018
Lab Number : 06219497
Unique Number : 11097694
Test Package : CONST (Additional Tests: FuelDilution, PercentFuel, TBN)
Received : 25 Jun 2024
Tested : 28 Jun 2024
Diagnosed : 28 Jun 2024 - Jonathan Hester

To discuss this sample report, contact Customer Service at 1-800-237-1369.
** - Denotes test methods that are outside of the ISO 17025 scope of accreditation.*
Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

JRE - CHARLOTTE
9550 STATESVILLE ROAD
CHARLOTTE, NC
US 28269
Contact: CHARLOTTE SHOP
myoung@jamesriverequipment.com
T: (704)597-0211
F: (704)596-6198