



OIL ANALYSIS REPORT

WEAR	NORMAL
CONTAMINATION	NORMAL
FLUID CONDITION	NORMAL

Machine Id
20840
 Component
Compressor
 Fluid
INGERSOLL-RAND TURBOBLEND 46 (--- GAL)

RECOMMENDATION

Resample at the next service interval to monitor.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		CCSI2013313	CCSI2014534	---
Sample Date		Client Info		08 May 2024	24 Jul 2023	---
Machine Age	hrs	Client Info		24039	18955	---
Oil Age	hrs	Client Info		0	18955	---
Filter Age	hrs	Client Info		0	0	---
Oil Changed		Client Info		Not Changd	Not Changd	---
Filter Changed		Client Info		N/A	N/A	---
Sample Status				NORMAL	NORMAL	---

WEAR

All component wear rates are normal.

Iron	ppm	ASTM D5185m	>50	0	0	---
Chromium	ppm	ASTM D5185m	>10	0	0	---
Nickel	ppm	ASTM D5185m		0	0	---
Titanium	ppm	ASTM D5185m		0	0	---
Silver	ppm	ASTM D5185m		0	0	---
Aluminum	ppm	ASTM D5185m	>25	0	0	---
Lead	ppm	ASTM D5185m	>25	0	0	---
Copper	ppm	ASTM D5185m	>50	0	0	---
Tin	ppm	ASTM D5185m	>15	0	0	---
Vanadium	ppm	ASTM D5185m		0	0	---
White Metal	scalar	*Visual	NONE	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	---

CONTAMINATION










There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

Silicon	ppm	ASTM D5185m	>25	2	2	---
Potassium	ppm	ASTM D5185m	>20	0	<1	---
Water	%	ASTM D6304	>0.1	NEG	NEG	---
Particles >4µm		ASTM D7647	>10000	344	352	---
Particles >6µm		ASTM D7647	>2500	97	108	---
Particles >14µm		ASTM D7647	>320	9	13	---
Particles >21µm		ASTM D7647	>80	2	5	---
Particles >38µm		ASTM D7647	>20	0	1	---
Particles >71µm		ASTM D7647	>4	0	0	---
Oil Cleanliness		ISO 4406 (c)	>20/18/15	16/14/10	16/14/11	---
Silt	scalar	*Visual	NONE	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	NONE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG	---

FLUID CONDITION

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

Sodium	ppm	ASTM D5185m		1	0	---
Boron	ppm	ASTM D5185m		0	0	---
Barium	ppm	ASTM D5185m		0	0	---
Molybdenum	ppm	ASTM D5185m		0	0	---
Manganese	ppm	ASTM D5185m		0	0	---
Magnesium	ppm	ASTM D5185m		0	0	---
Calcium	ppm	ASTM D5185m		0	0	---
Phosphorus	ppm	ASTM D5185m		7	10	---
Zinc	ppm	ASTM D5185m		0	0	---
Sulfur	ppm	ASTM D5185m		51	7	---
Acid Number (AN)	mg KOH/g	ASTM D8045		0.13	0.08	---
Visc @ 40°C	cSt	ASTM D445	46	50.2	44.6	---

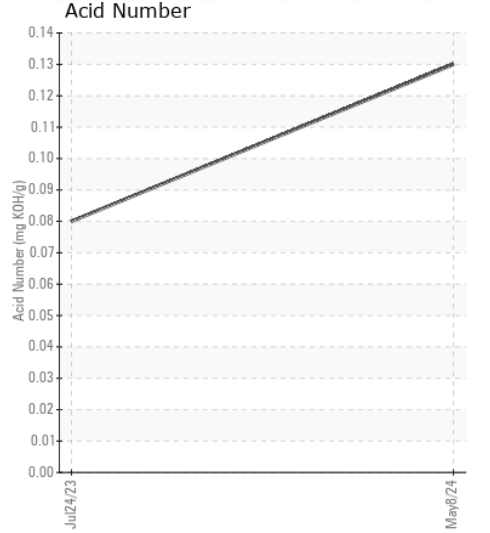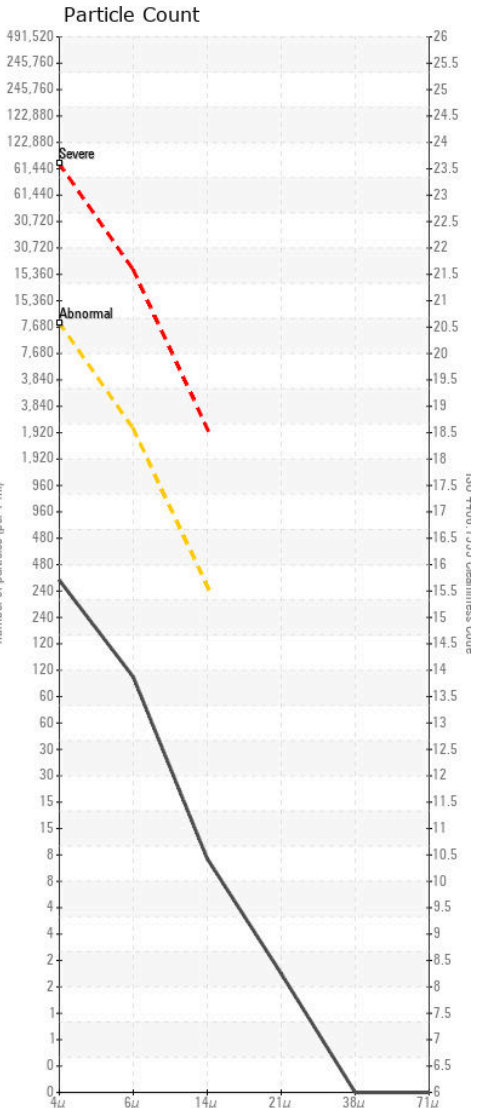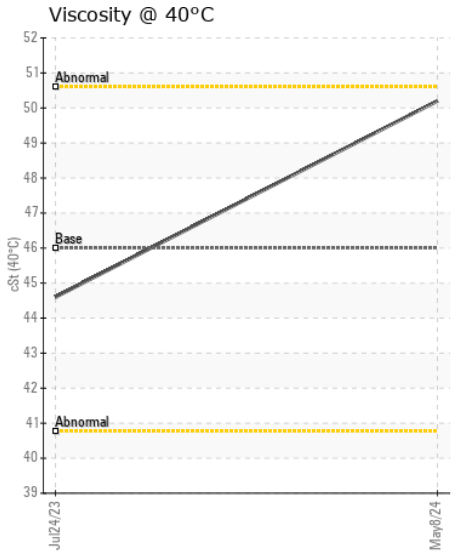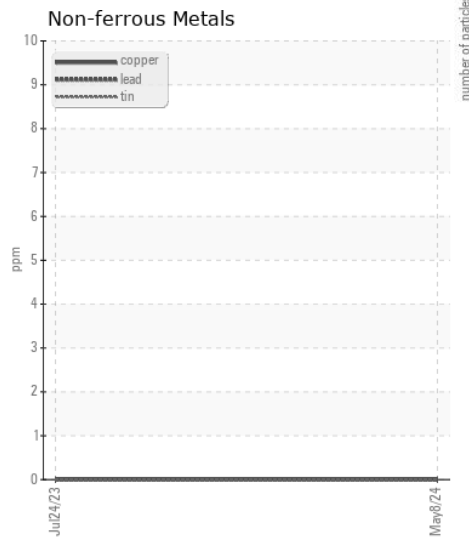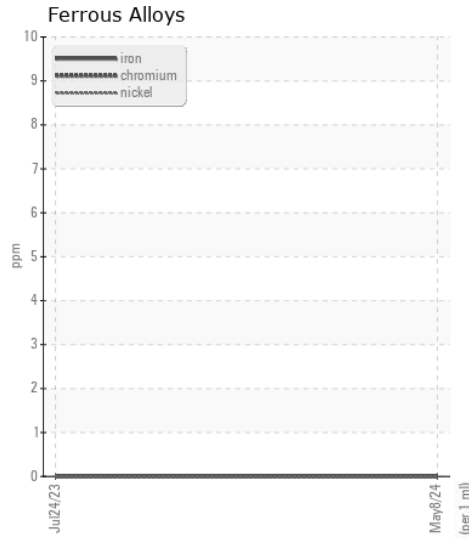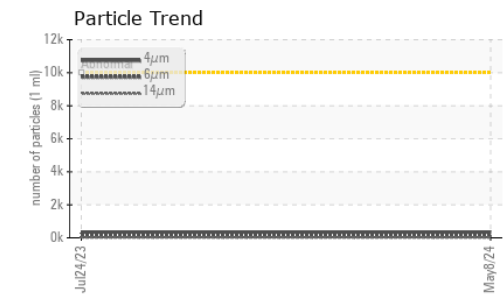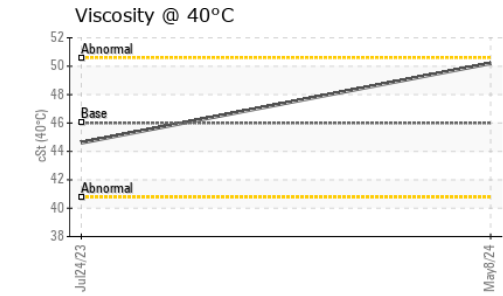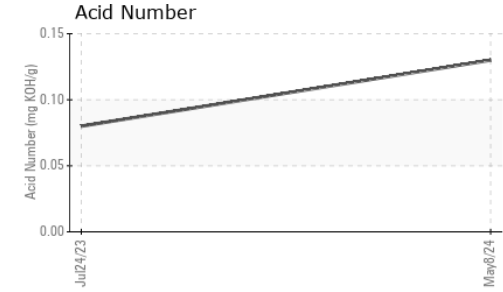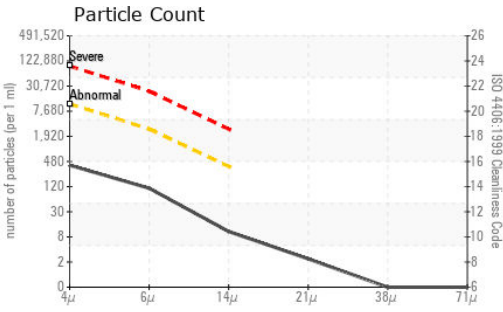

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : CCSI2013313 **Received** : 25 Jun 2024
Lab Number : 06219654 **Tested** : 26 Jun 2024
Unique Number : 11097851 **Diagnosed** : 26 Jun 2024 - Don Baldrige
Test Package : IND 2 (Additional Tests: KF, PrtCount)

JTEKT - MORRISTOWN TN
 5932 COMMERCE BLVD
 MORRISTOWN, TN
 US 37814
 Contact: STEVE BROWN
 steve.brown@jtekt.com
 T: (423)312-2553
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)