



# FUEL REPORT

CORROSION	<b>NORMAL</b>
CONTAMINANTS	<b>NORMAL</b>
FUEL CONDITION	<b>NORMAL</b>

Area  
**[PMOAS3507464]**  
 Machine Id  
**GENERAC SD0015 EBENEZER RD (S/N 3000701630)**  
 Component  
**Diesel Fuel**  
 Fluid  
**No.2 DIESEL FUEL (ULTRALOW SULPHUR) (--- GAL)**

## RECOMMENDATION

All laboratory tests indicate that this sample meets specifications for No.2 ultra-low-sulfur diesel fuel.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		<b>DC0036937</b>	---	---
Sample Date		Client Info		<b>30 May 2024</b>	---	---
Machine Age	hrs	Client Info		<b>224</b>	---	---
Sample Status				<b>NORMAL</b>	---	---

## CORROSION

All metal levels are normal indicating no corrosion in the system.

Aluminum	ppm	ASTM D5185m	<0.1	<b>0</b>	---	---
Nickel	ppm	ASTM D5185m	<0.1	<b>0</b>	---	---
Lead	ppm	ASTM D5185m	<0.1	<b>0</b>	---	---
Vanadium	ppm	ASTM D5185m	<0.1	<b>&lt;1</b>	---	---
Iron	ppm	ASTM D5185m	<0.1	<b>0</b>	---	---

## CONTAMINANTS






The water content is negligible. There is no bacteria or fungus (yeast and/or mold) indicated in the sample. There is no indication of any contamination in the fuel. The amount and size of particulates present in the system are acceptable.

Silicon	ppm	ASTM D5185m	<1.0	<b>&lt;1</b>	---	---
Sodium	ppm	ASTM D5185m	<0.1	<b>1</b>	---	---
Potassium	ppm	ASTM D5185m	<0.1	<b>&lt;1</b>	---	---
Water	%	ASTM D6304	<0.05	<b>0.003</b>	---	---
ppm Water	ppm	ASTM D6304	<500	<b>35</b>	---	---
Particles >4µm		ASTM D7647	>2500	<b>524</b>	---	---
Particles >6µm		ASTM D7647	>640	<b>163</b>	---	---
Particles >14µm		ASTM D7647	>80	<b>11</b>	---	---
Particles >21µm		ASTM D7647	>20	<b>3</b>	---	---
Particles >38µm		ASTM D7647	>4	<b>0</b>	---	---
Particles >71µm		ASTM D7647	>3	<b>0</b>	---	---
Oil Cleanliness		ISO 4406 (c)	>18/16/13	<b>16/15/11</b>	---	---
% Gasoline	%	*In-House	<0.50	<b>0.0</b>	---	---
% Biodiesel	%	*In-House	<20.0	<b>0.0</b>	---	---
Calcium	ppm	ASTM D5185m	<0.1	<b>0</b>	---	---
Magnesium	ppm	ASTM D5185m	<0.1	<b>0</b>	---	---
Phosphorus	ppm	ASTM D5185m	<0.1	<b>1</b>	---	---
Zinc	ppm	ASTM D5185m	<0.1	<b>0</b>	---	---

## FUEL CONDITION

Sulfur value derived by ASTM D5453 method for ULSD validation. Sulfur level is acceptable for ULSD specification.

ASTM Color	scalar	*ASTM D1500		<b>L2.0</b>	---	---
Visc @ 40°C	cSt	ASTM D445	3.0	<b>2.46</b>	---	---
Sulfur	ppm	ASTM D5185m	10	<b>0</b>	---	---
Sulfur (UVF)	ppm	ASTM D5453		<b>8</b>	---	---
API Gravity		ASTM D7777	37.7	<b>36.6</b>	---	---

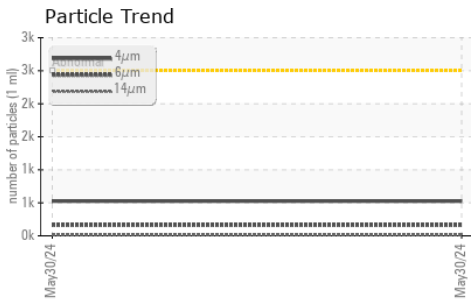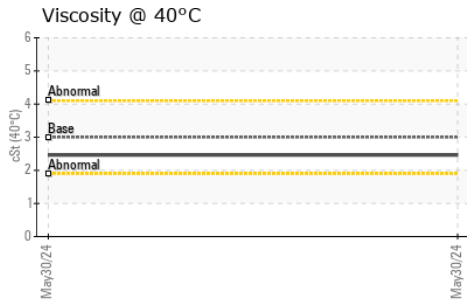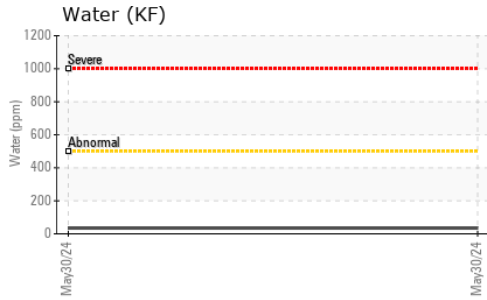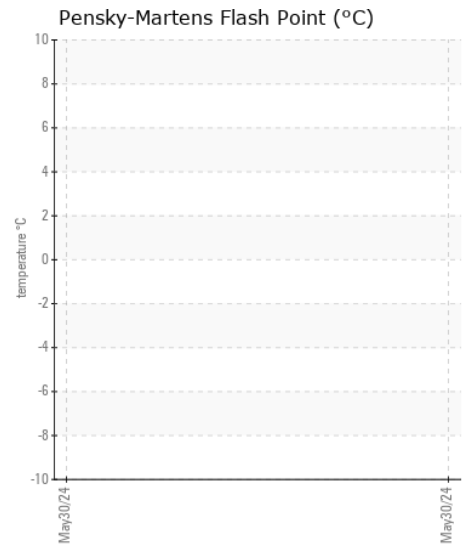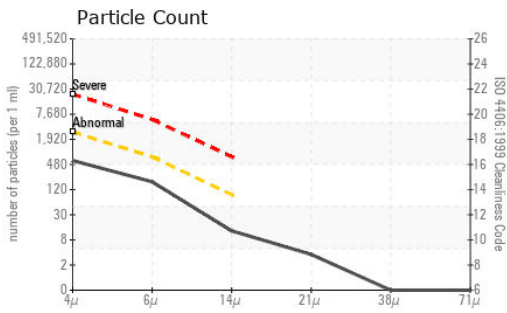

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : DC0036937  
**Lab Number** : 06220266  
**Unique Number** : 11098463  
**Test Package** : DF-5 ( Additional Tests: API, Cetane, Fuel, PrtCount, Screen )

**KELLY GENERATOR & EQUIPMENT INC**  
 1955 DALE LN  
 OWINGS, MD  
 US 20736  
 Contact: LESLIE SNURR  
 LSNURR@KGE.COM  
 T: (410)257-5225  
 F: (410)257-5227

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)