



COOLANT REPORT

|                   |        |
|-------------------|--------|
| CORROSION         | NORMAL |
| CONTAMINANTS      | NORMAL |
| COOLANT CONDITION | NORMAL |

Area  
**[PMOAS3507464]**  
 Machine Id  
**GENERAC SD0015 EBENEZER RD (S/N 3000701630)**

Component  
**Coolant**  
 Fluid  
**{not provided} (--- GAL)**

**RECOMMENDATION**

The fluid is suitable for further service.

| Test          | UOM | Method      | Limit/Abn | Current     | History1 | History2 |
|---------------|-----|-------------|-----------|-------------|----------|----------|
| Sample Number |     | Client Info |           | DC0035272   | ---      | ---      |
| Sample Date   |     | Client Info |           | 30 May 2024 | ---      | ---      |
| Machine Age   | hrs | Client Info |           | 224         | ---      | ---      |
| Oil Age       | hrs | Client Info |           | 0           | ---      | ---      |
| Oil Changed   |     | Client Info |           | Not Changd  | ---      | ---      |
| Sample Status |     |             |           | NORMAL      | ---      | ---      |








**CORROSION**

|                        |  |         |       |        |     |     |
|------------------------|--|---------|-------|--------|-----|-----|
| Total Dissolved Solids |  |         |       | 488.5  | --- | --- |
| Coolant Appearance     |  | *Visual | Clear | normal | --- | --- |

**CONTAMINANTS**

There is no indication of any contamination in the coolant.

|                    |            |             |  |       |     |     |
|--------------------|------------|-------------|--|-------|-----|-----|
| Boiling Point      | °C         | WC Method   |  | 225   | --- | --- |
| Specific Gravity   |            | *ASTM D1298 |  | 1.066 | --- | --- |
| pH                 | Scale 0-14 | ASTM D1287  |  | 8.06  | --- | --- |
| Nitrites           | ppm        | AP-053:2009 |  | 560   | --- | --- |
| Reserve Alkalinity | Scale 0-20 | *ASTM D1121 |  | ---   | --- | --- |
| Percentage Glycol  | %          | ASTM D3321  |  | 49.0  | --- | --- |
| Freezing Point     | °F         | ASTM D3321  |  | -33   | --- | --- |
| Carboxylate        |            |             |  | n/a   | --- | --- |
| Coolant Color      |            | *Visual     |  | Yllow | --- | --- |

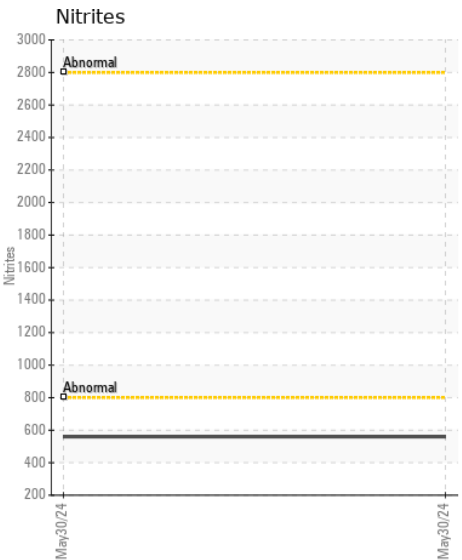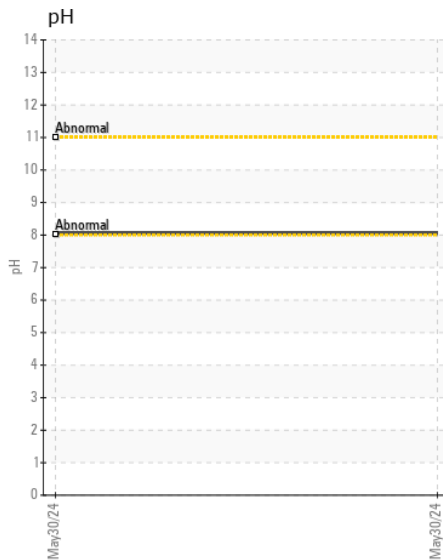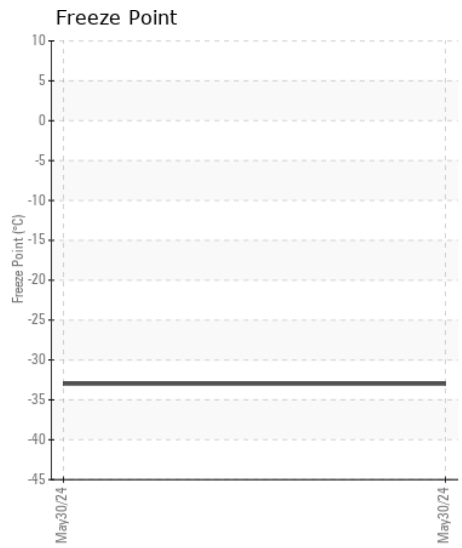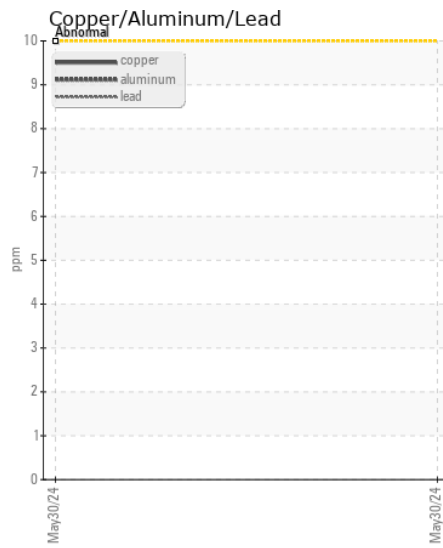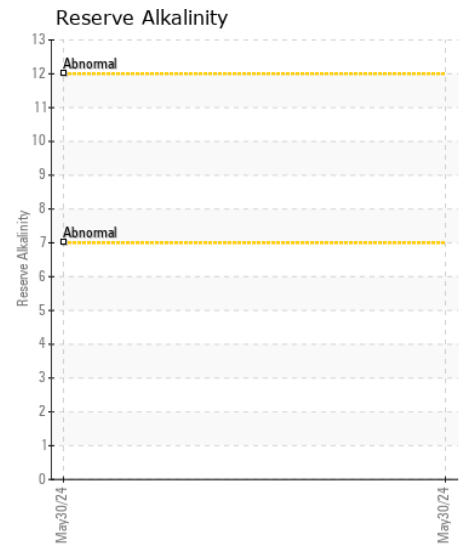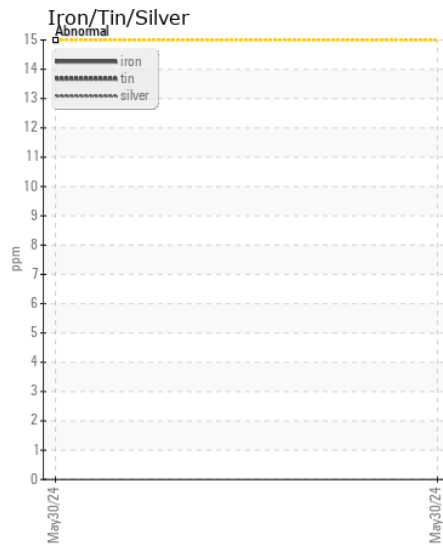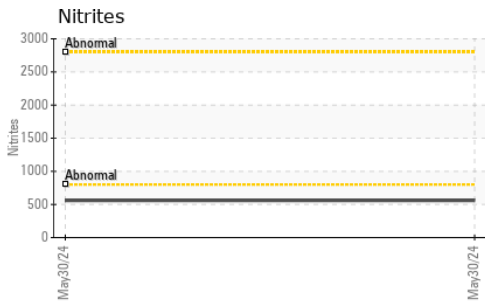

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : DC0035272  
**Lab Number** : 06220319  
**Unique Number** : 11098516  
**Test Package** : COOL- ( Additional Tests: GlycolType )

**KELLY GENERATOR & EQUIPMENT INC**  
 1955 DALE LN  
 OWINGS, MD  
 US 20736  
 Contact: LESLIE SNURR  
 LSNURR@KGE.COM  
 T: (410)257-5225  
 F: (410)257-5227

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)