



COOLANT REPORT

CORROSION	NORMAL
CONTAMINANTS	NORMAL
COOLANT CONDITION	NORMAL

Area
[PMIAS2968260]
 Machine Id
VP-125662 D16 037723 C3A 10693120500
 Component
Coolant
 Fluid
{not provided} (--- GAL)

RECOMMENDATION

The fluid is suitable for further service.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		DC0035410	---	---
Sample Date		Client Info		30 May 2024	---	---
Machine Age	hrs	Client Info		636	---	---
Oil Age	hrs	Client Info		0	---	---
Oil Changed		Client Info		Not Changd	---	---
Sample Status				NORMAL	---	---








CORROSION

Total Dissolved Solids				1144	---	---
Coolant Appearance		*Visual	Clear	normal	---	---

CONTAMINANTS

There is no indication of any contamination in the coolant.

Boiling Point	°C	WC Method		228	---	---
Specific Gravity		*ASTM D1298		1.076	---	---
pH	Scale 0-14	ASTM D1287		8.23	---	---
Nitrites	ppm	AP-053:2009		936	---	---
Reserve Alkalinity	Scale 0-20	*ASTM D1121		---	---	---
Percentage Glycol	%	ASTM D3321		56.4	---	---
Freezing Point	°F	ASTM D3321		-50	---	---
Carboxylate				n/a	---	---
Coolant Color		*Visual		Yllow	---	---

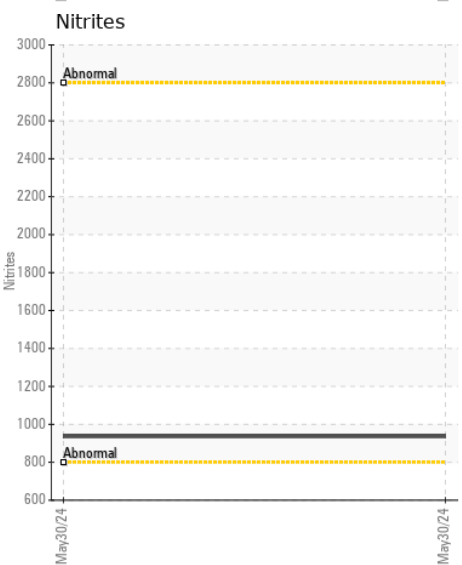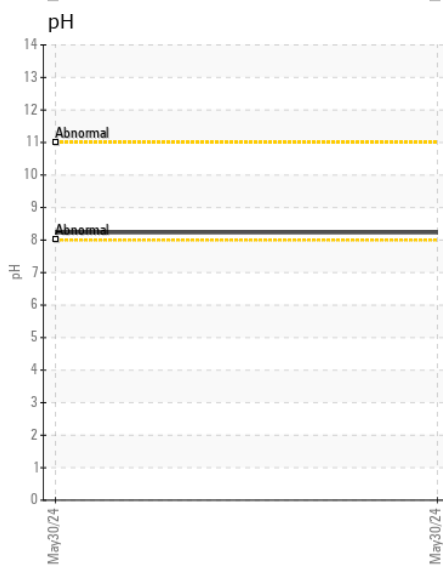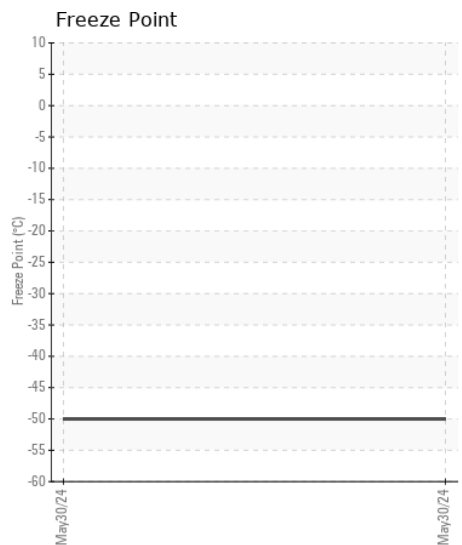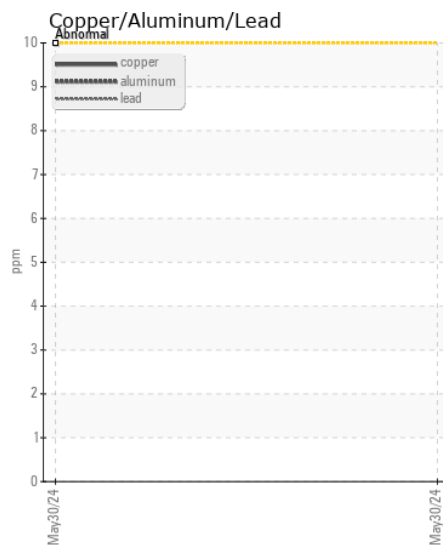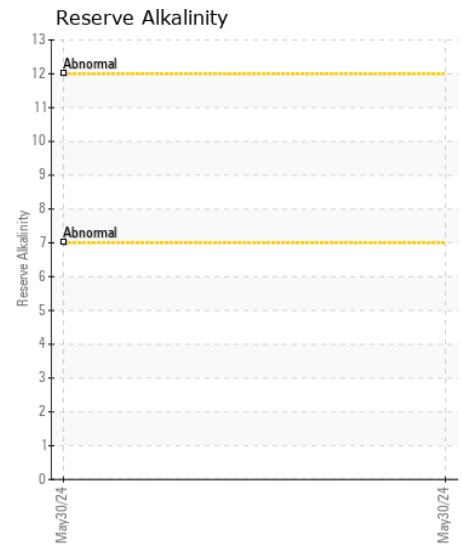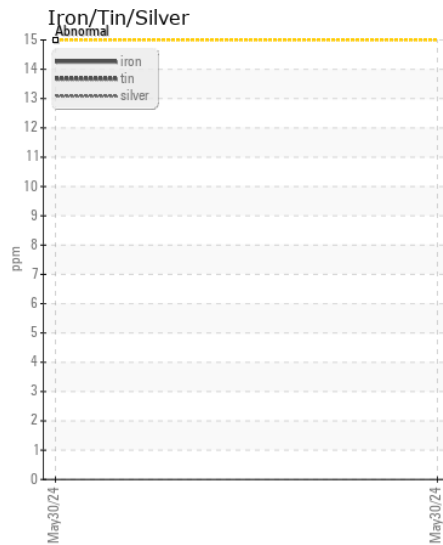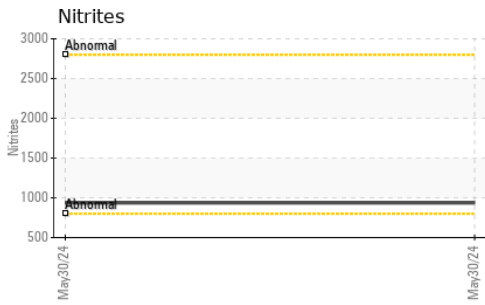

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513

Sample No. : DC0035410

Lab Number : 06220326

Unique Number : 11098523

Test Package : COOL- (Additional Tests: GlycolType)

Received : 25 Jun 2024

Tested : 27 Jun 2024

Diagnosed : 27 Jun 2024 - Jonathan Hester

KELLY GENERATOR & EQUIPMENT INC

1955 DALE LN

OWINGS, MD

US 20736

Contact: LESLIE SNURR

LSNURR@KGE.COM

T: (410)257-5225

F: (410)257-5227

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)