



COOLANT REPORT

CORROSION

NORMAL

CONTAMINANTS

NORMAL

COOLANT CONDITION

NORMAL

Area

[PMOAS3429610]

Machine Id

KOHLER GENERATOR D150FPJ4T2 115593-0905 - PFVRS-C04

Component

Coolant

Fluid

FLEET CHARGE (--- GAL)

RECOMMENDATION

The fluid is suitable for further service.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		DC0035432	DC0031916	DC0026730
Sample Date		Client Info		13 Jun 2024	05 Dec 2023	17 May 2023
Machine Age	hrs	Client Info		274	272	272
Oil Age	hrs	Client Info		0	0	0
Oil Changed		Client Info		Not Chngd	Not Chngd	Changed
Sample Status				NORMAL	NORMAL	NORMAL








CORROSION

Total Dissolved Solids				188.5	194.0	239.0
Coolant Appearance		*Visual	Clear	normal	normal	normal

CONTAMINANTS

There is no indication of any contamination in the coolant.

Boiling Point	°C	WC Method		227	---	---
Specific Gravity		*ASTM D1298		1.073	1.067	1.067
pH	Scale 0-14	ASTM D1287		8.77	8.75	9.34
Nitrites	ppm	AP-053:2009		1500	1240	1164
Reserve Alkalinity	Scale 0-20	*ASTM D1121		---	---	---
Percentage Glycol	%	ASTM D3321		54.5	49.2	49.7
Freezing Point	°F	ASTM D3321		-45	-33	-33
Carboxylate				n/a	n/a	n/a
Coolant Color		*Visual		Pink	Pink	Pink

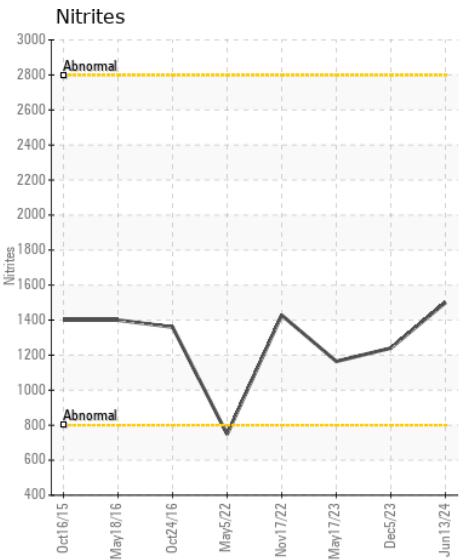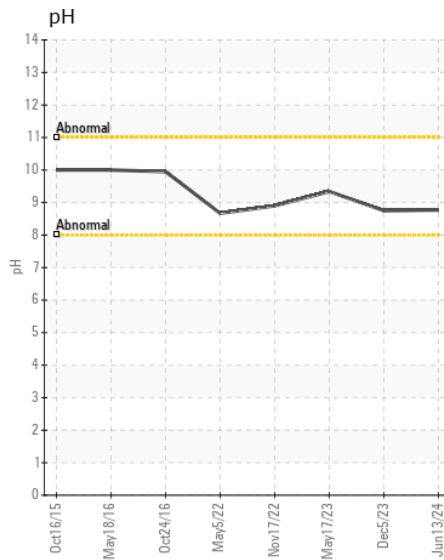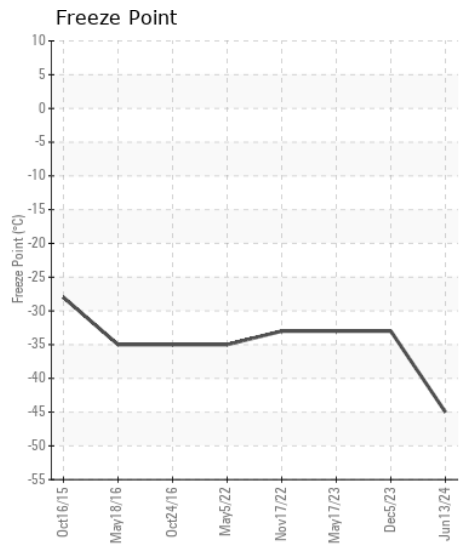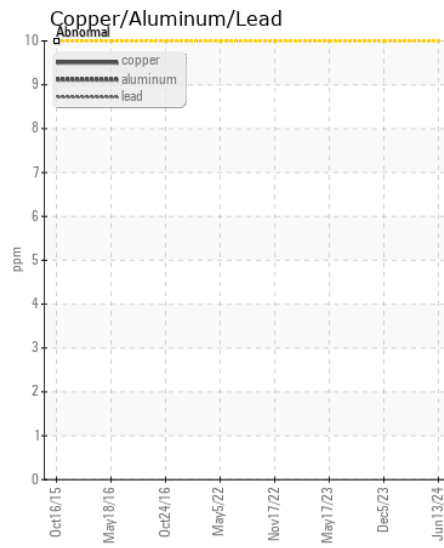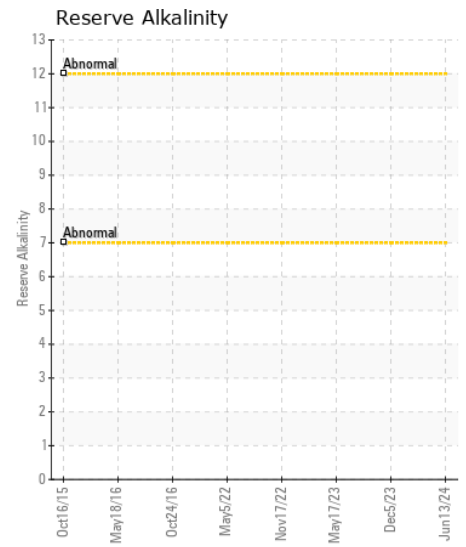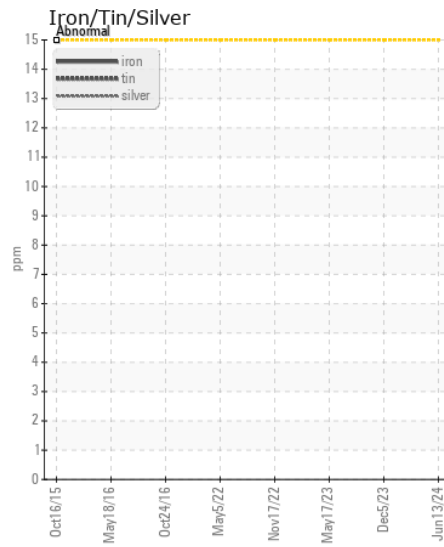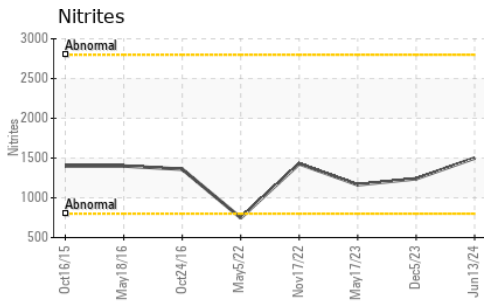

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : DC0035432
Lab Number : 06220328
Unique Number : 11098525
Test Package : COOL- (Additional Tests: GlycolType)

KELLY GENERATOR & EQUIPMENT INC
 1955 DALE LN
 OWINGS, MD
 US 20736
 Contact: LESLIE SNURR
 LSNURR@KGE.COM
 T: (410)257-5225
 F: (410)257-5227

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)