WEAR CONTAMINATION FLUID CONDITION


NORMAL NORMAL

PALEXTRA 44

SULLIVAN PALATEK 23KE004603 - US BRICK

Component Compressor

					.,		
RECOMMENDATION	Test	UOM	Method	Limit/Abn	Current	History1	History2
Resample at the next service interval to monitor.	Sample Number		Client Info		UCS06220408		
resumpto at the next convice interval to monitor.	Sample Date		Client Info		14 Jun 2024		
	Machine Age	hrs	Client Info		6290		
	Oil Age	hrs	Client Info		6290		
	Filter Age	hrs	Client Info		1		
	Oil Changed		Client Info		Not Changd		
	Filter Changed		Client Info		Changed		
	Sample Status				NORMAL		
WEAR	Iron	nnm	ASTM D5185m	<u> 50</u>	0		
All component wear rates are normal.	Chromium	ppm	ASTM D5185m		0		
	Nickel	ppm	ASTM D5185m	>10			
	Titanium	ppm	ASTM D5185m		0		
	Silver	ppm	ASTM D5185m		0		
	Aluminum	ppm	ASTM D5185m	► 2F	0		
	Lead	ppm	ASTM D5185m		0		
	Copper	ppm	ASTM D5185m		<1		
	Tin	ppm	ASTM D5185m		0		
	Vanadium	ppm	ASTM D5185m	>10	<1		
	White Metal	ppm scalar	*Visual	NONE	NONE		
	Yellow Metal	scalar	*Visual	NONE	NONE		
<u></u>		Scalai	visuai	INOINL	NONE		
CONTAMINATION	Silicon	ppm	ASTM D5185m	>25	13		
There is no indication of any contamination in the oil.	Potassium	ppm	ASTM D5185m	>20	<1		
	Water		WC Method	>0.1	NEG		
	Silt	scalar	*Visual	NONE	NONE		
	Debris	scalar	*Visual	NONE	NONE		
	Sand/Dirt	scalar	*Visual	NONE	NONE		
	Appearance	scalar	*Visual	NORML	NORML		
	Odor	scalar	*Visual	NORML	NORML		
	Emulsified Water	scalar	*Visual	>0.1	NEG		
FLUID CONDITION	Sodium	ppm	ASTM D5185m		1		
	Boron	ppm	ASTM D5185m	0	0		
The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.	Barium	ppm	ASTM D5185m	0.3	0		
	Molybdenum	ppm	ASTM D5185m	0	0		
	Manganese	ppm	ASTM D5185m	0.3	0		
	Magnesium	ppm	ASTM D5185m	0.4	0		
	Calcium	ppm	ASTM D5185m	0	0		
	Phosphorus	ppm	ASTM D5185m	689	586		
	Zinc	ppm	ASTM D5185m		0		
	Sulfur	ppm	ASTM D5185m	1237	1002		
	Acid Number (AN)	mg KOH/g	ASTM D8045	0.135	0.09		
	Visc @ 40°C	cSt	ASTM D445	44.62	43.3		
Report Id: LICAIRGRESC [WILSCAR] 06220408 (Generated: 06/26/2024 15:02:21) Rev: 1				Conto	t/Location: S	COTT HO	AIDCDECC

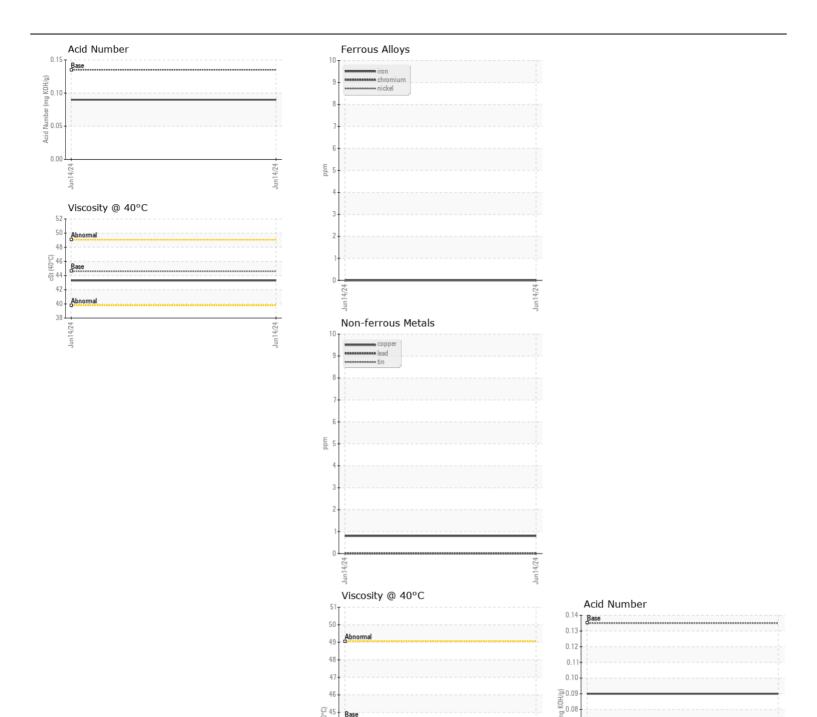





Certificate L2367

Laboratory

Sample No.

: UCS06220408 Lab Number : 06220408 Unique Number : 11098605 Test Package : IND 2

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 Received **Tested**

Diagnosed

AIR COMPRESSOR SERVICES

GREENVILLE, SC US 29609

Contact: SCOTT

To discuss this sample report, contact Customer Service at 1-800-237-1369. scott@aircompressorservices.com T: (877)592-9892

: 26 Jun 2024 - Wes Davis

: 25 Jun 2024

: 26 Jun 2024

0.07

ii n ne

0.03 0.02

0.00

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

±5 44

43 42

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

F: