



# OIL ANALYSIS REPORT

WEAR	NORMAL
CONTAMINATION	NORMAL
FLUID CONDITION	ATTENTION

Machine Id  
**KOHLER KOHLER 250KW**  
Component  
**Diesel Engine**  
Fluid  
**CHEVRON 15W40 (10 GAL)**

## RECOMMENDATION

Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

## WEAR

All component wear rates are normal.













## CONTAMINATION

Fuel content negligible. There is no indication of any contamination in the oil.

## FLUID CONDITION

The oil viscosity is lower than normal. The BN result indicates that there is suitable alkalinity remaining in the oil. Confirm oil type.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		<b>WC0827470</b>	WCM1396176	WCM1370118
Sample Date		Client Info		<b>25 Jun 2024</b>	31 Jan 2019	04 Jan 2017
Machine Age	hrs	Client Info		<b>1182</b>	794	733
Oil Age	hrs	Client Info		<b>0</b>	26	47
Filter Age	hrs	Client Info		<b>0</b>	26	0
Oil Changed		Client Info		<b>Changed</b>	Changed	Changed
Filter Changed		Client Info		<b>Changed</b>	Changed	Changed
Sample Status				<b>ATTENTION</b>	ABNORMAL	NORMAL
Iron	ppm	ASTM D5185m	>100	<b>6</b>	3	3
Chromium	ppm	ASTM D5185m	>20	<b>0</b>	<1	<1
Nickel	ppm	ASTM D5185m	>4	<b>0</b>	0	<1
Titanium	ppm	ASTM D5185m		<b>&lt;1</b>	0	0
Silver	ppm	ASTM D5185m	>3	<b>0</b>	0	<1
Aluminum	ppm	ASTM D5185m	>20	<b>3</b>	2	1
Lead	ppm	ASTM D5185m	>40	<b>&lt;1</b>	<1	1
Copper	ppm	ASTM D5185m	>330	<b>4</b>	2	2
Tin	ppm	ASTM D5185m	>15	<b>&lt;1</b>	<1	0
Vanadium	ppm	ASTM D5185m		<b>0</b>	0	0
White Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Silicon	ppm	ASTM D5185m	>25	<b>5</b>	▲ 77	3
Potassium	ppm	ASTM D5185m	>20	<b>3</b>	4	3
Fuel	%	ASTM D3524	>5	<b>1.1</b>	<1.0	<1.0
Water		WC Method	>0.2	<b>NEG</b>	NEG	NEG
Glycol		WC Method		<b>NEG</b>	NEG	NEG
Soot %	%	*ASTM D7844	>3	<b>0.1</b>	0.1	0
Nitration	Abs/cm	*ASTM D7624	>20	<b>5.5</b>	4.8	5.
Sulfation	Abs/.1mm	*ASTM D7415	>30	<b>19.1</b>	19.8	18.
Silt	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Debris	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Appearance	scalar	*Visual	NORML	<b>NORML</b>	NORML	NORML
Odor	scalar	*Visual	NORML	<b>NORML</b>	NORML	NORML
Emulsified Water	scalar	*Visual	>0.2	<b>NEG</b>	NEG	NEG
Sodium	ppm	ASTM D5185m	>50	<b>2</b>	2	2
Boron	ppm	ASTM D5185m		<b>356</b>	295	328
Barium	ppm	ASTM D5185m		<b>0</b>	0	<1
Molybdenum	ppm	ASTM D5185m		<b>94</b>	90	82
Manganese	ppm	ASTM D5185m		<b>&lt;1</b>	<1	2
Magnesium	ppm	ASTM D5185m		<b>462</b>	430	406
Calcium	ppm	ASTM D5185m		<b>1413</b>	1243	1571
Phosphorus	ppm	ASTM D5185m		<b>967</b>	635	975
Zinc	ppm	ASTM D5185m		<b>1161</b>	695	1092
Sulfur	ppm	ASTM D5185m		<b>3674</b>	2762	1912
Oxidation	Abs/.1mm	*ASTM D7414	>25	<b>12.9</b>	13.7	13.
Base Number (BN)	mg KOH/g	ASTM D2896		<b>7.4</b>	---	---
Visc @ 100°C	cSt	ASTM D445	14.4	● <b>12.0</b>	14.2	13.47

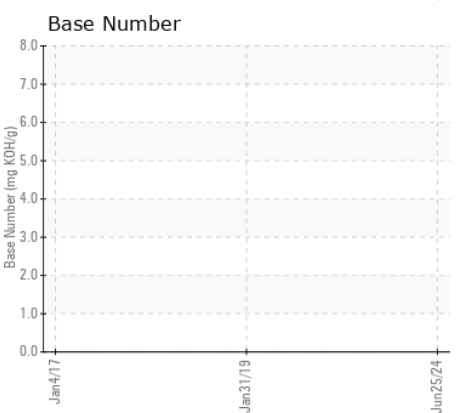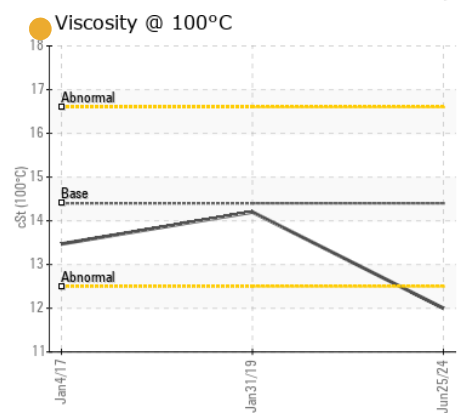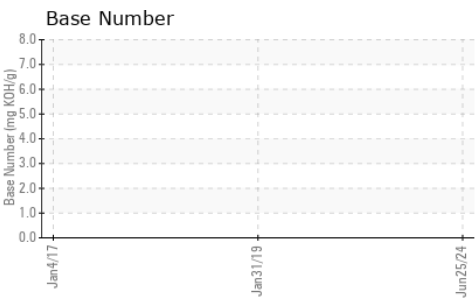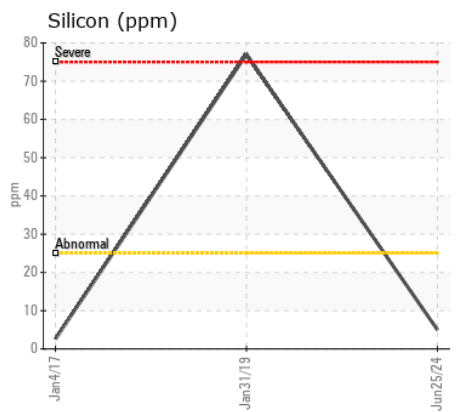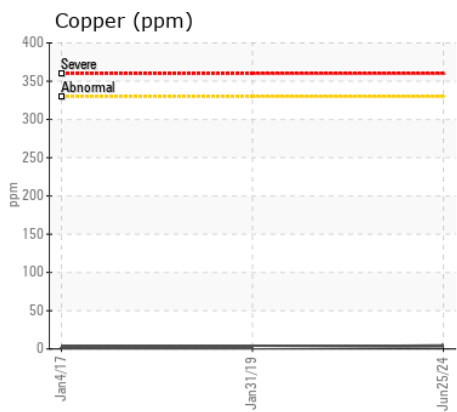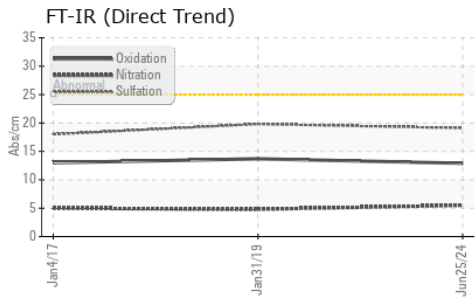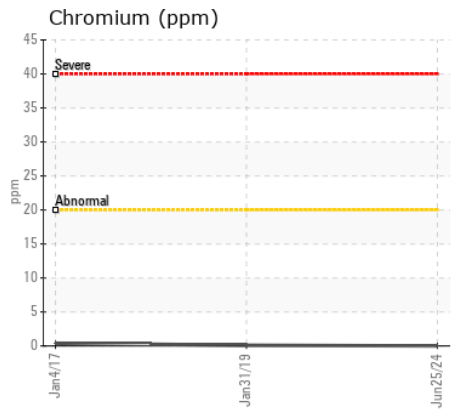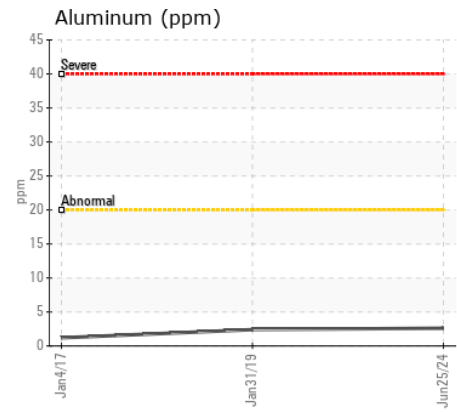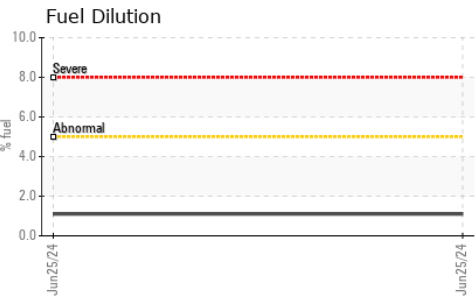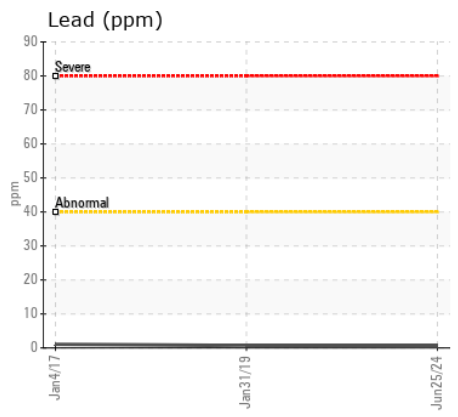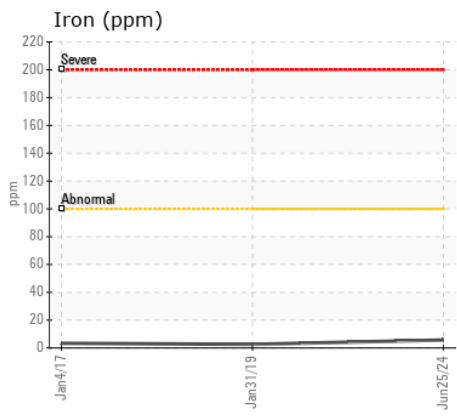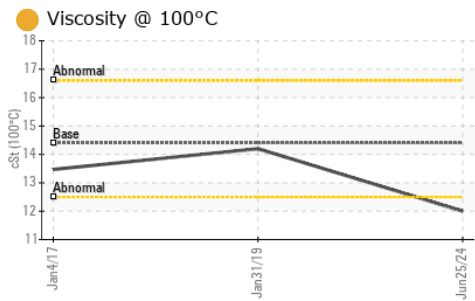

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : WC0827470 **Received** : 25 Jun 2024  
**Lab Number** : 06220582 **Tested** : 28 Jun 2024  
**Unique Number** : 11098779 **Diagnosed** : 28 Jun 2024 - Jonathan Hester  
**Test Package** : MOB 1 ( Additional Tests: FuelDilution, PercentFuel, TBN )

**BROOKE GLEN**  
 7170 LAFAYETTE AVE  
 FT WASHINGTON, PA  
 US 19034  
 Contact: BILL THOMAS

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:  
F: