



OIL ANALYSIS REPORT

WEAR	NORMAL
CONTAMINATION	ABNORMAL
FLUID CONDITION	NORMAL

Machine Id
1688-8123063
 Component
Compressor
 Fluid
KAESER SIGMA (OEM) M-460 (--- GAL)

RECOMMENDATION

We recommend you service the filters on this component. Resample at the next service interval to monitor. We were unable to perform a particle count due to a high concentration of particles present in this sample.

WEAR

All component wear rates are normal.








CONTAMINATION

Moderate concentration of visible dirt/debris present in the oil.

FLUID CONDITION

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		Y2K0001563	---	---
Sample Date		Client Info		20 Jun 2024	---	---
Machine Age	hrs	Client Info		8280	---	---
Oil Age	hrs	Client Info		800	---	---
Filter Age	hrs	Client Info		800	---	---
Oil Changed		Client Info		Not Changd	---	---
Filter Changed		Client Info		Not Changd	---	---
Sample Status				ABNORMAL	---	---
Iron	ppm	ASTM D5185m	>50	0	---	---
Chromium	ppm	ASTM D5185m	>10	0	---	---
Nickel	ppm	ASTM D5185m	>3	0	---	---
Titanium	ppm	ASTM D5185m	>3	0	---	---
Silver	ppm	ASTM D5185m	>2	0	---	---
Aluminum	ppm	ASTM D5185m	>10	0	---	---
Lead	ppm	ASTM D5185m	>10	0	---	---
Copper	ppm	ASTM D5185m	>50	5	---	---
Tin	ppm	ASTM D5185m	>10	0	---	---
Vanadium	ppm	ASTM D5185m		0	---	---
White Metal	scalar	*Visual	NONE	NONE	---	---
Yellow Metal	scalar	*Visual	NONE	NONE	---	---
Silicon	ppm	ASTM D5185m	>25	1	---	---
Potassium	ppm	ASTM D5185m	>20	2	---	---
Water	%	ASTM D6304	>0.05	0.348	---	---
ppm Water	ppm	ASTM D6304	>500	3480	---	---
Silt	scalar	*Visual	NONE	NONE	---	---
Debris	scalar	*Visual	NONE	▲ MODER	---	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---	---
Appearance	scalar	*Visual	NORML	NORML	---	---
Odor	scalar	*Visual	NORML	NORML	---	---
Emulsified Water	scalar	*Visual	>0.05	0.2%	---	---
Sodium	ppm	ASTM D5185m		9	---	---
Boron	ppm	ASTM D5185m	0	<1	---	---
Barium	ppm	ASTM D5185m	90	25	---	---
Molybdenum	ppm	ASTM D5185m	0	0	---	---
Manganese	ppm	ASTM D5185m		<1	---	---
Magnesium	ppm	ASTM D5185m	100	46	---	---
Calcium	ppm	ASTM D5185m	0	0	---	---
Phosphorus	ppm	ASTM D5185m	0	10	---	---
Zinc	ppm	ASTM D5185m	0	4	---	---
Sulfur	ppm	ASTM D5185m	23500	22096	---	---
Acid Number (AN)	mg KOH/g	ASTM D8045	1.0	0.40	---	---
Visc @ 40°C	cSt	ASTM D445	45	47.6	---	---

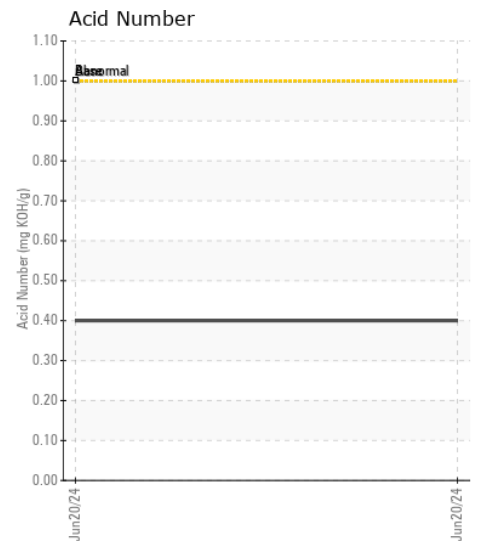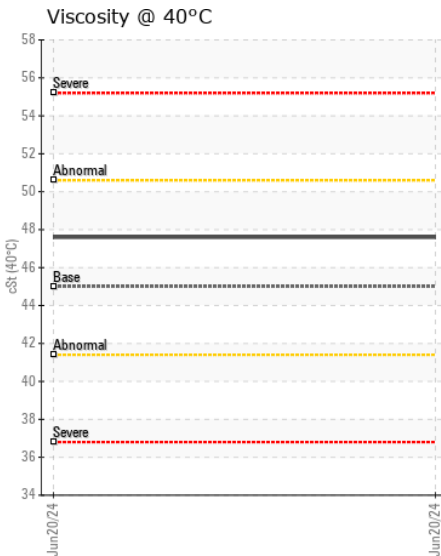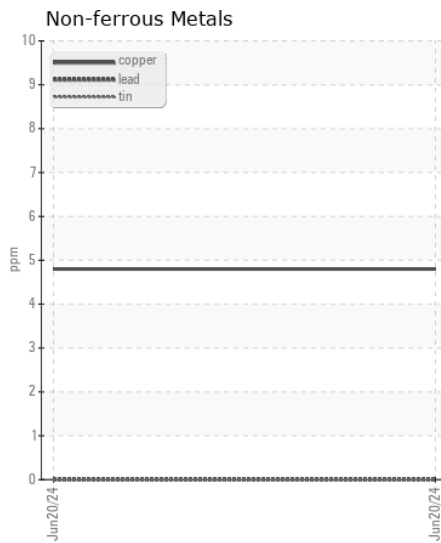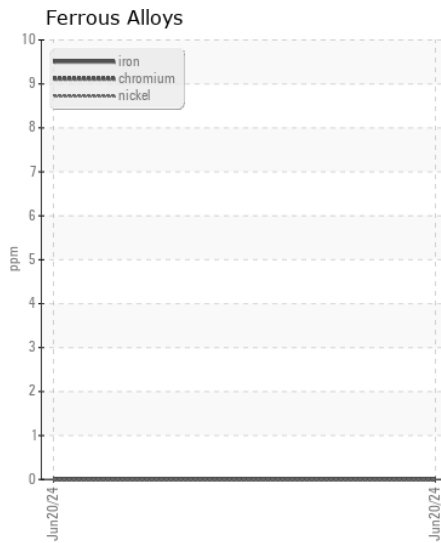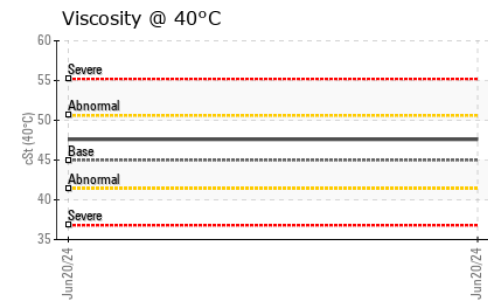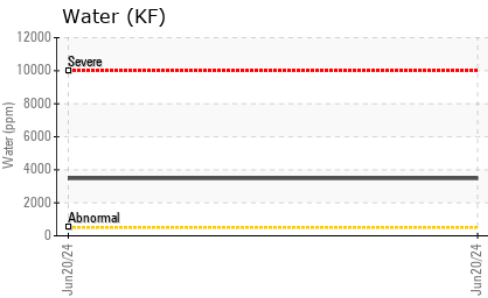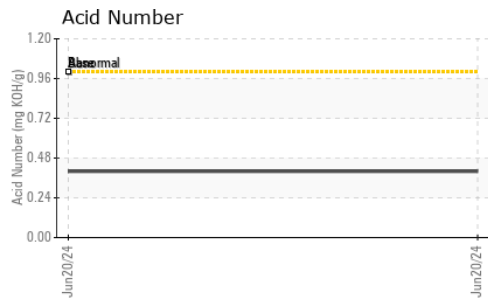

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : Y2K0001563 **Received** : 26 Jun 2024
Lab Number : 06221194 **Tested** : 28 Jun 2024
Unique Number : 11099391 **Diagnosed** : 28 Jun 2024 - Jonathan Hester
Test Package : MOB 2 (Additional Tests: KF, PrtCount)

NEW ANGUS
 39229 133RD ST
 ABERDEEN, SD
 US 57401
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:
F: