



WEAR	<b>NORMAL</b>
CONTAMINATION	<b>NORMAL</b>
FLUID CONDITION	<b>NORMAL</b>

Area  
**ANS 460 [3510]**  
Machine Id  
**KAESER 1420 - KAESER 2 - ALTEC**  
Component  
**Compressor**

### RECOMMENDATION

Resample at the next service interval to monitor.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		<b>UCS06221327</b>	UCS06103138	UCH05914737
Sample Date		Client Info		<b>10 Jun 2024</b>	25 Jan 2024	25 Jul 2023
Machine Age	hrs	Client Info		<b>17019</b>	15352	13087
Oil Age	hrs	Client Info		<b>4908</b>	3241	976
Filter Age	hrs	Client Info		<b>1727</b>	2265	976
Oil Changed		Client Info		<b>Not Changed</b>	Not Changed	Not Changed
Filter Changed		Client Info		<b>Changed</b>	Changed	Changed
Sample Status				<b>NORMAL</b>	NORMAL	NORMAL

### WEAR

All component wear rates are normal.

Iron	ppm	ASTM D5185m	>50	<b>0</b>	0	<1
Chromium	ppm	ASTM D5185m	>10	<b>&lt;1</b>	0	0
Nickel	ppm	ASTM D5185m	>3	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m	>3	<b>0</b>	0	0
Silver	ppm	ASTM D5185m	>2	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m	>10	<b>2</b>	0	<1
Lead	ppm	ASTM D5185m	>10	<b>0</b>	0	0
Copper	ppm	ASTM D5185m	>50	<b>11</b>	9	10
Tin	ppm	ASTM D5185m	>10	<b>0</b>	0	0
Vanadium	ppm	ASTM D5185m		<b>0</b>	<1	0
White Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE	MODER
Yellow Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE

### CONTAMINATION







There is no indication of any contamination in the oil.

Silicon	ppm	ASTM D5185m	>25	<b>0</b>	0	<1
Potassium	ppm	ASTM D5185m	>20	<b>3</b>	3	6
Water		WC Method	>0.05	<b>NEG</b>	NEG	NEG
Silt	scalar	*Visual	NONE	<b>NONE</b>	NONE	LIGHT
Debris	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Appearance	scalar	*Visual	NORML	<b>NORML</b>	NORML	NORML
Odor	scalar	*Visual	NORML	<b>NORML</b>	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	<b>NEG</b>	NEG	NEG

### FLUID CONDITION

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

Sodium	ppm	ASTM D5185m		<b>6</b>	14	18
Boron	ppm	ASTM D5185m		<b>0</b>	0	0
Barium	ppm	ASTM D5185m	90	<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m		<b>0</b>	0	0
Manganese	ppm	ASTM D5185m		<b>&lt;1</b>	<1	<1
Magnesium	ppm	ASTM D5185m	90	<b>10</b>	8	31
Calcium	ppm	ASTM D5185m	2	<b>0</b>	0	0
Phosphorus	ppm	ASTM D5185m		<b>0</b>	0	2
Zinc	ppm	ASTM D5185m		<b>17</b>	27	25
Sulfur	ppm	ASTM D5185m		<b>16046</b>	15807	20630
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	<b>0.31</b>	0.45	0.36
Visc @ 40°C	cSt	ASTM D445	46	<b>45.0</b>	45.14	44.3

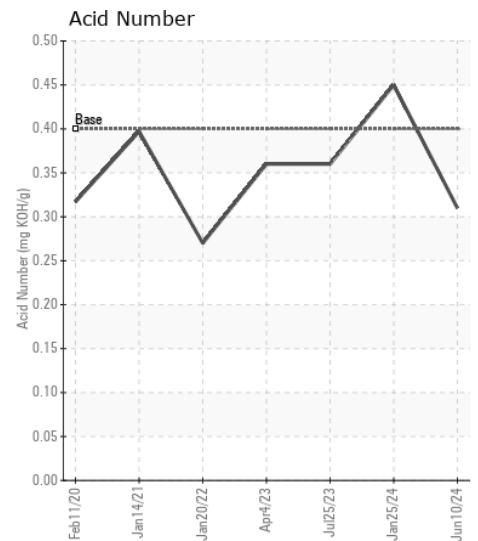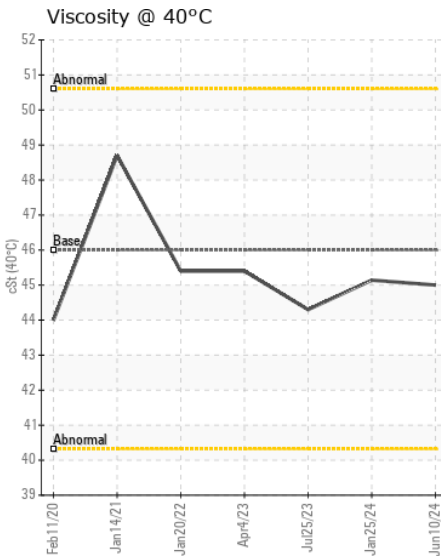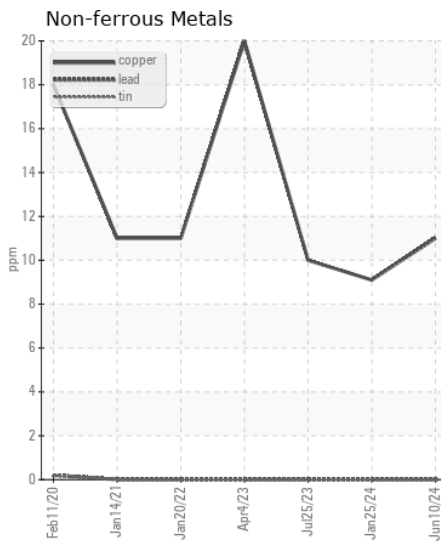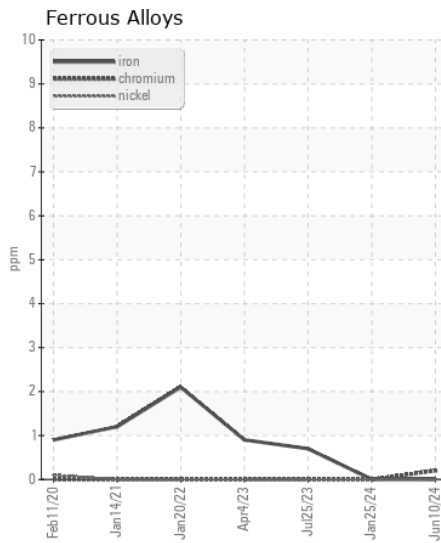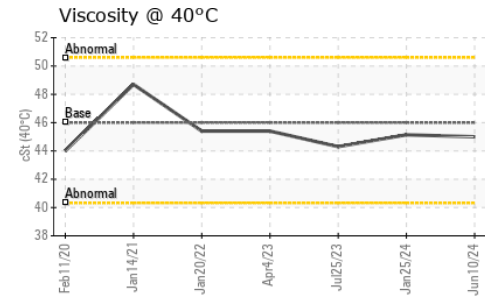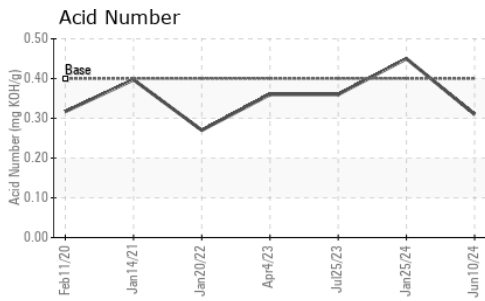

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513

**Sample No.** : UCS06221327

**Lab Number** : 06221327

**Unique Number** : 11099524

**Test Package** : IND 2

**Received** : 26 Jun 2024

**Tested** : 27 Jun 2024

**Diagnosed** : 27 Jun 2024 - Wes Davis

**STANLEY HEATING & AIR**

1002 DOBBINS MILL RD

ELKIN, NC

US 28621

Contact: DARRYL WEDDLE

darryl@stanleyvac.com

T: (336)366-4226

F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)