



# OIL ANALYSIS REPORT

WEAR	NORMAL
CONTAMINATION	ABNORMAL
FLUID CONDITION	NORMAL

Area

[6157738]

Machine Id

GOULDS 1014-P01A

Component

Pump

Fluid

SHELL OMALA 68 (3 QTS)

## RECOMMENDATION

No corrective action is recommended at this time. Resample at the next service interval to monitor.

## WEAR

All component wear rates are normal.

## CONTAMINATION

Moderate concentration of visible dirt/debris present in the oil.

## FLUID CONDITION










The condition of the oil is acceptable for the time in service.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		WC0851088	WC0783963	WC0668709
Sample Date		Client Info		24 Jun 2024	03 Jul 2023	30 Jun 2022
Machine Age	hrs	Client Info		250612	242092	233160
Oil Age	hrs	Client Info		139516	130996	122064
Filter Age	hrs	Client Info		0	0	0
Oil Changed		Client Info		Not Changd	Not Changd	Not Changd
Filter Changed		Client Info		N/A	N/A	N/A
Sample Status				ABNORMAL	NORMAL	NORMAL

Iron	ppm	ASTM D5185m	>500	21	22	22
Chromium	ppm	ASTM D5185m	>7	0	0	0
Nickel	ppm	ASTM D5185m		0	<1	0
Titanium	ppm	ASTM D5185m		0	0	0
Silver	ppm	ASTM D5185m		0	<1	<1
Aluminum	ppm	ASTM D5185m	>25	0	0	<1
Lead	ppm	ASTM D5185m	>35	<1	1	1
Copper	ppm	ASTM D5185m	>50	<1	<1	<1
Tin	ppm	ASTM D5185m	>5	0	<1	<1
Vanadium	ppm	ASTM D5185m		0	0	0
White Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE

Silicon	ppm	ASTM D5185m	>50	13	12	9
Potassium	ppm	ASTM D5185m	>20	1	1	0
Water		WC Method	>.1	NEG	NEG	NEG
Silt	scalar	*Visual	NONE	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	▲ MODER	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>.1	NEG	NEG	NEG

Sodium	ppm	ASTM D5185m		<1	0	<1
Boron	ppm	ASTM D5185m		<1	<1	4
Barium	ppm	ASTM D5185m		0	0	0
Molybdenum	ppm	ASTM D5185m		0	0	0
Manganese	ppm	ASTM D5185m		<1	0	<1
Magnesium	ppm	ASTM D5185m		0	<1	0
Calcium	ppm	ASTM D5185m		0	<1	0
Phosphorus	ppm	ASTM D5185m		344	334	366
Zinc	ppm	ASTM D5185m		2	1	0
Sulfur	ppm	ASTM D5185m		974	1771	1504
Visc @ 40°C	cSt	ASTM D445	68.0	70.6	69.2	69.1

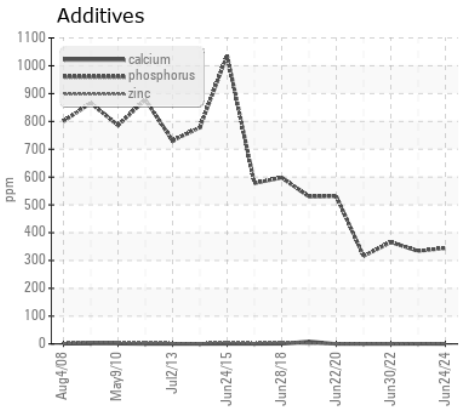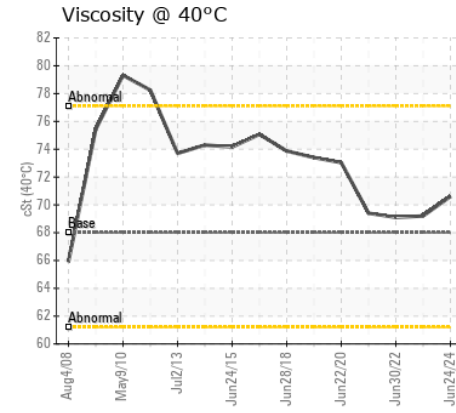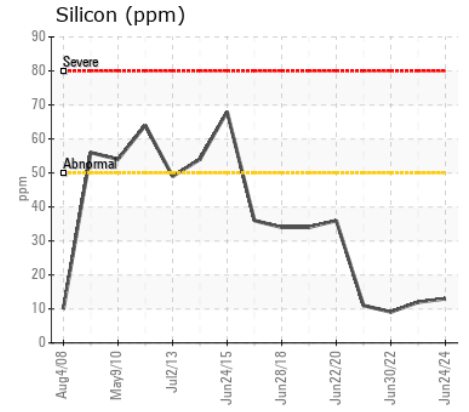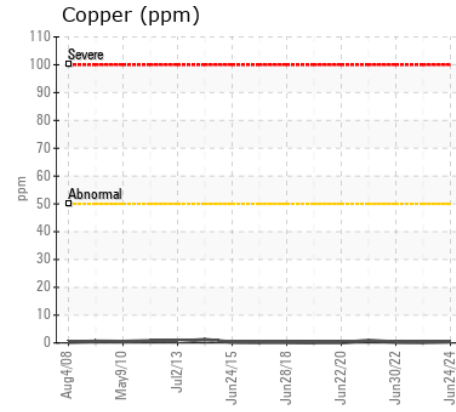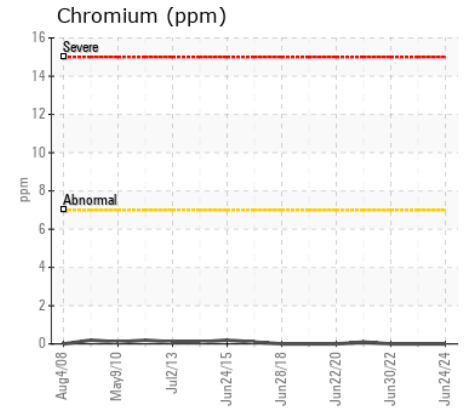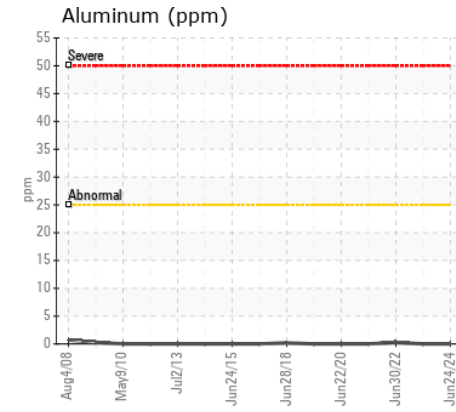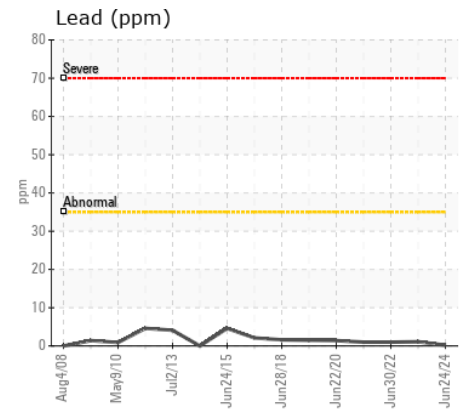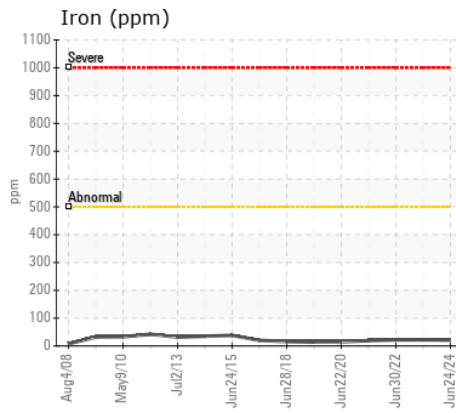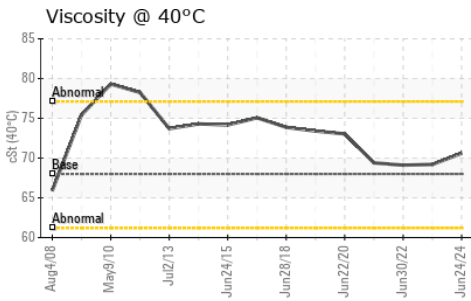

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513

**Sample No.** : WC0851088

**Lab Number** : 06221711

**Unique Number** : 11099908

**Test Package** : MOB 1

**Received** : 26 Jun 2024

**Tested** : 27 Jun 2024

**Diagnosed** : 28 Jun 2024 - Don Baldrige

**ALPEK POLYESTER - DAK AMERICAS LLC**

3216 CEDAR CREEK RD.

FAYETTEVILLE, NC

US 28312

Contact: RONNIE HUDSON

rudson@alpekpolyester.com

T: (910)433-8361

F: (910)433-8218

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)