



OIL ANALYSIS REPORT

| | |
|-----------------|-----------------|
| WEAR | NORMAL |
| CONTAMINATION | ABNORMAL |
| FLUID CONDITION | NORMAL |



Machine Id
ENG 7
Component
Right Biogas Engine
Fluid
D-A Lubricant Blue Flame HB-5 40W (110 GAL)

RECOMMENDATION

No corrective action is recommended at this time. Resample at the next service interval to monitor.

| Test | UOM | Method | Limit/Abn | Current | History1 | History2 |
|----------------|-----|-------------|-----------|--------------------|-------------|-------------|
| Sample Number | | Client Info | | WC0935624 | WC0935621 | WC0935618 |
| Sample Date | | Client Info | | 24 Jun 2024 | 17 Jun 2024 | 28 May 2024 |
| Machine Age | hrs | Client Info | | 74941 | 74775 | 74291 |
| Oil Age | hrs | Client Info | | 980 | 814 | 330 |
| Filter Age | hrs | Client Info | | 980 | 814 | 330 |
| Oil Changed | | Client Info | | N/A | N/A | Changed |
| Filter Changed | | Client Info | | N/A | N/A | Changed |
| Sample Status | | | | ABNORMAL | NORMAL | NORMAL |

WEAR

All component wear rates are normal.

| | | | | | | |
|--------------|--------|-------------|------|--------------|------|------|
| Iron | ppm | ASTM D5185m | >45 | 9 | 6 | 7 |
| Chromium | ppm | ASTM D5185m | >2 | 1 | 0 | <1 |
| Nickel | ppm | ASTM D5185m | >2 | <1 | 0 | <1 |
| Titanium | ppm | ASTM D5185m | | <1 | 0 | <1 |
| Silver | ppm | ASTM D5185m | >5 | <1 | 0 | <1 |
| Aluminum | ppm | ASTM D5185m | >10 | 2 | 2 | 2 |
| Lead | ppm | ASTM D5185m | >5 | 2 | <1 | 2 |
| Copper | ppm | ASTM D5185m | >14 | 2 | <1 | 1 |
| Tin | ppm | ASTM D5185m | >13 | 4 | 4 | 3 |
| Vanadium | ppm | ASTM D5185m | | <1 | 0 | <1 |
| White Metal | scalar | *Visual | NONE | MODER | NONE | NONE |
| Yellow Metal | scalar | *Visual | NONE | NONE | NONE | NONE |

CONTAMINATION














Elemental level of silicon (Si) above normal.

| | | | | | | |
|------------------|----------|-------------|-------|----------------|-------|-------|
| Silicon | ppm | ASTM D5185m | >200 | ▲ 217 | 181 | 134 |
| Potassium | ppm | ASTM D5185m | >20 | 1 | 3 | 1 |
| Fuel | | WC Method | >4.0 | <1.0 | <1.0 | <1.0 |
| Water | | WC Method | >0.1 | NEG | NEG | NEG |
| Glycol | | WC Method | | NEG | NEG | NEG |
| Soot % | % | *ASTM D7844 | | 0 | 0.1 | 0 |
| Nitration | Abs/cm | *ASTM D7624 | >20 | 5.6 | 5.3 | 5.0 |
| Sulfation | Abs/.1mm | *ASTM D7415 | >30 | 19.2 | 18.0 | 19.8 |
| Silt | scalar | *Visual | NONE | NONE | NONE | NONE |
| Debris | scalar | *Visual | NONE | NONE | NONE | NONE |
| Sand/Dirt | scalar | *Visual | NONE | NONE | NONE | NONE |
| Appearance | scalar | *Visual | NORML | NORML | NORML | NORML |
| Odor | scalar | *Visual | NORML | NORML | NORML | NORML |
| Emulsified Water | scalar | *Visual | >0.1 | NEG | NEG | NEG |

FLUID CONDITION

The BN result indicates that there is suitable alkalinity remaining in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

| | | | | | | |
|------------------|----------|-------------|-----|--------------|------|------|
| Sodium | ppm | ASTM D5185m | | 0 | 2 | 0 |
| Boron | ppm | ASTM D5185m | | 1 | <1 | <1 |
| Barium | ppm | ASTM D5185m | | 1 | 0 | 2 |
| Molybdenum | ppm | ASTM D5185m | | 3 | <1 | 3 |
| Manganese | ppm | ASTM D5185m | | <1 | <1 | <1 |
| Magnesium | ppm | ASTM D5185m | | 14 | 15 | 15 |
| Calcium | ppm | ASTM D5185m | | 1553 | 1591 | 1462 |
| Phosphorus | ppm | ASTM D5185m | | 346 | 392 | 400 |
| Zinc | ppm | ASTM D5185m | | 475 | 493 | 470 |
| Sulfur | ppm | ASTM D5185m | | 2866 | 3485 | 3244 |
| Oxidation | Abs/.1mm | *ASTM D7414 | >25 | 13.1 | 12.3 | 12.9 |
| Acid Number (AN) | mg KOH/g | ASTM D8045 | | 1.67 | 1.42 | 1.20 |
| Base Number (BN) | mg KOH/g | ASTM D2896 | | 3.59 | 3.73 | 4.00 |
| Visc @ 100°C | cSt | ASTM D445 | | 13.3 | 13.4 | 13.3 |

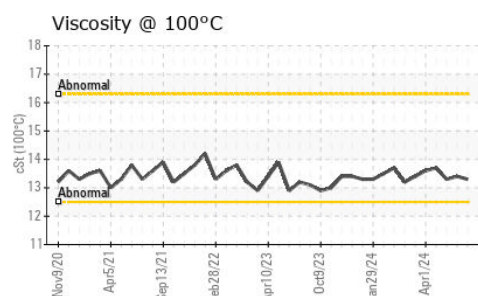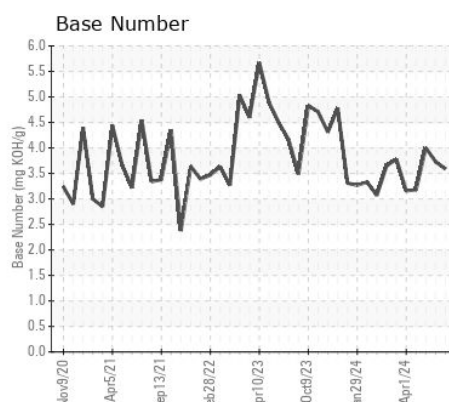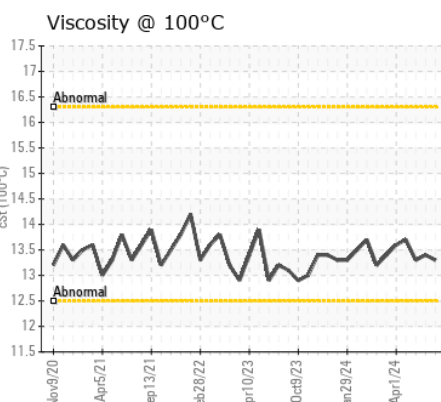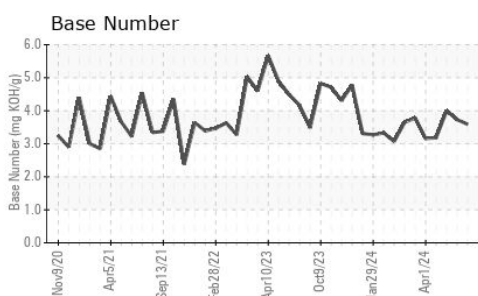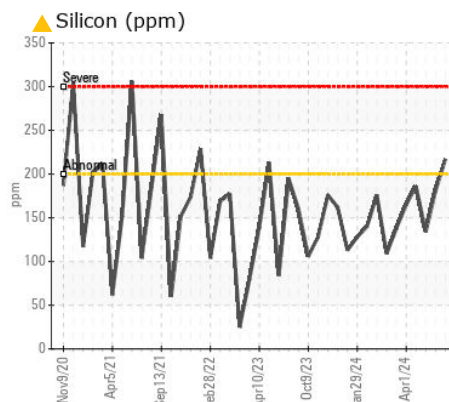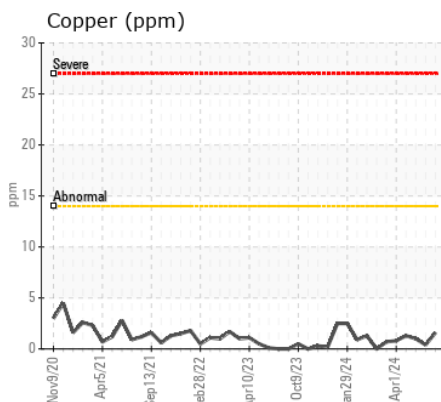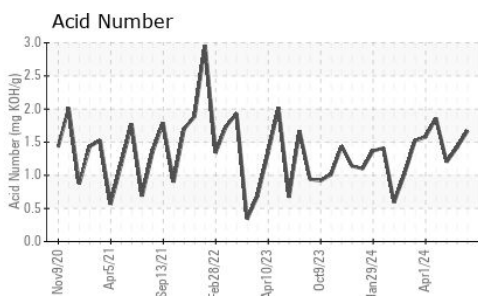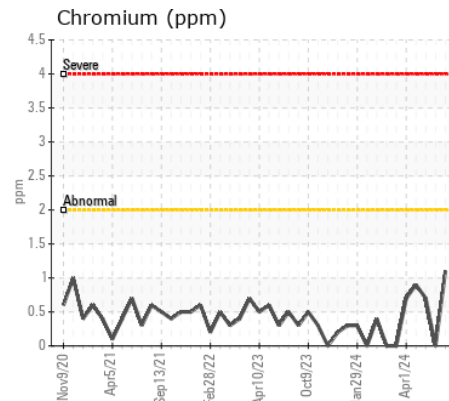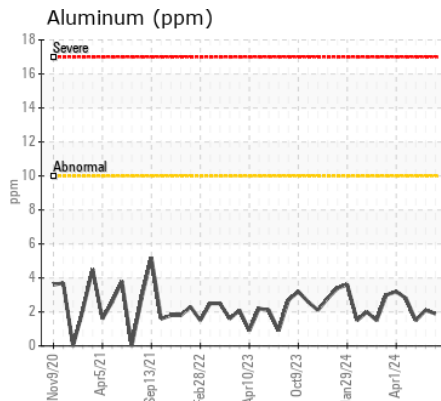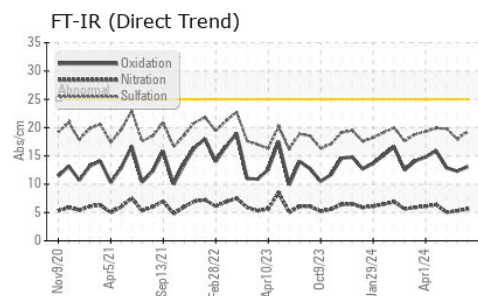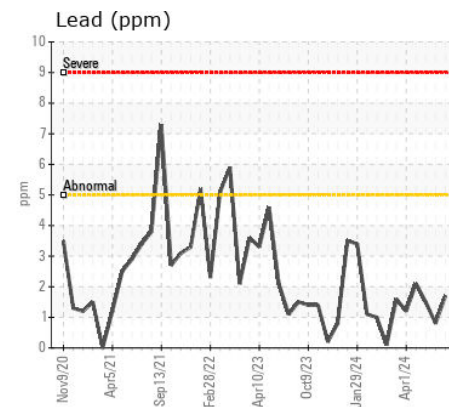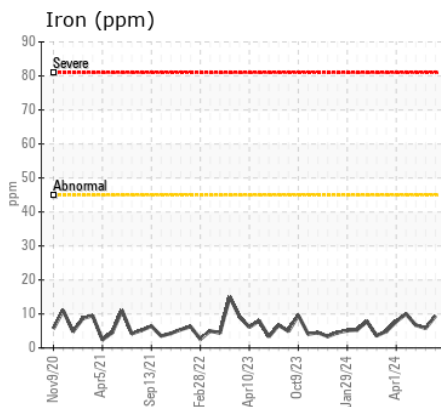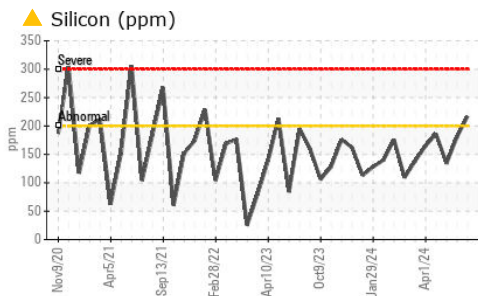

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WC0935624
Lab Number : 06221848
Unique Number : 11100045
Test Package : MOB 2
Received : 26 Jun 2024
Tested : 29 Jun 2024
Diagnosed : 01 Jul 2024 - Jonathan Hester

BROOME ENERGY
 286 KNAPP ROAD
 BINGHAMTON, NY
 US 13905
 Contact: RUSS MERCER
 BroomeEnergy@gmail.com
 T: (607)766-0358
 F: (607)766-0357

Certificate L2367
 To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)