

Area SURVEY-CANNON [SURVEY-CANNON] Machine Id ONAN B190476304 Component Genset Fluid DIESEL ENGINE OIL SAE 15W40 (2 GAL) RECOMMENDATION

RECOMMENDATION	Test	UOM	Method	Limit/Abn	Current	History1	History2
RECOMMENDATION	Sample Number		Client Info		VPA057333		
No corrective action is recommended at this time. Resample at the	Sample Date		Client Info		25 Jun 2024		
next service interval to monitor.	Machine Age	hrs	Client Info		471		
	Oil Age	hrs	Client Info		0		
	Filter Age	hrs	Client Info		0		
	Oil Changed		Client Info		Not Changd		
	Filter Changed		Client Info		Not Changd		
	Sample Status				NORMAL		
WEAR	Iron	ppm	ASTM D5185m	<u>\</u> 50	2		
All component wear rates are normal.	Chromium	ppm	ASTM D5185m		0		
	Nickel	ppm	ASTM D5185m		0		
	Titanium	ppm	ASTM D5185m	~~	<1		
	Silver	ppm	ASTM D5185m	<u>\</u> 5	0		
	Aluminum	ppm	ASTM D5185m		2		
	Lead	ppm	ASTM D5185m		0		
	Copper	ppm	ASTM D5185m		<1		
	Tin	ppm	ASTM D5185m		0		
	Vanadium	ppm	ASTM D5185m	210	0		
	White Metal	scalar	*Visual	NONE	NONE		
	Yellow Metal	scalar	*Visual	NONE	NONE		
CONTAMINATION	Silicon	ppm	ASTM D5185m	>25	6		
	Potassium	ppm	ASTM D5185m	>20	2		
There is no indication of any contamination in the oil.	Fuel		WC Method	>4.0	<1.0		
	Water		WC Method	>0.1	NEG		
	Glycol		WC Method		NEG		
	Soot %	%	*ASTM D7844		0.1		
	Nitration	Abs/cm	*ASTM D7624	>20	6.8		
	Sulfation	Abs/.1mm	*ASTM D7415	>30	17.3		
	Silt	scalar	*Visual	NONE	NONE		
	Debris	scalar	*Visual	NONE	NONE		
	Sand/Dirt	scalar	*Visual	NONE	NONE		
	Appearance	scalar	*Visual	NORML	NORML		
	Odor	scalar	*Visual	NORML	NORML		
	Emulsified Water	scalar	*Visual	>0.1	NEG		
FLUID CONDITION	Sodium	nom	ASTM D5185m	×159	1		
FLOID CONDITION	Boron	ppm	ASTM D5185m		131		
The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.	Barium	ppm	ASTM D5185m		0		
	Molybdenum	ppm	ASTM D5185m		90		
	Manganese	ppm ppm	ASTM D5185m	100	90 <1		
	Magnesium	ppm	ASTM D5185m	450	115		
	Calcium	ppm	ASTM D5185m		2230		
	Phosphorus	ppm	ASTM D5185m		957		
	Zinc	ppm	ASTM D5185m		1319		
	Sulfur	ppm	ASTM D5185m		4680		
	Oxidation		*ASTM D3103111		13.0		
			101101414	~LJ	10.0		


Base Number (BN) mg KOH/g ASTM D2896 8.5

ASTM D445 14.4

Visc @ 100°C cSt

7.6

13.8

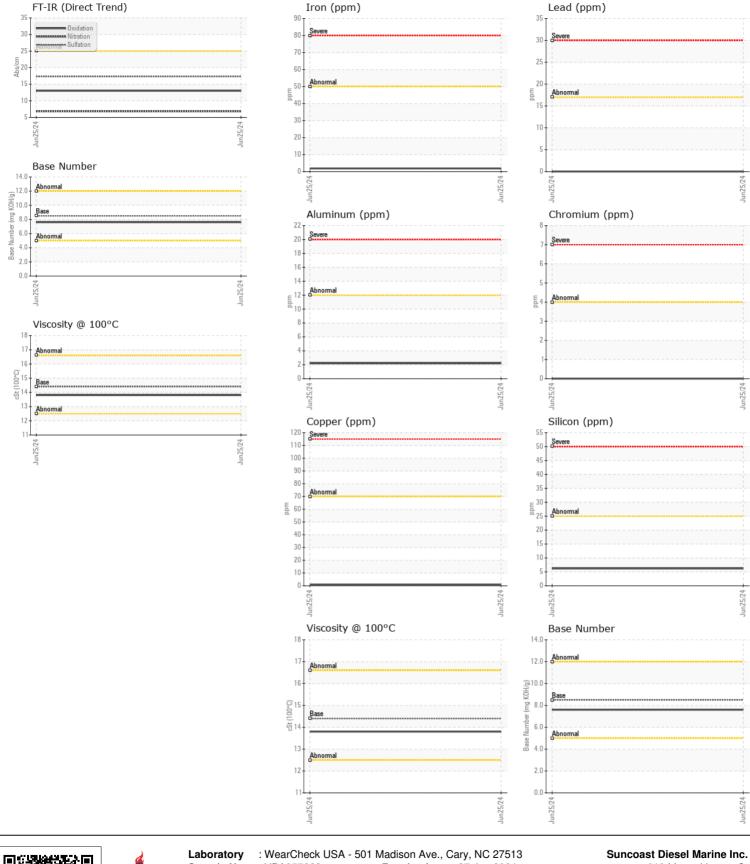

Sample No. : VPA057333 Received 610 Mount Vernan St : 27 Jun 2024 Lab Number : 06222105 Tested OLDSMAR, FL : 28 Jun 2024 Unique Number : 11100302 Diagnosed : 28 Jun 2024 - Doug Bogart US 34677 Test Package : MOB 1 (Additional Tests: TBN) Contact: MARK WARREN Certificate L2367 To discuss this sample report, contact Customer Service at 1-800-237-1369. oldsmar@suncoastdmi.com * - Denotes test methods that are outside of the ISO 17025 scope of accreditation. T: (813)475-5942 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012) F: (813)475-5943