



VOLVO PENTA

OIL ANALYSIS REPORT

WEAR	NORMAL
CONTAMINATION	NORMAL
FLUID CONDITION	NORMAL

Area

STEVE & JOAN IHLENFELDT [SR00100232]

Machine Id

VOLVO PENTA STEVE & JOAN IHLENFELDT (S/N NOT GIVEN)

Component

Genset

Fluid

{not provided} (--- GAL)

RECOMMENDATION

No corrective action is recommended at this time. Resample at the next service interval to monitor.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		VPA061450	---	---
Sample Date		Client Info		14 Jun 2024	---	---
Machine Age	hrs	Client Info		180	---	---
Oil Age	hrs	Client Info		0	---	---
Filter Age	hrs	Client Info		0	---	---
Oil Changed		Client Info		N/A	---	---
Filter Changed		Client Info		N/A	---	---
Sample Status				NORMAL	---	---

WEAR

All component wear rates are normal.

Iron	ppm	ASTM D5185m	>80	11	---	---
Chromium	ppm	ASTM D5185m	>6	<1	---	---
Nickel	ppm	ASTM D5185m	>2	0	---	---
Titanium	ppm	ASTM D5185m	>2	0	---	---
Silver	ppm	ASTM D5185m	>2	0	---	---
Aluminum	ppm	ASTM D5185m	>20	7	---	---
Lead	ppm	ASTM D5185m	>95	<1	---	---
Copper	ppm	ASTM D5185m	>85	5	---	---
Tin	ppm	ASTM D5185m	>9	<1	---	---
Vanadium	ppm	ASTM D5185m		0	---	---
White Metal	scalar	*Visual	NONE	NONE	---	---
Yellow Metal	scalar	*Visual	NONE	NONE	---	---

CONTAMINATION












There is no indication of any contamination in the oil.

Silicon	ppm	ASTM D5185m	>25	35	---	---
Potassium	ppm	ASTM D5185m	>20	2	---	---
Fuel		WC Method	>4.0	<1.0	---	---
Water		WC Method	>0.1	NEG	---	---
Glycol		WC Method		NEG	---	---
Soot %	%	*ASTM D7844		0.1	---	---
Nitration	Abs/cm	*ASTM D7624	>20	4.4	---	---
Sulfation	Abs/.1mm	*ASTM D7415	>30	18.4	---	---
Silt	scalar	*Visual	NONE	NONE	---	---
Debris	scalar	*Visual	NONE	NONE	---	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---	---
Appearance	scalar	*Visual	NORML	NORML	---	---
Odor	scalar	*Visual	NORML	NORML	---	---
Emulsified Water	scalar	*Visual	>0.1	NEG	---	---

FLUID CONDITION

The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.

Sodium	ppm	ASTM D5185m		2	---	---
Boron	ppm	ASTM D5185m		61	---	---
Barium	ppm	ASTM D5185m		0	---	---
Molybdenum	ppm	ASTM D5185m		47	---	---
Manganese	ppm	ASTM D5185m		2	---	---
Magnesium	ppm	ASTM D5185m		806	---	---
Calcium	ppm	ASTM D5185m		1095	---	---
Phosphorus	ppm	ASTM D5185m		921	---	---
Zinc	ppm	ASTM D5185m		1080	---	---
Sulfur	ppm	ASTM D5185m		7452	---	---
Oxidation	Abs/.1mm	*ASTM D7414	>25	11.6	---	---
Base Number (BN)	mg KOH/g	ASTM D2896		9.8	---	---
Visc @ 100°C	cSt	ASTM D445		13.1	---	---

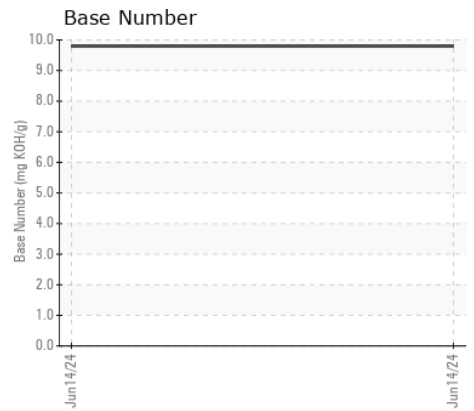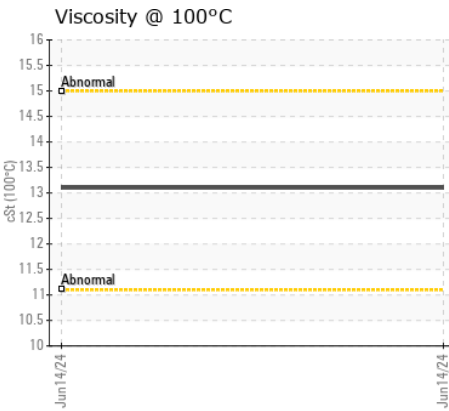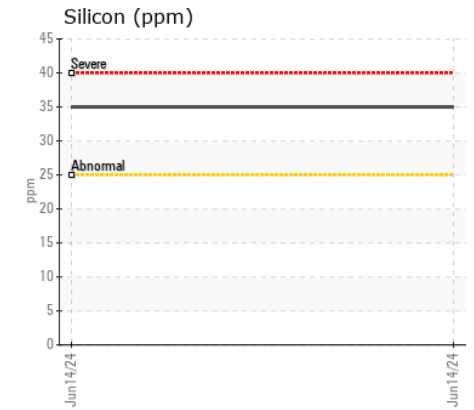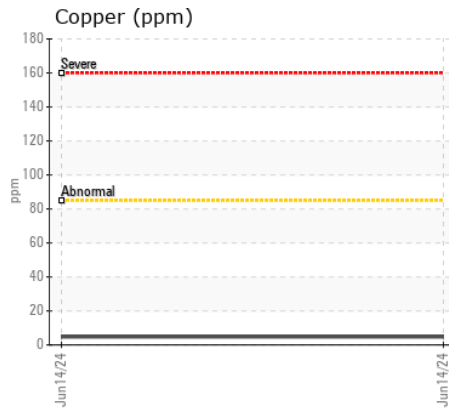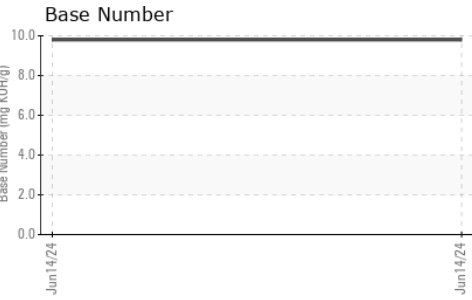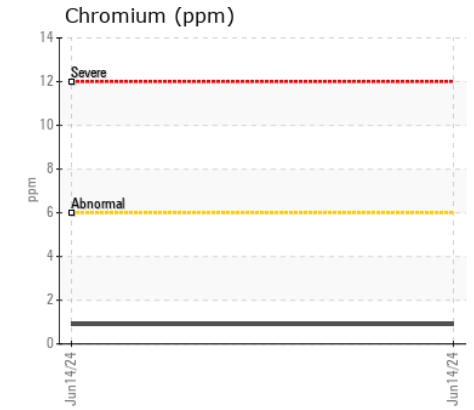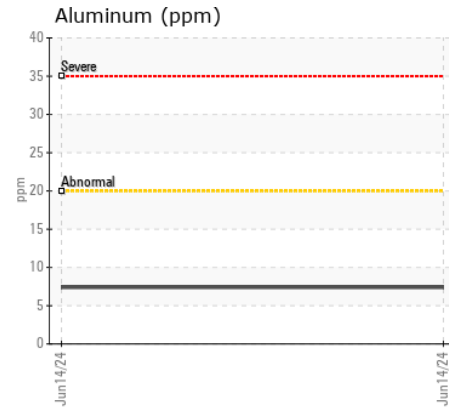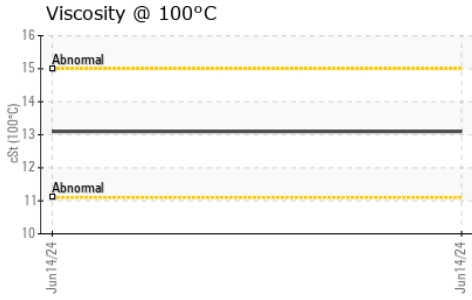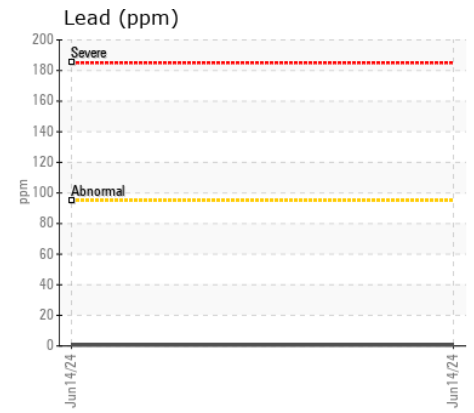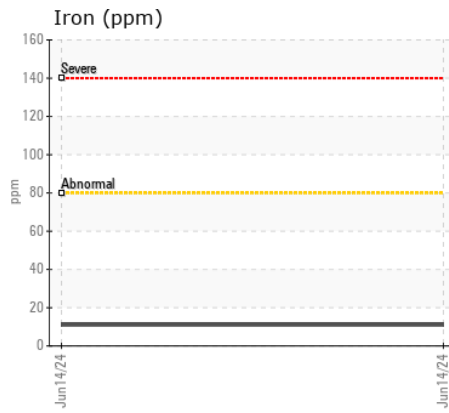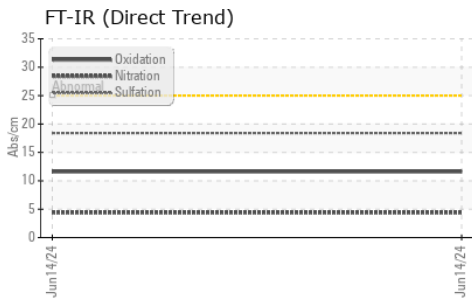

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : VPA061450 **Received** : 27 Jun 2024
Lab Number : 06222112 **Tested** : 28 Jun 2024
Unique Number : 11100309 **Diagnosed** : 28 Jun 2024 - Sean Felton
Test Package : MOB 1 (Additional Tests: TBN)

Pacific Power Group - VP981534
 7215 S 228th St
 Kent, WA
 US 98032
 Contact: STEVE CAREY
 scarey@pacificpowergroup.com
 T: (253)740-0842
 F: x:

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)