



WEAR	<b>NORMAL</b>
CONTAMINATION	<b>SEVERE</b>
FLUID CONDITION	<b>ABNORMAL</b>

Area  
**[W52672]**

Machine Id  
**MQ POWER DCA-70 7353122**

Component  
**Diesel Engine**

Fluid  
**{not provided} (--- GAL)**

### RECOMMENDATION

We advise that you check the fuel injection system. We recommend that you drain the oil and perform a filter service on this component if not already done. We recommend an early resample to monitor this condition.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		<b>JR0224983</b>	---	---
Sample Date		Client Info		<b>21 Jun 2024</b>	---	---
Machine Age	hrs	Client Info		<b>11087</b>	---	---
Oil Age	hrs	Client Info		<b>170</b>	---	---
Filter Age	hrs	Client Info		<b>170</b>	---	---
Oil Changed		Client Info		<b>Not Changd</b>	---	---
Filter Changed		Client Info		<b>Not Changd</b>	---	---
Sample Status				<b>SEVERE</b>	---	---

### WEAR

All component wear rates are normal.

Iron	ppm	ASTM D5185m	>100	<b>4</b>	---	---
Chromium	ppm	ASTM D5185m	>20	<b>&lt;1</b>	---	---
Nickel	ppm	ASTM D5185m	>4	<b>&lt;1</b>	---	---
Titanium	ppm	ASTM D5185m		<b>&lt;1</b>	---	---
Silver	ppm	ASTM D5185m	>3	<b>0</b>	---	---
Aluminum	ppm	ASTM D5185m	>20	<b>3</b>	---	---
Lead	ppm	ASTM D5185m	>40	<b>0</b>	---	---
Copper	ppm	ASTM D5185m	>330	<b>2</b>	---	---
Tin	ppm	ASTM D5185m	>15	<b>&lt;1</b>	---	---
Vanadium	ppm	ASTM D5185m		<b>&lt;1</b>	---	---
White Metal	scalar	*Visual	NONE	<b>NONE</b>	---	---
Yellow Metal	scalar	*Visual	NONE	<b>NONE</b>	---	---

### CONTAMINATION









There is a high amount of fuel present in the oil.

Silicon	ppm	ASTM D5185m	>25	<b>5</b>	---	---
Potassium	ppm	ASTM D5185m	>20	<b>2</b>	---	---
Fuel	%	ASTM D3524	>5	<b>▲ 15.2</b>	---	---
Water		WC Method	>0.2	<b>NEG</b>	---	---
Glycol		WC Method		<b>NEG</b>	---	---
Soot %	%	*ASTM D7844	>3	<b>0.1</b>	---	---
Nitration	Abs/cm	*ASTM D7624	>20	<b>7.9</b>	---	---
Sulfation	Abs/.1mm	*ASTM D7415	>30	<b>20.7</b>	---	---
Silt	scalar	*Visual	NONE	<b>NONE</b>	---	---
Debris	scalar	*Visual	NONE	<b>NONE</b>	---	---
Sand/Dirt	scalar	*Visual	NONE	<b>NONE</b>	---	---
Appearance	scalar	*Visual	NORML	<b>NORML</b>	---	---
Odor	scalar	*Visual	NORML	<b>NORML</b>	---	---
Emulsified Water	scalar	*Visual	>0.2	<b>NEG</b>	---	---

### FLUID CONDITION

Fuel is present in the oil and is lowering the viscosity. The BN result indicates that there is suitable alkalinity remaining in the oil. The oil is no longer serviceable due to the presence of contaminants.

Sodium	ppm	ASTM D5185m		<b>5</b>	---	---
Boron	ppm	ASTM D5185m		<b>47</b>	---	---
Barium	ppm	ASTM D5185m		<b>0</b>	---	---
Molybdenum	ppm	ASTM D5185m		<b>45</b>	---	---
Manganese	ppm	ASTM D5185m		<b>&lt;1</b>	---	---
Magnesium	ppm	ASTM D5185m		<b>450</b>	---	---
Calcium	ppm	ASTM D5185m		<b>1568</b>	---	---
Phosphorus	ppm	ASTM D5185m		<b>746</b>	---	---
Zinc	ppm	ASTM D5185m		<b>894</b>	---	---
Sulfur	ppm	ASTM D5185m		<b>2511</b>	---	---
Oxidation	Abs/.1mm	*ASTM D7414	>25	<b>19.6</b>	---	---
Base Number (BN)	mg KOH/g	ASTM D2896		<b>8.9</b>	---	---
Visc @ 100°C	cSt	ASTM D445		<b>▲ 9.8</b>	---	---

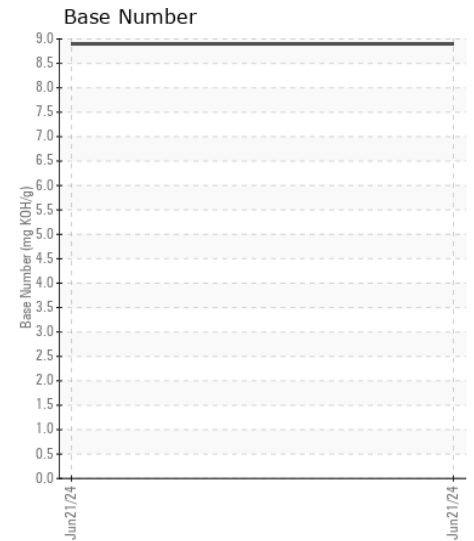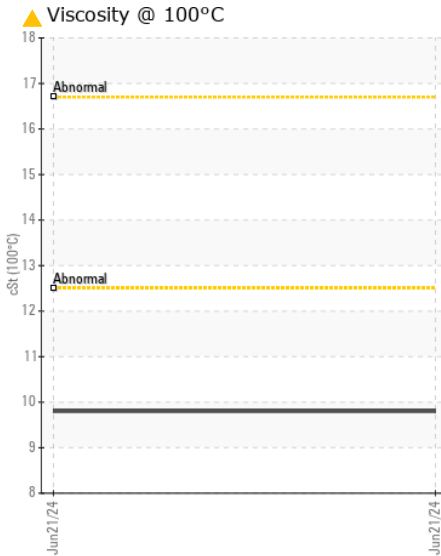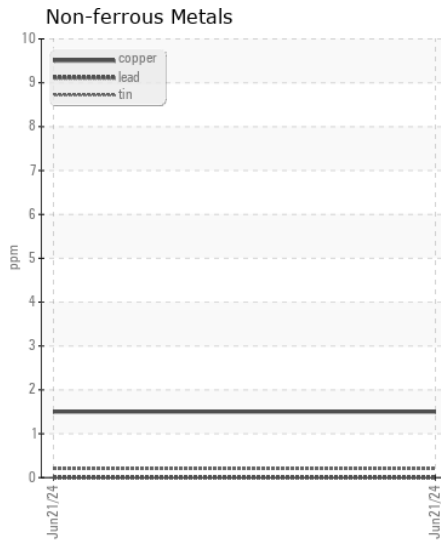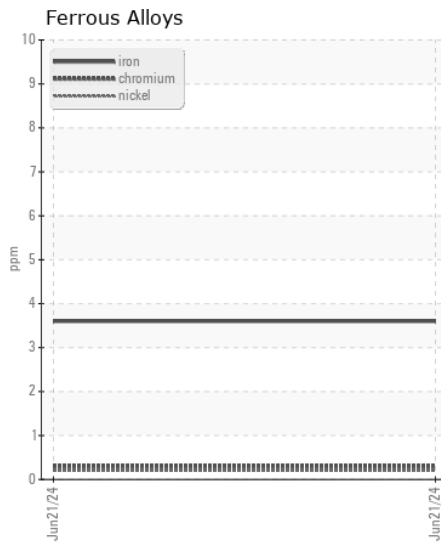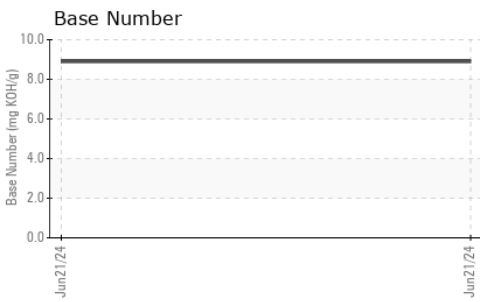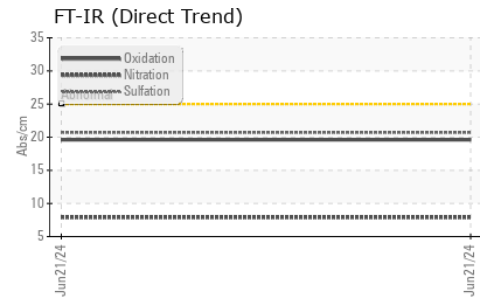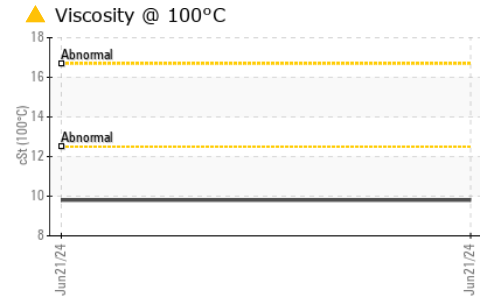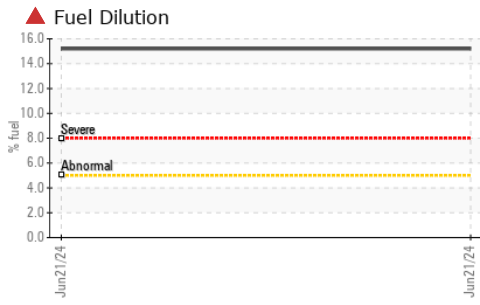

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : JR0224983 **Received** : 27 Jun 2024  
**Lab Number** : 06222194 **Tested** : 01 Jul 2024  
**Unique Number** : 11100391 **Diagnosed** : 01 Jul 2024 - Jonathan Hester  
**Test Package** : CONST ( Additional Tests: FuelDilution, PercentFuel, TBN )

**JRE - ASHLAND**  
 11047 LEADBETTER RD  
 ASHLAND, VA  
 US 23005  
 Contact: DAVID ZIEG  
 dzieg@jamesriverequipment.com  
 T: (804)798-6001  
 F: (804)798-0292

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)