



| | |
|-----------------|---------------|
| WEAR | NORMAL |
| CONTAMINATION | NORMAL |
| FLUID CONDITION | NORMAL |

Area
GRANT GUNDY [6746]
Machine Id
NEXT GEN SL1056-9.3KLA 240-20565
Component
Genset
Fluid
{not provided} (--- QTS)

RECOMMENDATION

Resample at the next service interval to monitor.

| Test | UOM | Method | Limit/Abn | Current | History1 | History2 |
|----------------|-----|-------------|-----------|--------------------|-------------|----------|
| Sample Number | | Client Info | | VPA052973 | VPA055939 | --- |
| Sample Date | | Client Info | | 26 Jun 2024 | 01 Jan 2023 | --- |
| Machine Age | hrs | Client Info | | 394 | 75 | --- |
| Oil Age | hrs | Client Info | | 0 | 0 | --- |
| Filter Age | hrs | Client Info | | 0 | 0 | --- |
| Oil Changed | | Client Info | | Not Changd | Not Changd | --- |
| Filter Changed | | Client Info | | Not Changd | Not Changd | --- |
| Sample Status | | | | NORMAL | NORMAL | --- |

WEAR

All component wear rates are normal.

| | | | | | | |
|--------------|--------|-------------|------|--------------|------|-----|
| Iron | ppm | ASTM D5185m | >50 | 6 | 4 | --- |
| Chromium | ppm | ASTM D5185m | >4 | <1 | 0 | --- |
| Nickel | ppm | ASTM D5185m | >2 | 0 | 0 | --- |
| Titanium | ppm | ASTM D5185m | | <1 | 0 | --- |
| Silver | ppm | ASTM D5185m | >5 | 0 | 0 | --- |
| Aluminum | ppm | ASTM D5185m | >12 | 2 | 0 | --- |
| Lead | ppm | ASTM D5185m | >17 | 0 | 0 | --- |
| Copper | ppm | ASTM D5185m | >70 | <1 | 0 | --- |
| Tin | ppm | ASTM D5185m | >15 | <1 | 0 | --- |
| Vanadium | ppm | ASTM D5185m | | <1 | 0 | --- |
| White Metal | scalar | *Visual | NONE | NONE | NONE | --- |
| Yellow Metal | scalar | *Visual | NONE | NONE | NONE | --- |

CONTAMINATION













There is no indication of any contamination in the oil.

| | | | | | | |
|------------------|----------|-------------|-------|----------------|-------|-----|
| Silicon | ppm | ASTM D5185m | >25 | 6 | 4 | --- |
| Potassium | ppm | ASTM D5185m | >20 | 3 | 2 | --- |
| Fuel | | WC Method | >4.0 | <1.0 | <1.0 | --- |
| Water | | WC Method | >0.1 | NEG | NEG | --- |
| Glycol | | WC Method | | NEG | NEG | --- |
| Soot % | % | *ASTM D7844 | | 0 | 0.1 | --- |
| Nitration | Abs/cm | *ASTM D7624 | >20 | 5.9 | 6.2 | --- |
| Sulfation | Abs/.1mm | *ASTM D7415 | >30 | 17.4 | 17.2 | --- |
| Silt | scalar | *Visual | NONE | NONE | NONE | --- |
| Debris | scalar | *Visual | NONE | NONE | NONE | --- |
| Sand/Dirt | scalar | *Visual | NONE | NONE | NONE | --- |
| Appearance | scalar | *Visual | NORML | NORML | NORML | --- |
| Odor | scalar | *Visual | NORML | NORML | NORML | --- |
| Emulsified Water | scalar | *Visual | >0.1 | NEG | NEG | --- |

FLUID CONDITION

The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is acceptable for the time in service.

| | | | | | | |
|------------------|----------|-------------|-----|--------------|------|-----|
| Sodium | ppm | ASTM D5185m | | 1 | 1 | --- |
| Boron | ppm | ASTM D5185m | | 96 | 92 | --- |
| Barium | ppm | ASTM D5185m | | 0 | <1 | --- |
| Molybdenum | ppm | ASTM D5185m | | 19 | 0 | --- |
| Manganese | ppm | ASTM D5185m | | <1 | 0 | --- |
| Magnesium | ppm | ASTM D5185m | | 797 | 604 | --- |
| Calcium | ppm | ASTM D5185m | | 1720 | 1237 | --- |
| Phosphorus | ppm | ASTM D5185m | | 898 | 644 | --- |
| Zinc | ppm | ASTM D5185m | | 1067 | 754 | --- |
| Sulfur | ppm | ASTM D5185m | | 4431 | 2756 | --- |
| Oxidation | Abs/.1mm | *ASTM D7414 | >25 | 11.5 | 11.7 | --- |
| Base Number (BN) | mg KOH/g | ASTM D2896 | | 8.4 | 8.8 | --- |
| Visc @ 100°C | cSt | ASTM D445 | | 13.4 | 13.3 | --- |

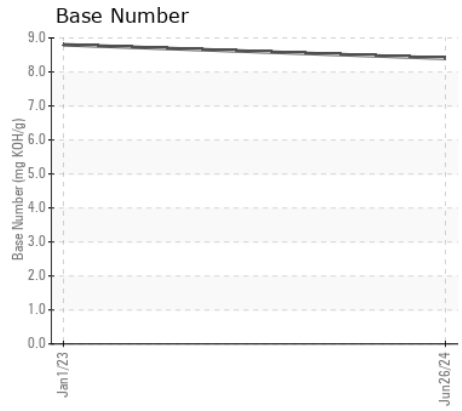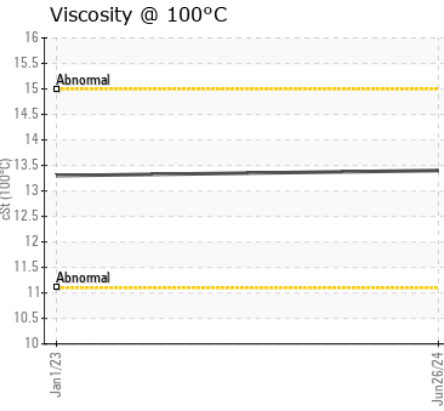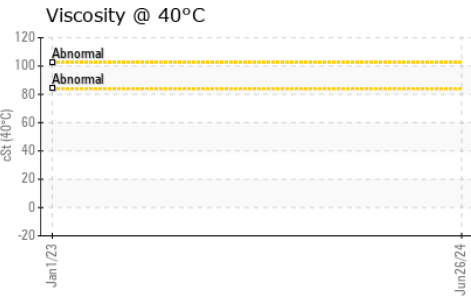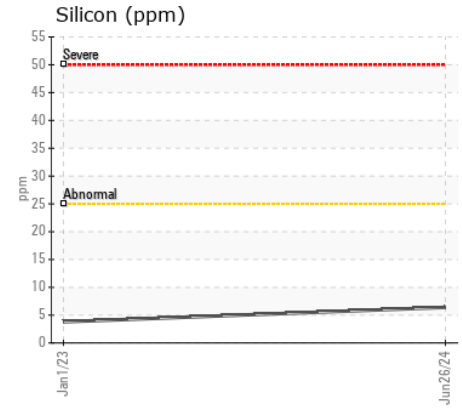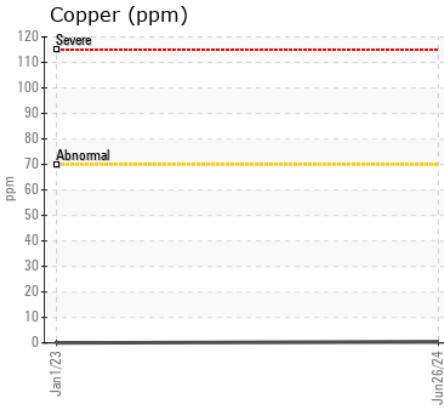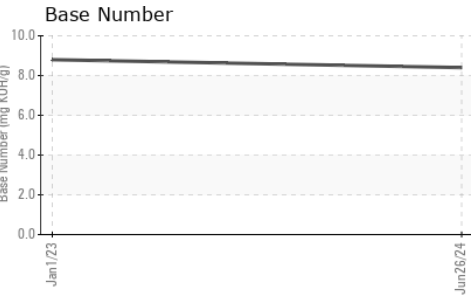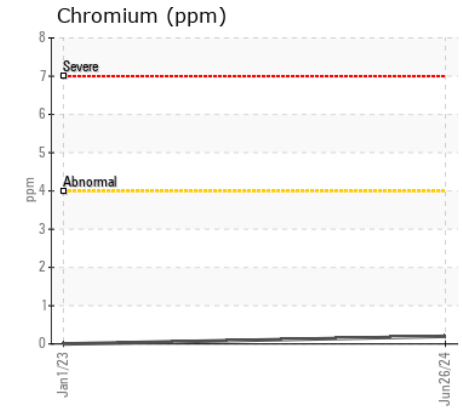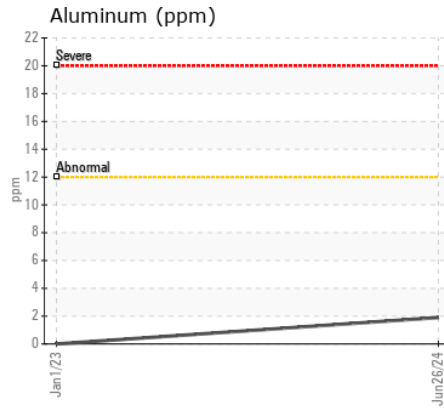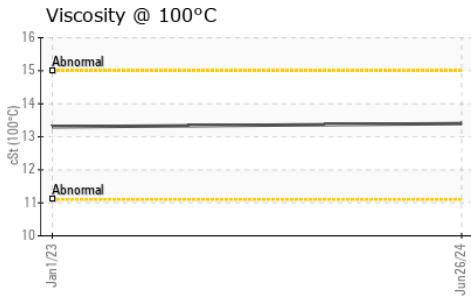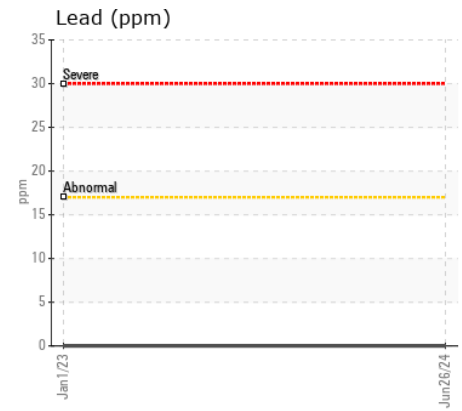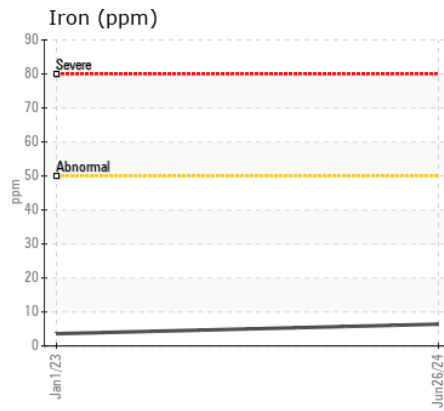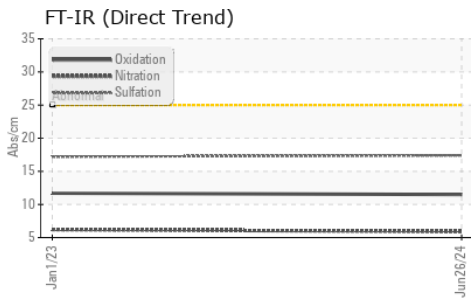

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513

Sample No. : VPA052973

Lab Number : 06223287

Unique Number : 11101484

Test Package : MOB 1 (Additional Tests: KV40, TBN)

Received : 28 Jun 2024

Tested : 01 Jul 2024

Diagnosed : 01 Jul 2024 - Don Baldrige

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Northwest Diesel Power

1325 ROEDER AVE SUITE 103

BELLINGHAM, WA

US 98225

Contact: BRANDON ROBERTSON

parts@nwdieselpower.com

T:

F: