



WEAR	NORMAL
CONTAMINATION	NORMAL
FLUID CONDITION	NORMAL

Machine Id
INGERSOLL RAND TA3000 21144 - BALL CORP WADDELL
 Component
Compressor
 Fluid
INGERSOLL-RAND TURBOBLEND 46 (55 GAL)

RECOMMENDATION

Resample at the next service interval to monitor.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		CCSI2014316	CCSI2013339	CCSI2013417
Sample Date		Client Info		18 Jun 2024	28 Feb 2024	14 Nov 2023
Machine Age	hrs	Client Info		22343	19676	18506
Oil Age	hrs	Client Info		0	0	0
Filter Age	hrs	Client Info		0	0	0
Oil Changed		Client Info		N/A	Not Changd	Not Changd
Filter Changed		Client Info		N/A	N/A	N/A
Sample Status				NORMAL	NORMAL	NORMAL

WEAR

All component wear rates are normal.

Iron	ppm	ASTM D5185m	>50	<1	0	<1
Chromium	ppm	ASTM D5185m	>5	<1	0	<1
Nickel	ppm	ASTM D5185m		<1	<1	<1
Titanium	ppm	ASTM D5185m		<1	0	<1
Silver	ppm	ASTM D5185m		<1	0	0
Aluminum	ppm	ASTM D5185m	>15	2	0	2
Lead	ppm	ASTM D5185m	>65	<1	0	0
Copper	ppm	ASTM D5185m	>65	<1	0	<1
Tin	ppm	ASTM D5185m	>10	<1	0	<1
Vanadium	ppm	ASTM D5185m		<1	0	0
White Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE

CONTAMINATION










There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

Silicon	ppm	ASTM D5185m	>35	<1	0	1
Potassium	ppm	ASTM D5185m	>20	<1	0	<1
Water	%	ASTM D6304	>0.1	NEG	NEG	NEG
Particles >4µm		ASTM D7647	>10000	586	234	462
Particles >6µm		ASTM D7647	>2500	249	29	151
Particles >14µm		ASTM D7647	>320	35	3	15
Particles >21µm		ASTM D7647	>80	10	1	5
Particles >38µm		ASTM D7647	>20	1	0	1
Particles >71µm		ASTM D7647	>4	1	0	0
Oil Cleanliness		ISO 4406 (c)	>20/18/15	16/15/12	15/12/9	16/14/11
Silt	scalar	*Visual	NONE	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG	NEG

FLUID CONDITION

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

Sodium	ppm	ASTM D5185m		0	0	0
Boron	ppm	ASTM D5185m		0	0	0
Barium	ppm	ASTM D5185m		<1	1	4
Molybdenum	ppm	ASTM D5185m		<1	0	<1
Manganese	ppm	ASTM D5185m		<1	0	<1
Magnesium	ppm	ASTM D5185m		0	<1	0
Calcium	ppm	ASTM D5185m		0	<1	0
Phosphorus	ppm	ASTM D5185m		10	13	34
Zinc	ppm	ASTM D5185m		2	6	0
Sulfur	ppm	ASTM D5185m		0	0	0
Acid Number (AN)	mg KOH/g	ASTM D8045		0.13	0.11	0.06
Visc @ 40°C	cSt	ASTM D445	46	44.5	44.8	44.6

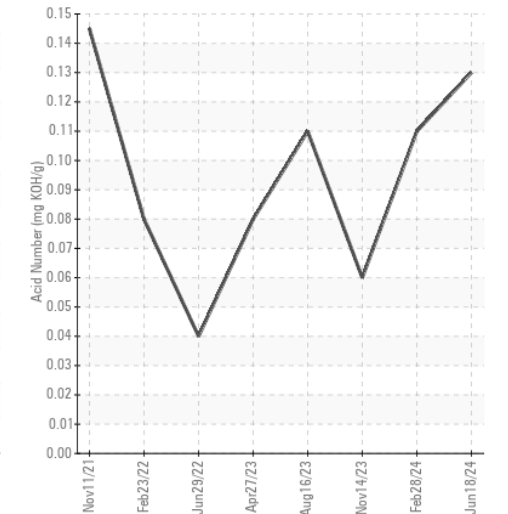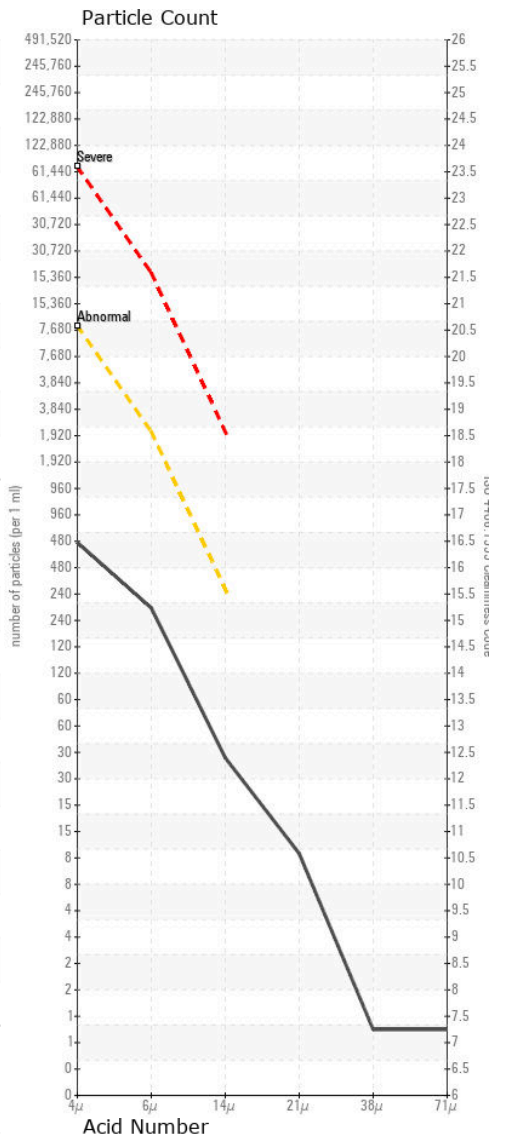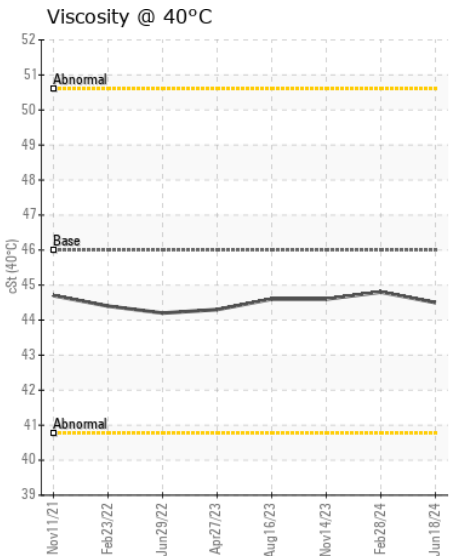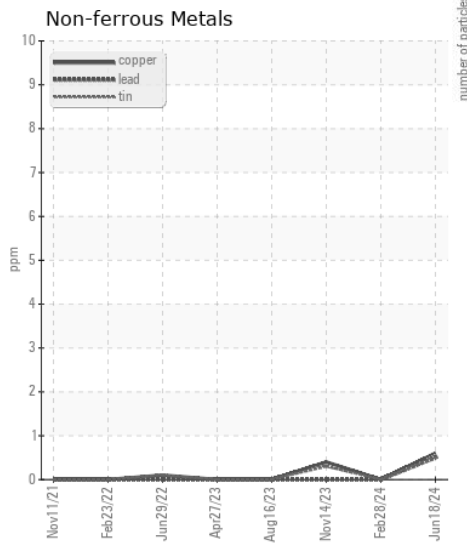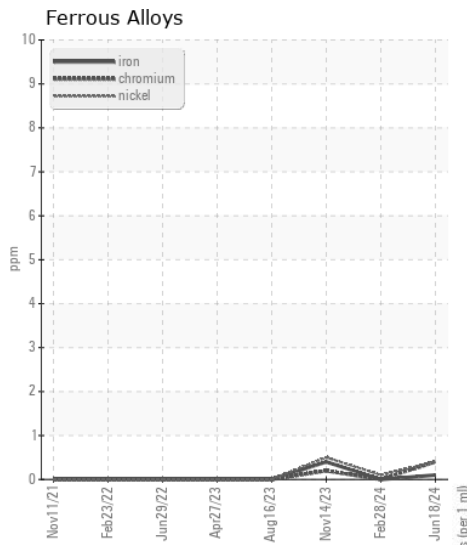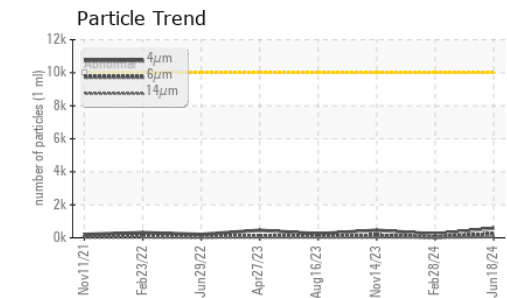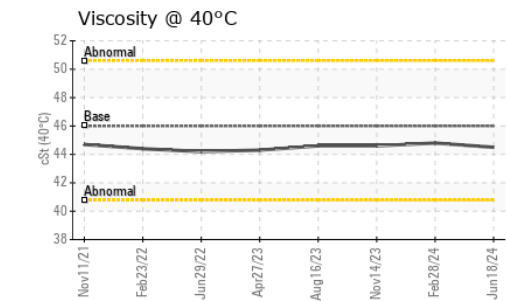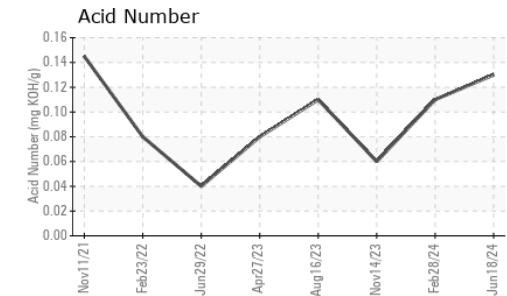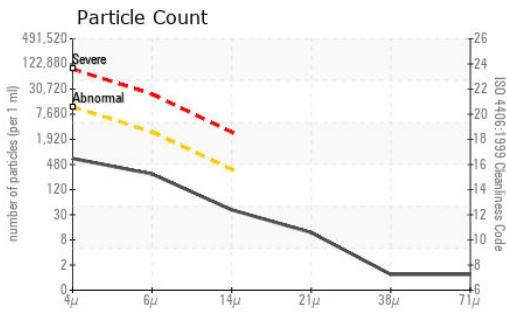

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : CCSI2014316 **Received** : 28 Jun 2024
Lab Number : 06223469 **Tested** : 01 Jul 2024
Unique Number : 11101666 **Diagnosed** : 01 Jul 2024 - Don Baldrige
Test Package : IND 2 (Additional Tests: KF, PrtCount)

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

BLACKHAWK EQUIPMENT
 5295 VIVION ST
 ARVADA, CO
 US 80002
 Contact: ROB BAINNSON
 rb@blackhawkequipment.com
 T: (303)421-3000
 F: