


Machine Id **RO 91204** Component **Center Left Genset** Fluid **MOBIL 1 FORMULA 10W30 (2 QTS)**

RECOMMENDATION	Test	UOM	Method	Limit/Abn	Current	History1	History2
Resample at the next service interval to monitor.	Sample Number	00101	Client Info		WC0824079		
	Sample Date		Client Info		07 Jun 2024		
	Machine Age	hrs	Client Info		19		
	Oil Age	hrs	Client Info		0		
	Filter Age	hrs	Client Info		0		
	Oil Changed		Client Info		N/A		
	Filter Changed		Client Info		N/A		
	Sample Status		0.00.00.00		NORMAL		
WEAR All component wear rates are normal.	Iron	ppm	ASTM D5185m	>50	<1		
	Chromium	ppm	ASTM D5185m	>4	0		
	Nickel	ppm	ASTM D5185m	>2	0		
	Titanium	ppm	ASTM D5185m		0		
	Silver	ppm	ASTM D5185m	>5	0		
	Aluminum	ppm	ASTM D5185m	>12	1		
	Lead	ppm	ASTM D5185m	>17	0		
	Copper	ppm	ASTM D5185m	>70	1		
	Tin	ppm	ASTM D5185m	>15	0		
	Vanadium	ppm	ASTM D5185m		0		
	White Metal	scalar	*Visual	NONE	NONE		
	Yellow Metal	scalar	*Visual	NONE	NONE		
CONTAMINATION	Silicon	ppm	ASTM D5185m	>25	14		
	Potassium	ppm	ASTM D5185m		2		
There is no indication of any contamination in the oil.	Fuel	PP	WC Method		- <1.0		
	Water		WC Method		NEG		
	Glycol		WC Method		NEG		
	Soot %	%	*ASTM D7844		0		
	Nitration	Abs/cm	*ASTM D7624	>20	5.8		
	Sulfation	Abs/.1mm	*ASTM D7415	>30	16.7		
	Silt	scalar	*Visual	NONE	NONE		
	Debris	scalar	*Visual	NONE	NONE		
	Sand/Dirt	scalar	*Visual	NONE	NONE		
	Appearance	scalar	*Visual	NORML	NORML		
	Odor	scalar	*Visual	NORML	NORML		
	Emulsified Water	scalar	*Visual	>0.1	NEG		
FLUID CONDITION	Sodium		ASTM D5185m		8		
LOID CONDITION	Boron	ppm	ASTM D5185m		7		
The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.	Barium	ppm ppm	ASTM D5185m		0		
	Molybdenum	ppm	ASTM D5185m		50		
	Manganese	ppm	ASTM D5185m				
	Magnesium	ppm	ASTM D5185m		873		
	Calcium	ppm	ASTM D5185m		1030		
	Phosphorus		ASTM D5185m		962		
	Zinc	ppm	ASTM D5185m		962 1173		
	Sulfur	ppm	ASTM D5185m		3413		
	Oxidation	ppm Abs/.1mm	*ASTM D5185111	>25	13.9		
	Base Number (BN)			>20			
	Dase Number (BN)	ing KOH/g	ASTIVI D2896		10.5		

Visc @ 100°C cSt

ASTM D445 10.0

13.6

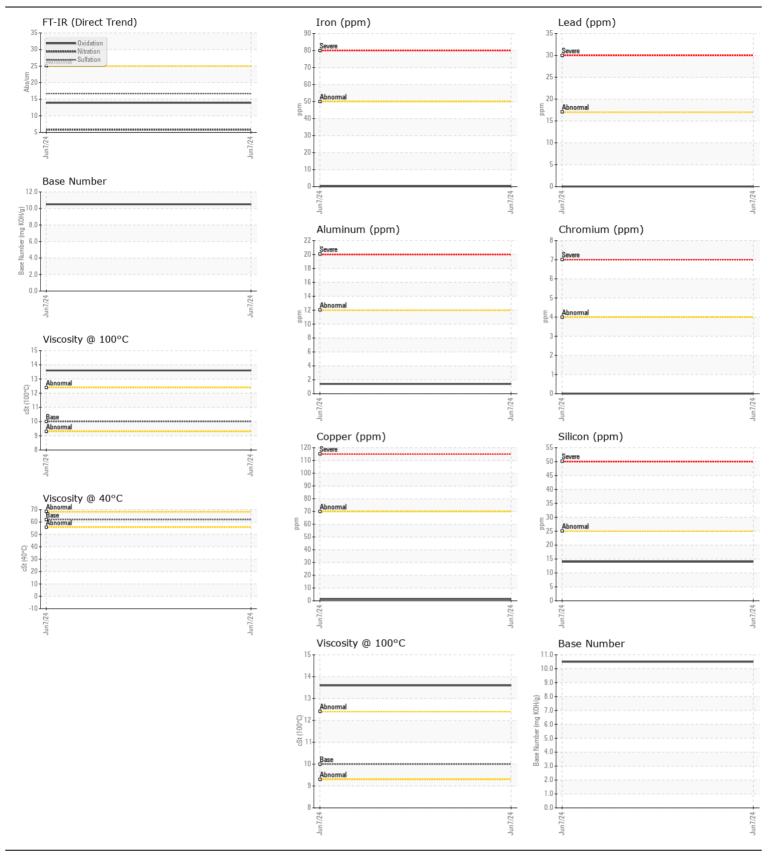

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513 **ATEL BUS & TRUCK** Sample No. : WC0824079 Received 12120 CONWAY RD : 01 Jul 2024 Lab Number : 06225469 Tested : 03 Jul 2024 BELTSVILLE, MD Unique Number : 11103666 Diagnosed : 03 Jul 2024 - Jonathan Hester US 20705 Test Package : MOB 1 (Additional Tests: KV40, TBN) Contact: OSCAR ROMERO Certificate L2367 To discuss this sample report, contact Customer Service at 1-800-237-1369. oromero@atelbus.com * - Denotes test methods that are outside of the ISO 17025 scope of accreditation. T: Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012) F:

Contact/Location: OSCAR ROMERO - ATEBEL Page 2 of 2