



Machine Id
[] NOT GIVEN MW0053432 MW 0053432
 Component
Port Genset
 Fluid
{not provided} (--- GAL)

RECOMMENDATION

Resample at the next service interval to monitor. Please specify the brand, type, and viscosity of the oil on your next sample.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		MW0053432	---	---
Sample Date		Client Info		01 Jul 2024	---	---
Machine Age	hrs	Client Info		0	---	---
Oil Age	hrs	Client Info		0	---	---
Filter Age	hrs	Client Info		0	---	---
Oil Changed		Client Info		N/A	---	---
Filter Changed		Client Info		N/A	---	---
Sample Status				NORMAL	---	---

WEAR

All component wear rates are normal.

Iron	ppm	ASTM D5185m	>50	3	---	---
Chromium	ppm	ASTM D5185m	>4	<1	---	---
Nickel	ppm	ASTM D5185m	>2	<1	---	---
Titanium	ppm	ASTM D5185m		<1	---	---
Silver	ppm	ASTM D5185m	>5	<1	---	---
Aluminum	ppm	ASTM D5185m	>12	3	---	---
Lead	ppm	ASTM D5185m	>17	<1	---	---
Copper	ppm	ASTM D5185m	>70	<1	---	---
Tin	ppm	ASTM D5185m	>15	<1	---	---
Vanadium	ppm	ASTM D5185m		<1	---	---
White Metal	scalar	*Visual	NONE	NONE	---	---
Yellow Metal	scalar	*Visual	NONE	NONE	---	---

CONTAMINATION








There is no indication of any contamination in the oil.

Silicon	ppm	ASTM D5185m	>25	4	---	---
Potassium	ppm	ASTM D5185m	>20	6	---	---
Fuel		WC Method	>4.0	<1.0	---	---
Water		WC Method	>0.1	NEG	---	---
Glycol		WC Method		NEG	---	---
Soot %	%	*ASTM D7844		0.1	---	---
Nitration	Abs/cm	*ASTM D7624	>20	6.9	---	---
Sulfation	Abs/.1mm	*ASTM D7415	>30	20.4	---	---
Silt	scalar	*Visual	NONE	NONE	---	---
Debris	scalar	*Visual	NONE	NONE	---	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---	---
Appearance	scalar	*Visual	NORML	NORML	---	---
Odor	scalar	*Visual	NORML	NORML	---	---
Emulsified Water	scalar	*Visual	>0.1	NEG	---	---

FLUID CONDITION

The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.

Sodium	ppm	ASTM D5185m		0	---	---
Boron	ppm	ASTM D5185m		213	---	---
Barium	ppm	ASTM D5185m		<1	---	---
Molybdenum	ppm	ASTM D5185m		50	---	---
Manganese	ppm	ASTM D5185m		0	---	---
Magnesium	ppm	ASTM D5185m		226	---	---
Calcium	ppm	ASTM D5185m		1899	---	---
Phosphorus	ppm	ASTM D5185m		905	---	---
Zinc	ppm	ASTM D5185m		1070	---	---
Sulfur	ppm	ASTM D5185m		2825	---	---
Oxidation	Abs/.1mm	*ASTM D7414	>25	15.9	---	---
Base Number (BN)	mg KOH/g	ASTM D2896		7.5	---	---
Visc @ 100°C	cSt	ASTM D445		13.3	---	---

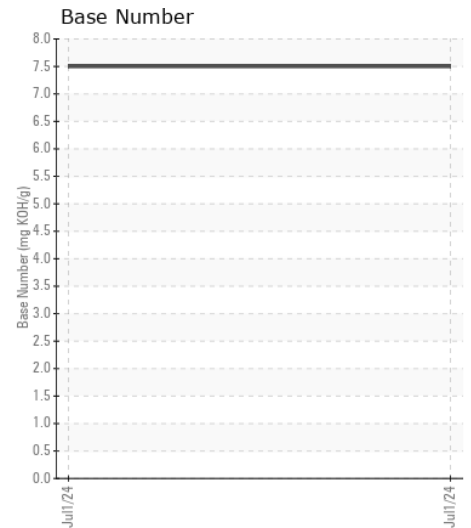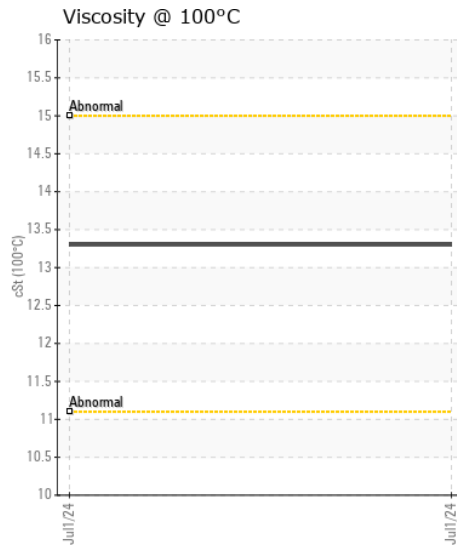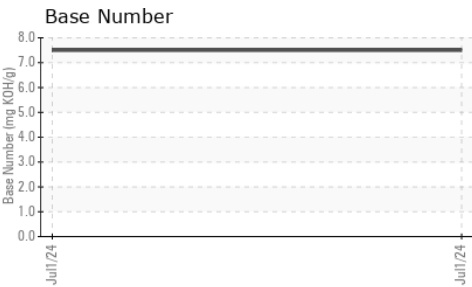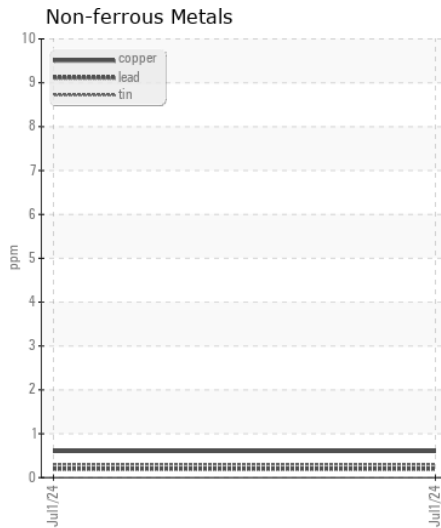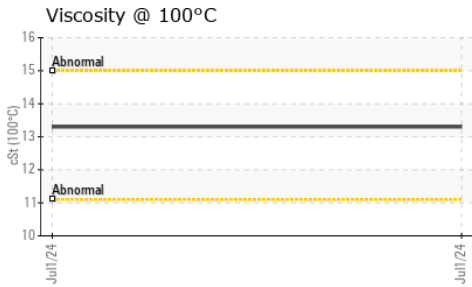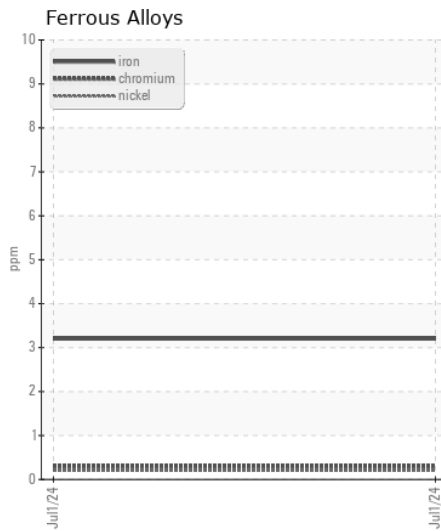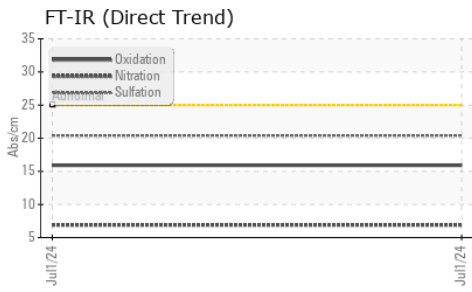

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513

Sample No. : MW0053432

Lab Number : 06226078

Unique Number : 11109571

Test Package : MAR 2

Received : 02 Jul 2024

Tested : 08 Jul 2024

Diagnosed : 08 Jul 2024 - Sean Felton

INGRAM BARGE

900 S 3RD ST

PADUCAH, KY

US 42003

Contact: ANTHONY VAN CURA

anthony.vancura@ingrambarga.com

T: (270)415-4467

F: (615)695-3697

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)