



OIL ANALYSIS REPORT

WEAR	NORMAL
CONTAMINATION	ABNORMAL
FLUID CONDITION	NORMAL

Machine Id
C586 HSP5 PUMP 2
 Component
Hydraulic System
 Fluid
AW HYDRAULIC OIL ISO 68 (--- GAL)

RECOMMENDATION

We recommend you service the filters on this component. Resample at the next service interval to monitor.

WEAR

All component wear rates are normal.










CONTAMINATION

There is a high amount of particulates present in the oil. The system cleanliness is above the acceptable limit for the target ISO 4406 cleanliness code.

FLUID CONDITION

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		FC006228	FC007431	FC007365
Sample Date		Client Info		27 Jun 2024	12 May 2023	12 May 2022
Machine Age	hrs	Client Info		0	0	0
Oil Age	hrs	Client Info		0	0	0
Filter Age	hrs	Client Info		0	0	0
Oil Changed		Client Info		N/A	N/A	N/A
Filter Changed		Client Info		N/A	N/A	N/A
Sample Status				ABNORMAL	ABNORMAL	ABNORMAL
Iron	ppm	ASTM D5185m	>20	<1	<1	10
Chromium	ppm	ASTM D5185m	>20	0	0	0
Nickel	ppm	ASTM D5185m	>20	0	0	0
Titanium	ppm	ASTM D5185m		<1	0	0
Silver	ppm	ASTM D5185m		0	0	0
Aluminum	ppm	ASTM D5185m	>20	0	0	0
Lead	ppm	ASTM D5185m	>20	0	0	<1
Copper	ppm	ASTM D5185m	>20	1	0	3
Tin	ppm	ASTM D5185m	>20	<1	0	1
Vanadium	ppm	ASTM D5185m		0	0	0
White Metal	scalar	*Visual	NONE	NONE	NONE	LIGHT
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Silicon	ppm	ASTM D5185m	>15	<1	0	2
Potassium	ppm	ASTM D5185m	>20	0	0	<1
Water		WC Method	>0.05	NEG	NEG	NEG
Particles >4µm		ASTM D7647		57388	45565	158901
Particles >6µm		ASTM D7647	>1300	▲ 16016	▲ 7350	▲ 56874
Particles >14µm		ASTM D7647	>80	▲ 537	▲ 129	▲ 736
Particles >21µm		ASTM D7647	>20	▲ 51	17	▲ 27
Particles >38µm		ASTM D7647	>4	1	1	0
Particles >71µm		ASTM D7647	>3	0	0	0
Oil Cleanliness		ISO 4406 (c)	>-/17/13	▲ 23/21/16	▲ 23/20/14	▲ 24/23/17
Silt	scalar	*Visual	NONE	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE	VLITE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG	NEG
Sodium	ppm	ASTM D5185m		2	0	0
Boron	ppm	ASTM D5185m	5	0	0	0
Barium	ppm	ASTM D5185m	5	0	0	2
Molybdenum	ppm	ASTM D5185m	5	0	0	<1
Manganese	ppm	ASTM D5185m		0	0	<1
Magnesium	ppm	ASTM D5185m	25	<1	0	2
Calcium	ppm	ASTM D5185m	200	41	42	73
Phosphorus	ppm	ASTM D5185m	300	334	300	533
Zinc	ppm	ASTM D5185m	370	411	390	715
Sulfur	ppm	ASTM D5185m	2500	902	786	1071
Acid Number (AN)	mg KOH/g	ASTM D8045	0.57	0.39	0.44	0.46
Visc @ 40°C	cSt	ASTM D445	68	57.3	57.8	58.1

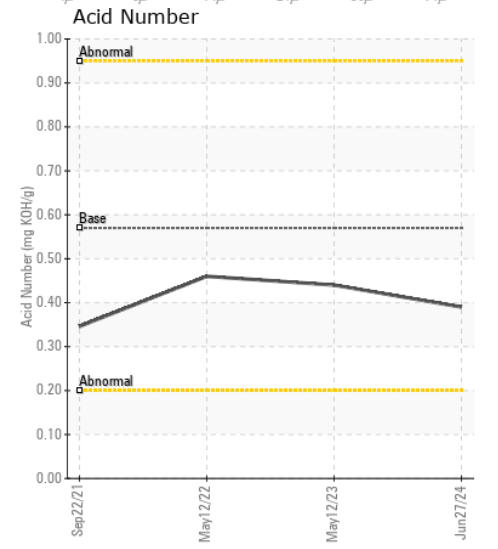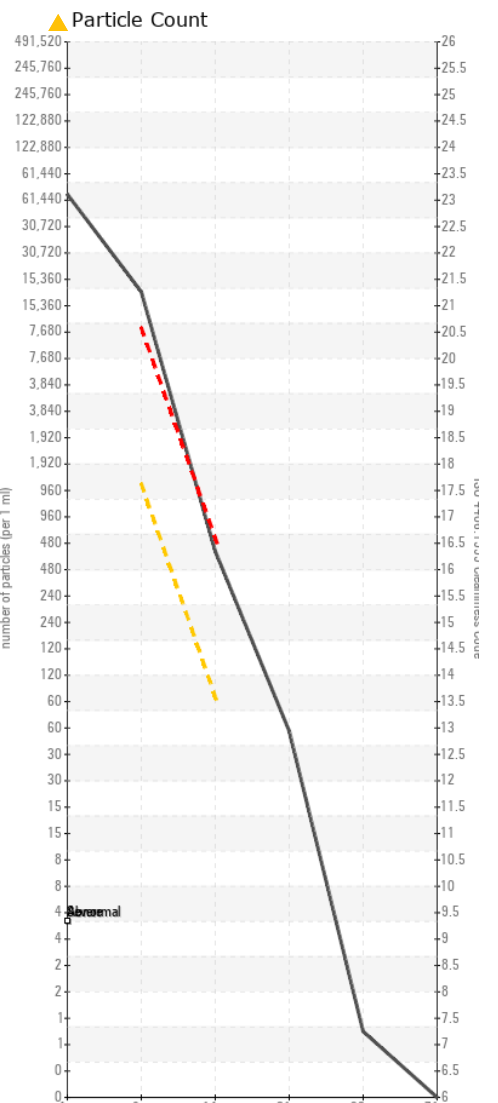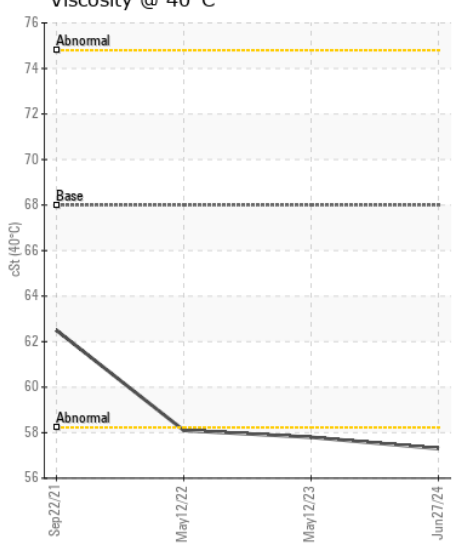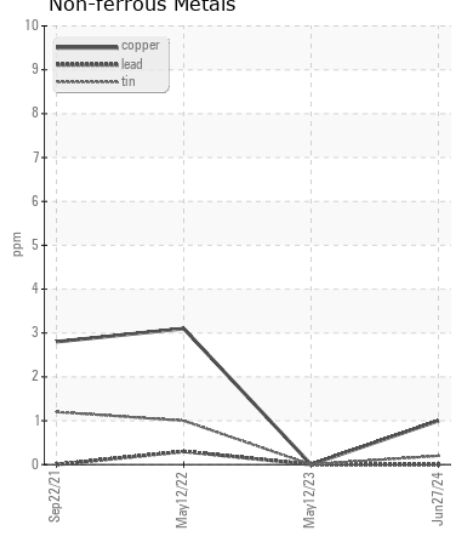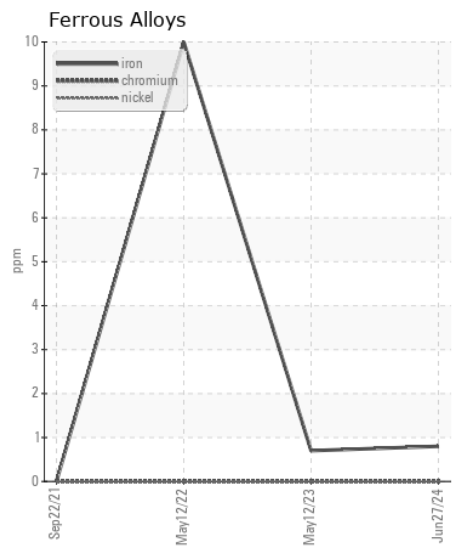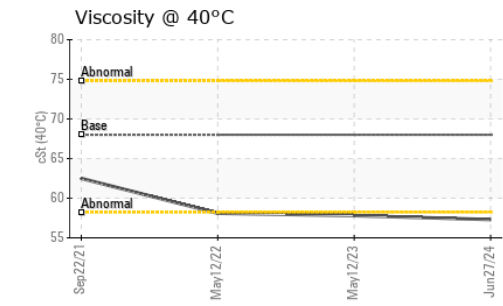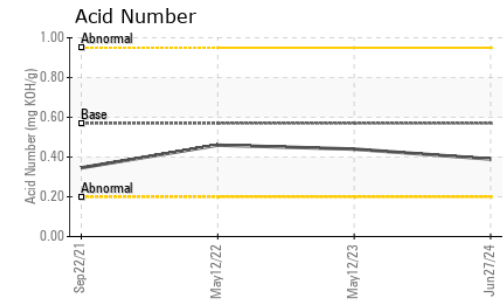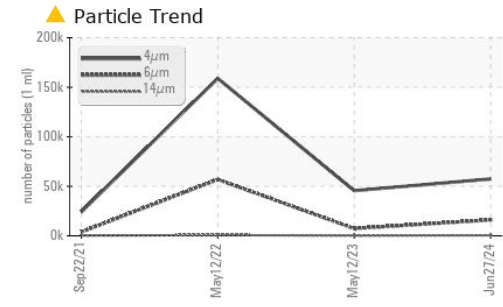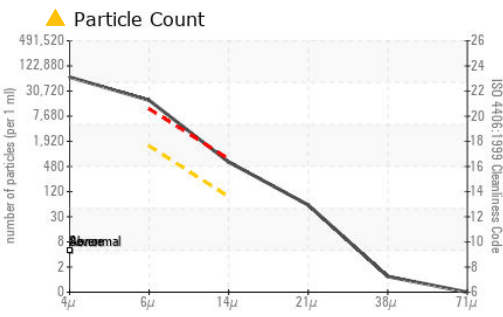

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : FC006228 **Received** : 02 Jul 2024
Lab Number : 06226171 **Tested** : 03 Jul 2024
Unique Number : 11109664 **Diagnosed** : 05 Jul 2024 - Jonathan Hester
Test Package : IND 2

FLUID CONTROL SERVICES, INC.
 1155 ALLGOOD ROAD, SUITE 15
 MARIETTA, GA
 US 30062
 Contact: Duane Smith
 dsmith.fcs@sealsaver.com
 T: (770)509-5833
 F: (770)509-5832

Certificate L2367
 To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)