



OIL ANALYSIS REPORT

WEAR	NORMAL
CONTAMINATION	ABNORMAL
FLUID CONDITION	ABNORMAL

Machine Id
ROSHARON E-1101
 Component
Diesel Engine
 Fluid
{not provided} (--- GAL)

RECOMMENDATION

We recommend that you drain the oil from the component if this has not already been done. We recommend an early resample to monitor this condition. Please specify the component make and model with your next sample. Please specify the brand, type, and viscosity of the oil on your next sample.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		WC0941953	---	---
Sample Date		Client Info		02 Jul 2024	---	---
Machine Age	hrs	Client Info		0	---	---
Oil Age	hrs	Client Info		0	---	---
Filter Age	hrs	Client Info		0	---	---
Oil Changed		Client Info		N/A	---	---
Filter Changed		Client Info		N/A	---	---
Sample Status				ABNORMAL	---	---

WEAR

All component wear rates are normal.

Iron	ppm	ASTM D5185m	>100	13	---	---
Chromium	ppm	ASTM D5185m	>20	<1	---	---
Nickel	ppm	ASTM D5185m	>4	0	---	---
Titanium	ppm	ASTM D5185m		0	---	---
Silver	ppm	ASTM D5185m	>3	0	---	---
Aluminum	ppm	ASTM D5185m	>20	2	---	---
Lead	ppm	ASTM D5185m	>40	<1	---	---
Copper	ppm	ASTM D5185m	>330	2	---	---
Tin	ppm	ASTM D5185m	>15	<1	---	---
Vanadium	ppm	ASTM D5185m		0	---	---
White Metal	scalar	*Visual	NONE	NONE	---	---
Yellow Metal	scalar	*Visual	NONE	NONE	---	---

CONTAMINATION









There is a moderate amount of fuel present in the oil. Tests confirm the presence of fuel in the oil.

Silicon	ppm	ASTM D5185m	>25	2	---	---
Potassium	ppm	ASTM D5185m	>20	5	---	---
Fuel	%	ASTM D3524	>5	▲ 6.9	---	---
Water		WC Method	>0.2	NEG	---	---
Glycol		WC Method		NEG	---	---
Soot %	%	*ASTM D7844	>3	0.4	---	---
Nitration	Abs/cm	*ASTM D7624	>20	8.5	---	---
Sulfation	Abs/.1mm	*ASTM D7415	>30	21.3	---	---
Silt	scalar	*Visual	NONE	NONE	---	---
Debris	scalar	*Visual	NONE	NONE	---	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---	---
Appearance	scalar	*Visual	NORML	NORML	---	---
Odor	scalar	*Visual	NORML	NORML	---	---
Emulsified Water	scalar	*Visual	>0.2	NEG	---	---

FLUID CONDITION

The BN result indicates that there is suitable alkalinity remaining in the oil. Fuel is present in the oil and is lowering the viscosity. The oil is no longer serviceable due to the presence of contaminants.

Sodium	ppm	ASTM D5185m		5	---	---
Boron	ppm	ASTM D5185m		66	---	---
Barium	ppm	ASTM D5185m		0	---	---
Molybdenum	ppm	ASTM D5185m		39	---	---
Manganese	ppm	ASTM D5185m		0	---	---
Magnesium	ppm	ASTM D5185m		239	---	---
Calcium	ppm	ASTM D5185m		1742	---	---
Phosphorus	ppm	ASTM D5185m		899	---	---
Zinc	ppm	ASTM D5185m		1072	---	---
Sulfur	ppm	ASTM D5185m		2882	---	---
Oxidation	Abs/.1mm	*ASTM D7414	>25	17.8	---	---
Base Number (BN)	mg KOH/g	ASTM D2896		5.9	---	---
Visc @ 100°C	cSt	ASTM D445		▲ 11.2	---	---

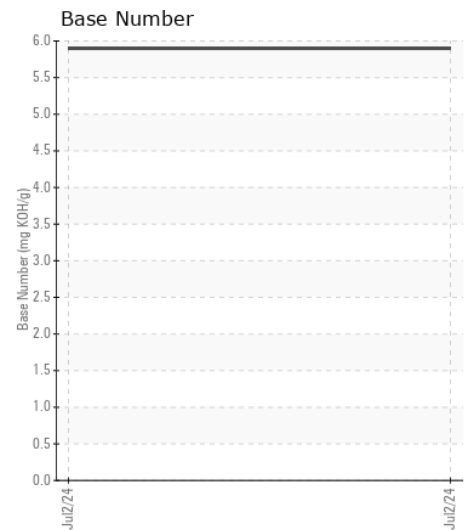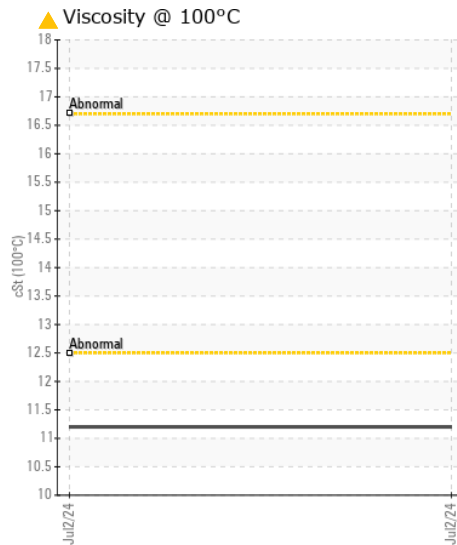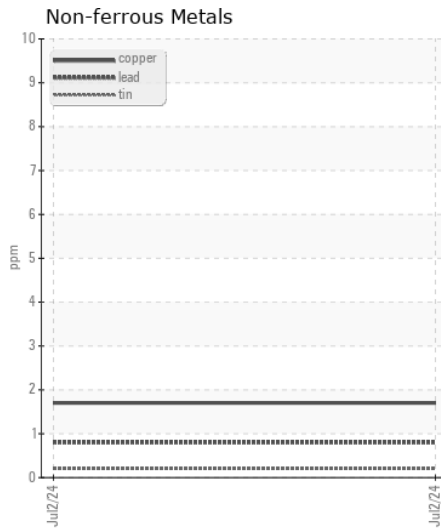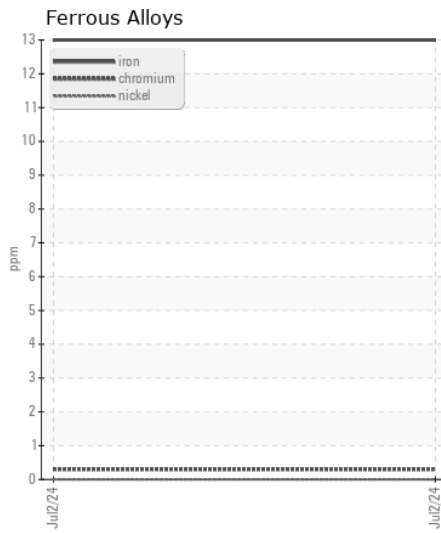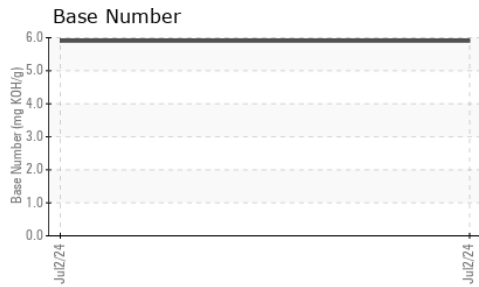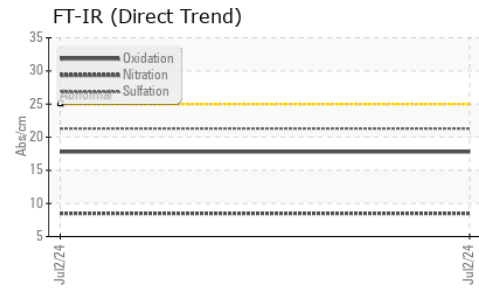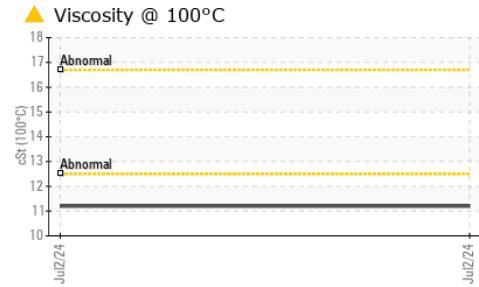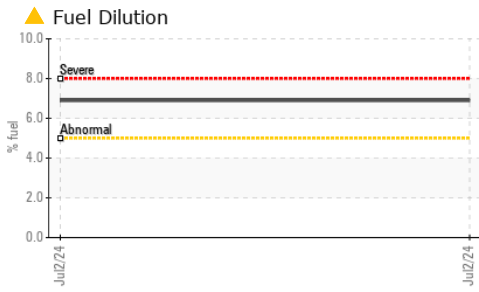

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513

Sample No. : WC0941953

Lab Number : 06226992

Unique Number : 11110485

Test Package : CONST (Additional Tests: FuelDilution, PercentFuel, TBN)

Received : 03 Jul 2024

Tested : 08 Jul 2024

Diagnosed : 08 Jul 2024 - Wes Davis

SIDDONS-MARTIN EMERGENCY GROUP

4401 REX RD

FRIENDSWOOD, TX

US 77546

Contact: DOUGLAS DLOUHY

DDLOUHY@SIDDONS-MARTIN.COM

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:

F: