



**PERFORMANCE
UNDER
PRESSURE**

OIL ANALYSIS REPORT

WEAR	NORMAL
CONTAMINATION	NORMAL
FLUID CONDITION	NORMAL

Machine Id
LOWE_U2120 LOWE_U2120_M2120
Component
Drive End Bearing
Fluid
ROYAL PURPLE SYNFILM GT 32 (--- GAL)

RECOMMENDATION

Resample at the next service interval to monitor.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		RP0029207	RP0029166	RP0024046
Sample Date		Client Info		28 Jun 2024	22 Mar 2024	18 Dec 2023
Machine Age	hrs	Client Info		0	9415	0
Oil Age	hrs	Client Info		0	1500	0
Filter Age	hrs	Client Info		0	1500	0
Oil Changed		Client Info		N/A	Not Changd	N/A
Filter Changed		Client Info		N/A	Changed	N/A
Sample Status				NORMAL	NORMAL	NORMAL

WEAR

All component wear rates are normal.

Iron	ppm	ASTM D5185m	>20	0	0	0
Chromium	ppm	ASTM D5185m	>20	<1	<1	0
Nickel	ppm	ASTM D5185m	>20	0	0	<1
Titanium	ppm	ASTM D5185m		0	0	0
Silver	ppm	ASTM D5185m		0	0	0
Aluminum	ppm	ASTM D5185m	>20	2	<1	<1
Lead	ppm	ASTM D5185m	>20	<1	0	<1
Copper	ppm	ASTM D5185m	>20	12	12	13
Tin	ppm	ASTM D5185m	>20	0	<1	<1
Vanadium	ppm	ASTM D5185m		0	0	0
White Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE

CONTAMINATION








The water content is negligible. There is no indication of any contamination in the oil.

Silicon	ppm	ASTM D5185m	>15	<1	0	<1
Potassium	ppm	ASTM D5185m	>20	<1	1	1
Water	%	ASTM D6304	>0.05	0.045	0.018	0.022
ppm Water	ppm	ASTM D6304	>500	452	186	228
Silt	scalar	*Visual	NONE	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE	LIGHT
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG	NEG

FLUID CONDITION

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

Sodium	ppm	ASTM D5185m		0	1	<1
Boron	ppm	ASTM D5185m		0	0	0
Barium	ppm	ASTM D5185m		0	0	0
Molybdenum	ppm	ASTM D5185m		0	0	0
Manganese	ppm	ASTM D5185m		0	<1	<1
Magnesium	ppm	ASTM D5185m		89	98	103
Calcium	ppm	ASTM D5185m		0	5	5
Phosphorus	ppm	ASTM D5185m		<1	0	2
Zinc	ppm	ASTM D5185m		0	0	0
Acid Number (AN)	mg KOH/g	ASTM D8045		0.36	0.49	0.34
Visc @ 40°C	cSt	ASTM D445	32	33.5	33.6	33.7

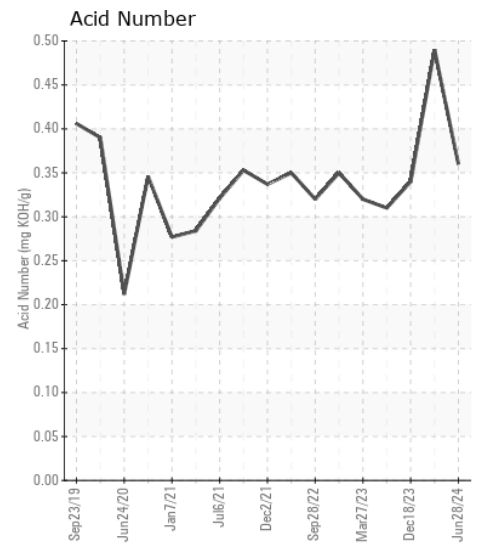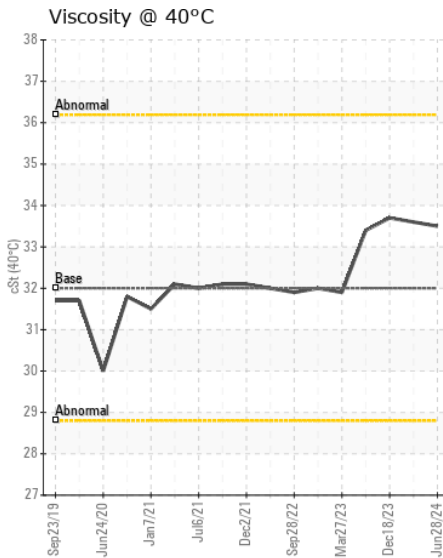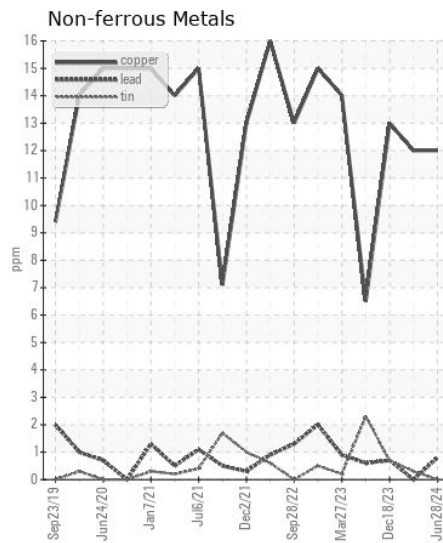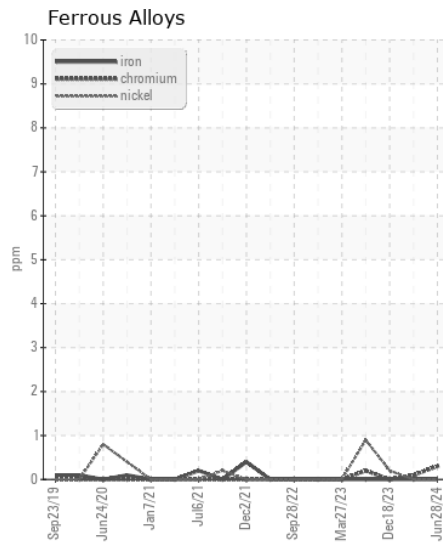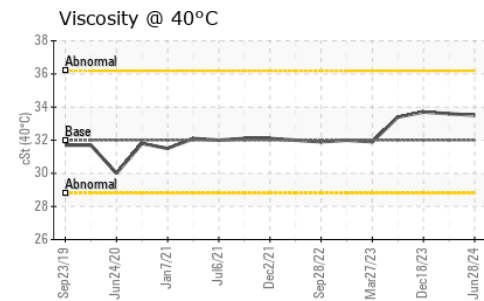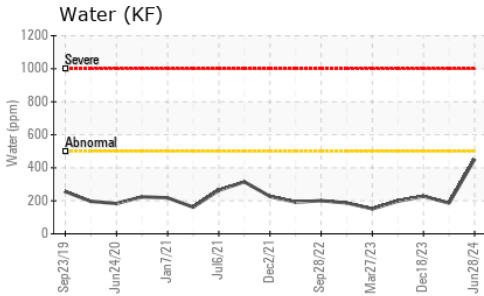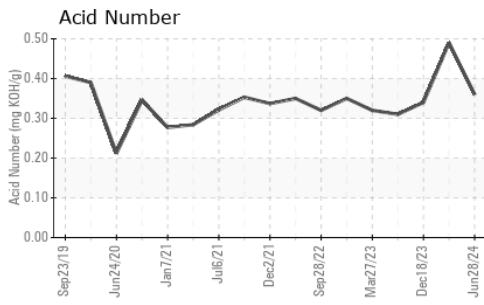

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : RP0029207
Lab Number : 06227527
Unique Number : 11111020
Test Package : PLANT
Received : 03 Jul 2024
Tested : 06 Jul 2024
Diagnosed : 06 Jul 2024 - Don Baldrige

ENERGY TRANSFER - LOWELL
 2475 OHIO STATE ROUTE 19
 REPUBLIC, OH
 US 44867
 Contact: EDDIE RIDDLE

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: (419)467-7972

F: