



WEAR	NORMAL
CONTAMINATION	NORMAL
FLUID CONDITION	NORMAL

Area
OH INGRAM
Machine Id
[OH INGRAM] 008 645896-8
Component
Starboard Genset
Fluid
CHEVRON DELO 400 XLE 15W40 (--- GAL)

RECOMMENDATION

Resample at the next service interval to monitor.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		MW0070743	MW0063335	MW0064805
Sample Date		Client Info		29 Jun 2024	24 Apr 2024	14 Jan 2024
Machine Age	hrs	Client Info		33440	32725	32359
Oil Age	hrs	Client Info		337	388	345
Filter Age	hrs	Client Info		0	0	345
Oil Changed		Client Info		N/A	N/A	Changed
Filter Changed		Client Info		N/A	N/A	Changed
Sample Status				NORMAL	NORMAL	NORMAL

WEAR

All component wear rates are normal.

Iron	ppm	ASTM D5185m	>50	11	12	4
Chromium	ppm	ASTM D5185m	>4	<1	<1	0
Nickel	ppm	ASTM D5185m	>2	0	<1	0
Titanium	ppm	ASTM D5185m		3	5	6
Silver	ppm	ASTM D5185m	>5	0	0	0
Aluminum	ppm	ASTM D5185m	>12	2	4	3
Lead	ppm	ASTM D5185m	>17	2	3	6
Copper	ppm	ASTM D5185m	>70	2	<1	0
Tin	ppm	ASTM D5185m	>15	0	<1	0
Vanadium	ppm	ASTM D5185m		0	<1	0
White Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE

CONTAMINATION








There is no indication of any contamination in the oil.

Silicon	ppm	ASTM D5185m	>25	6	11	6
Potassium	ppm	ASTM D5185m	>20	<1	4	0
Fuel		WC Method	>4.0	<1.0	<1.0	<1.0
Water		WC Method	>0.1	NEG	NEG	NEG
Glycol		WC Method		NEG	NEG	NEG
Soot %	%	*ASTM D7844		0.3	0.2	0.2
Nitration	Abs/cm	*ASTM D7624	>20	9.4	9.2	10.5
Sulfation	Abs/.1mm	*ASTM D7415	>30	23.8	23.6	23.9
Silt	scalar	*Visual	NONE	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG	NEG

FLUID CONDITION

The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.

Sodium	ppm	ASTM D5185m		2	0	1
Boron	ppm	ASTM D5185m		216	308	299
Barium	ppm	ASTM D5185m		0	<1	0
Molybdenum	ppm	ASTM D5185m		100	124	113
Manganese	ppm	ASTM D5185m		2	2	1
Magnesium	ppm	ASTM D5185m		626	722	768
Calcium	ppm	ASTM D5185m		1779	1700	1813
Phosphorus	ppm	ASTM D5185m	760	952	775	829
Zinc	ppm	ASTM D5185m	830	1164	951	984
Sulfur	ppm	ASTM D5185m	2770	3504	3163	3235
Oxidation	Abs/.1mm	*ASTM D7414	>25	19.7	19.1	21.4
Base Number (BN)	mg KOH/g	ASTM D2896	10.7	8.0	9.0	8.8
Visc @ 100°C	cSt	ASTM D445	14.9	14.1	13.7	13.8

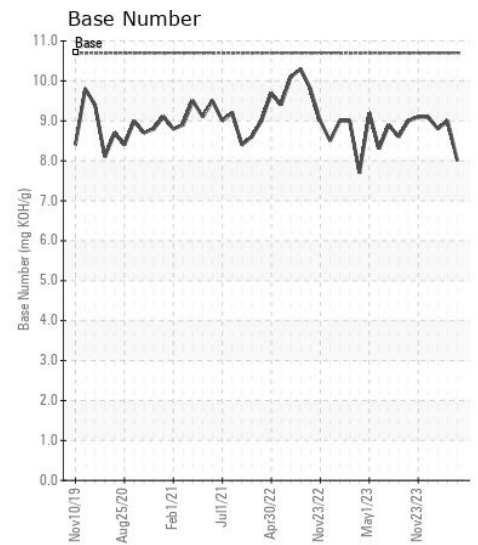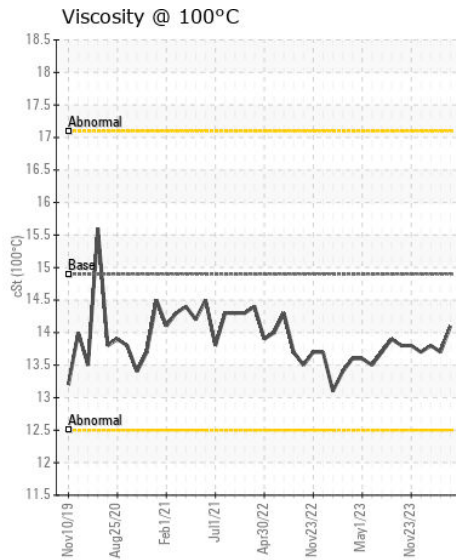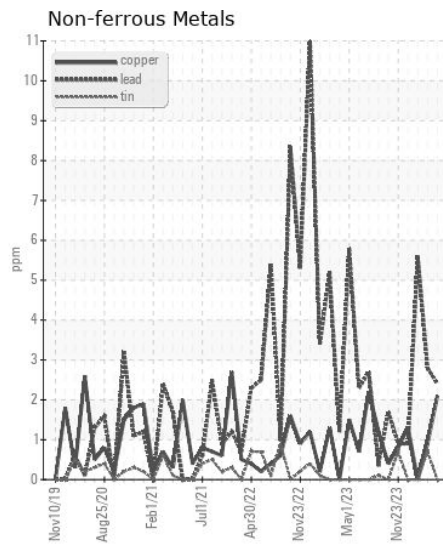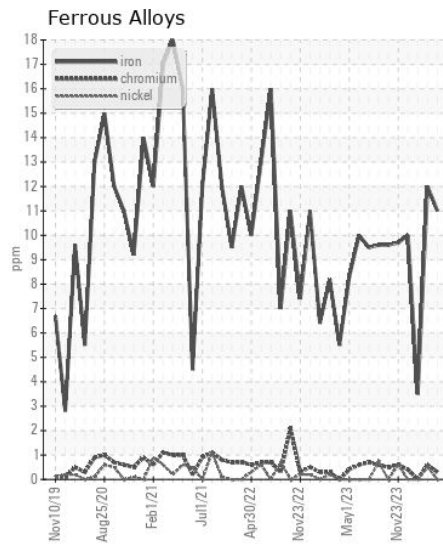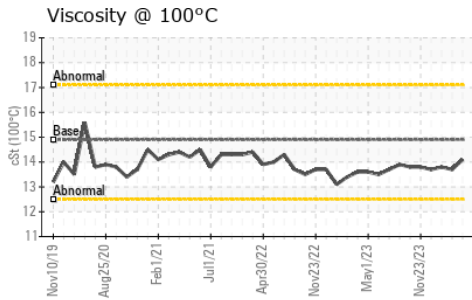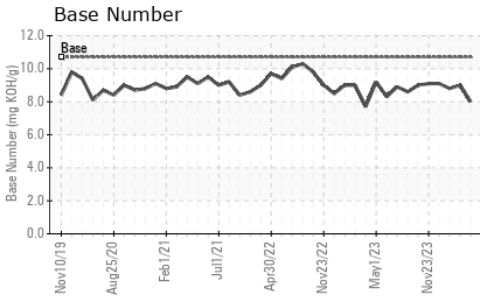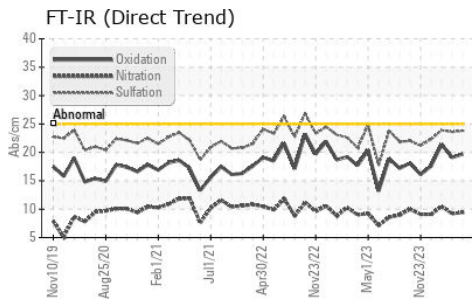

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : MW0070743
Lab Number : 06229429
Unique Number : 11112922
Test Package : MAR 2
Received : 05 Jul 2024
Tested : 09 Jul 2024
Diagnosed : 09 Jul 2024 - Jonathan Hester

INGRAM BARGE
 900 S 3RD ST
 PADUCAH, KY
 US 42003

Contact: ALLEN WILLHELM
 allen.willhelm@ingrambarga.com
 T: (270)415-4467
 F: (615)695-3697

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)