



WEAR	NORMAL
CONTAMINATION	NORMAL
FLUID CONDITION	NORMAL

Area
PALLUBE 32
Machine Id
SULLIVAN PALATEK 1901160002 - RCK COMPONENTS
Component
Compressor

RECOMMENDATION

Resample at the next service interval to monitor.

WEAR

All component wear rates are normal.







CONTAMINATION

There is no indication of any contamination in the oil.

FLUID CONDITION

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		UCS06230216	UCS06111543	---
Sample Date		Client Info		01 Jul 2024	01 Mar 2024	---
Machine Age	hrs	Client Info		46510	8906	---
Oil Age	hrs	Client Info		0	1284	---
Filter Age	hrs	Client Info		0	1284	---
Oil Changed		Client Info		Changed	Not Changed	---
Filter Changed		Client Info		Changed	Changed	---
Sample Status				NORMAL	NORMAL	---
<hr/>						
Iron	ppm	ASTM D5185m	>50	0	1	---
Chromium	ppm	ASTM D5185m	>10	0	<1	---
Nickel	ppm	ASTM D5185m		0	0	---
Titanium	ppm	ASTM D5185m		0	0	---
Silver	ppm	ASTM D5185m		0	0	---
Aluminum	ppm	ASTM D5185m	>25	0	2	---
Lead	ppm	ASTM D5185m	>25	0	0	---
Copper	ppm	ASTM D5185m	>50	0	2	---
Tin	ppm	ASTM D5185m	>15	0	<1	---
Vanadium	ppm	ASTM D5185m		0	<1	---
White Metal	scalar	*Visual	NONE	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	---
<hr/>						
Silicon	ppm	ASTM D5185m	>25	1	<1	---
Potassium	ppm	ASTM D5185m	>20	2	5	---
Water		WC Method	>0.1	NEG	NEG	---
Silt	scalar	*Visual	NONE	NONE	NONE	---
Debris	scalar	*Visual	NONE	LIGHT	NONE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG	---
<hr/>						
Sodium	ppm	ASTM D5185m		23	72	---
Boron	ppm	ASTM D5185m	1	0	0	---
Barium	ppm	ASTM D5185m	730	456	169	---
Molybdenum	ppm	ASTM D5185m	0	0	0	---
Manganese	ppm	ASTM D5185m	0.0	0	0	---
Magnesium	ppm	ASTM D5185m	0	1	<1	---
Calcium	ppm	ASTM D5185m	0	<1	5	---
Phosphorus	ppm	ASTM D5185m	0	8	2	---
Zinc	ppm	ASTM D5185m	0	0	3	---
Sulfur	ppm	ASTM D5185m	590	822	379	---
Acid Number (AN)	mg KOH/g	ASTM D8045	0.14	0.065	0.24	---
Visc @ 40°C	cSt	ASTM D445	42.8	42.4	43.8	---

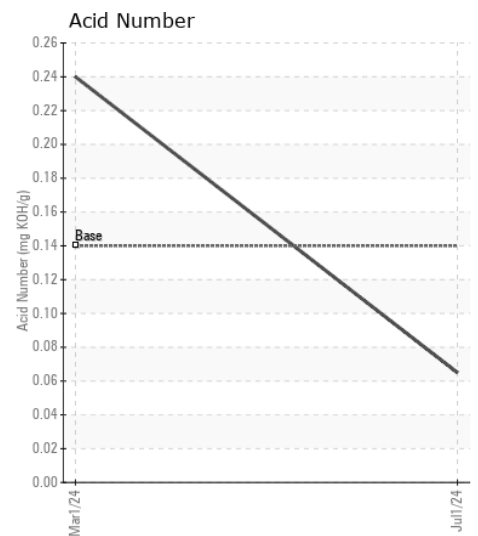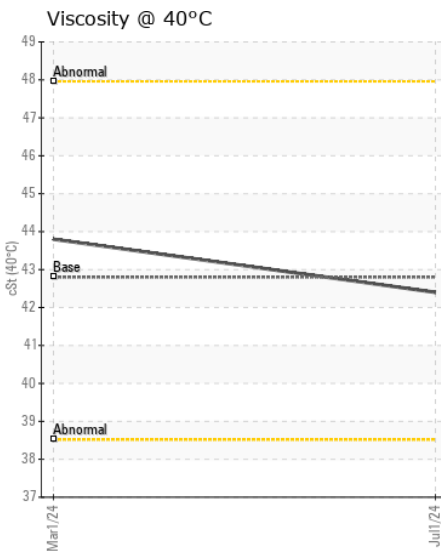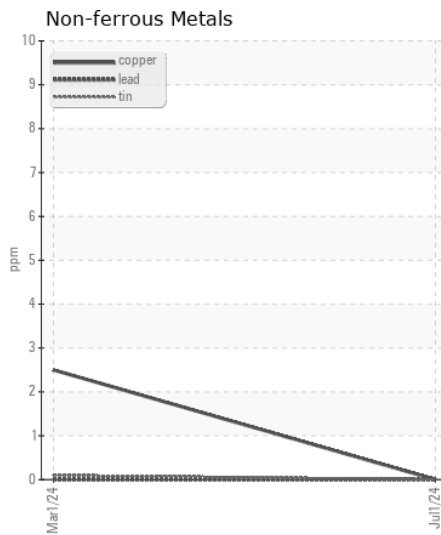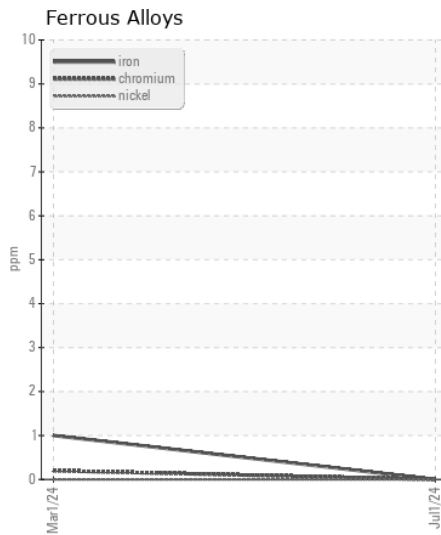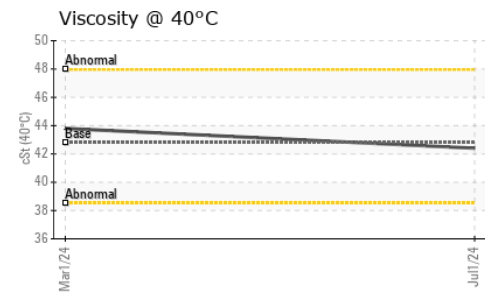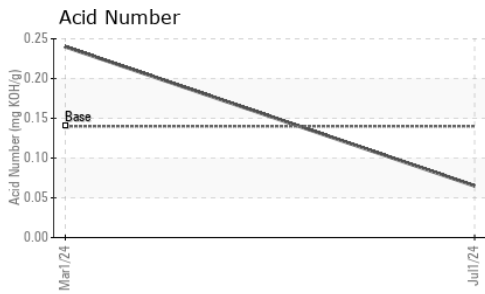

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : UCS06230216
Lab Number : 06230216
Unique Number : 11113709
Test Package : IND 2

Received : 08 Jul 2024
Tested : 09 Jul 2024
Diagnosed : 09 Jul 2024 - Wes Davis

BLAKE AND PENDLETON

MEMPHIS, TN
US 38133

Contact: JAY GIANNINI
JGIANNINI@BLAKEANDPENDLETON.COM

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:
F: