



WEAR	NORMAL
CONTAMINATION	NORMAL
FLUID CONDITION	NORMAL

Area
ROBERT W TAYLOR
Machine Id
[ROBERT W TAYLOR] 008 568680-8
Component
Starboard Genset
Fluid
SHELL ROTELLA T 15W40 (--- GAL)

RECOMMENDATION

Resample at the next service interval to monitor.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		MW0072249	MW0072199	MW0063175
Sample Date		Client Info		02 Jul 2024	03 Jun 2024	02 May 2024
Machine Age	hrs	Client Info		6917	6776	6676
Oil Age	hrs	Client Info		132	252	270
Filter Age	hrs	Client Info		132	252	270
Oil Changed		Client Info		Not Changd	Not Changd	Not Changd
Filter Changed		Client Info		Not Changd	Not Changd	Not Changd
Sample Status				NORMAL	NORMAL	NORMAL

WEAR

All component wear rates are normal.

Iron	ppm	ASTM D5185m	>50	3	4	5
Chromium	ppm	ASTM D5185m	>4	0	<1	<1
Nickel	ppm	ASTM D5185m	>2	0	0	0
Titanium	ppm	ASTM D5185m		0	<1	<1
Silver	ppm	ASTM D5185m	>5	0	0	0
Aluminum	ppm	ASTM D5185m	>12	<1	2	2
Lead	ppm	ASTM D5185m	>17	<1	<1	<1
Copper	ppm	ASTM D5185m	>70	1	4	1
Tin	ppm	ASTM D5185m	>15	0	<1	<1
Vanadium	ppm	ASTM D5185m		0	<1	<1
White Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE

CONTAMINATION








There is no indication of any contamination in the oil.

Silicon	ppm	ASTM D5185m	>25	2	4	4
Potassium	ppm	ASTM D5185m	>20	7	8	10
Fuel		WC Method	>4.0	<1.0	<1.0	<1.0
Water		WC Method	>0.1	NEG	NEG	NEG
Glycol		WC Method		NEG	NEG	NEG
Soot %	%	*ASTM D7844		0.1	0.1	0.1
Nitration	Abs/cm	*ASTM D7624	>20	6.4	7.9	8.1
Sulfation	Abs/.1mm	*ASTM D7415	>30	18.7	19.8	20.5
Silt	scalar	*Visual	NONE	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG	NEG

FLUID CONDITION

The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.

Sodium	ppm	ASTM D5185m		2	0	0
Boron	ppm	ASTM D5185m	316	132	154	170
Barium	ppm	ASTM D5185m	0.0	0	0	1
Molybdenum	ppm	ASTM D5185m	1.2	29	28	10
Manganese	ppm	ASTM D5185m		0	0	<1
Magnesium	ppm	ASTM D5185m	24	77	141	62
Calcium	ppm	ASTM D5185m	2292	2439	1953	2131
Phosphorus	ppm	ASTM D5185m	1064	1046	861	988
Zinc	ppm	ASTM D5185m	1160	1244	1071	1115
Sulfur	ppm	ASTM D5185m	4996	4238	3346	3572
Oxidation	Abs/.1mm	*ASTM D7414	>25	15.1	16.9	18.1
Base Number (BN)	mg KOH/g	ASTM D2896	10.1	7.9	7.5	7.7
Visc @ 100°C	cSt	ASTM D445	15.7	13.5	13.2	13.3

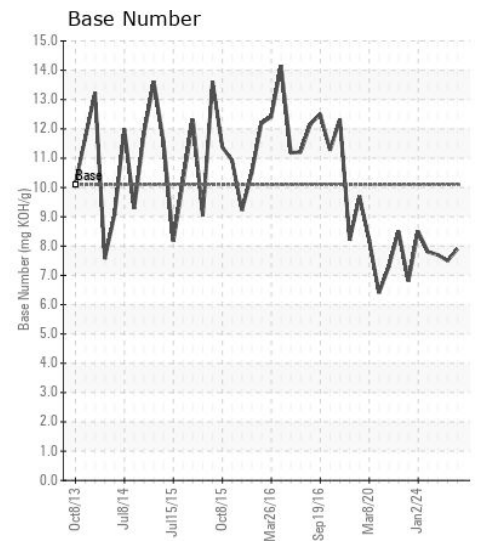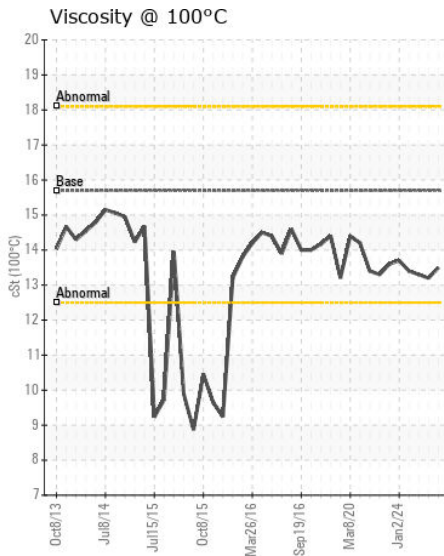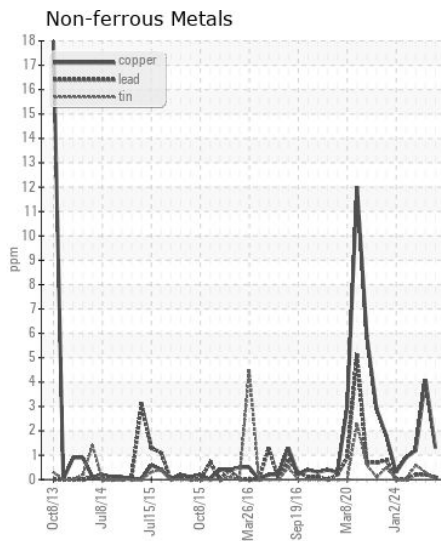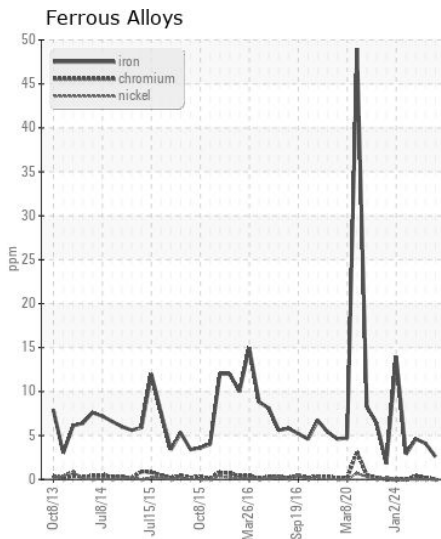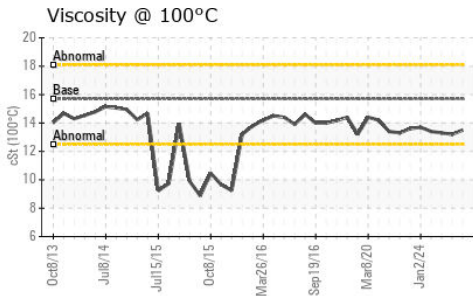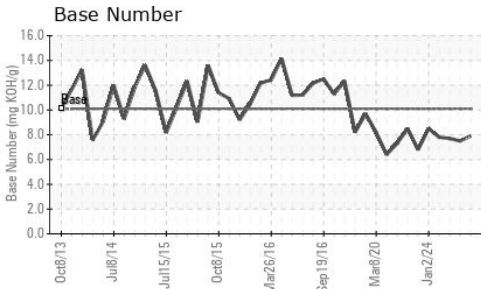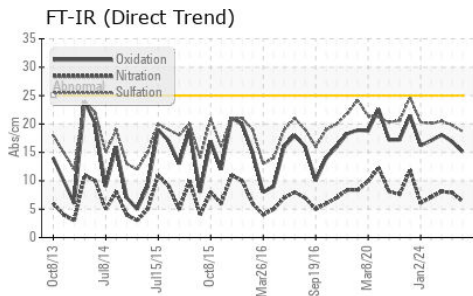

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : MW0072249
Lab Number : 06231138
Unique Number : 11114631
Test Package : MAR 2
Received : 08 Jul 2024
Tested : 10 Jul 2024
Diagnosed : 10 Jul 2024 - Don Baldridge

INGRAM BARGE
 900 S 3RD ST
 PADUCAH, KY
 US 42003

Contact: KEN ELLISON
 ken.ellison@ingrambarge.com
 T: (270)415-4467
 F: (615)695-3697

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)