



WEAR	NORMAL
CONTAMINATION	NORMAL
FLUID CONDITION	NORMAL

Area

ROTO XTEND

Machine Id

ATLAS COPCO AII630737 - WENSMEN SEED

Component

Compressor

RECOMMENDATION

Resample at the next service interval to monitor.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		UCS06231543	UCS05887916	---
Sample Date		Client Info		01 Jul 2024	20 Jun 2023	---
Machine Age	hrs	Client Info		16965	10664	---
Oil Age	hrs	Client Info		301	0	---
Filter Age	hrs	Client Info		301	0	---
Oil Changed		Client Info		Changed	Changed	---
Filter Changed		Client Info		Changed	Changed	---
Sample Status				NORMAL	NORMAL	---

WEAR

All component wear rates are normal.

Iron	ppm	ASTM D5185m	>50	<1	0	---
Chromium	ppm	ASTM D5185m	>5	<1	0	---
Nickel	ppm	ASTM D5185m		<1	0	---
Titanium	ppm	ASTM D5185m		<1	<1	---
Silver	ppm	ASTM D5185m		<1	0	---
Aluminum	ppm	ASTM D5185m	>15	2	<1	---
Lead	ppm	ASTM D5185m	>65	<1	0	---
Copper	ppm	ASTM D5185m	>65	1	0	---
Tin	ppm	ASTM D5185m	>10	<1	0	---
Vanadium	ppm	ASTM D5185m		<1	0	---
White Metal	scalar	*Visual	NONE	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	---

CONTAMINATION







There is no indication of any contamination in the oil.

Silicon	ppm	ASTM D5185m	>35	<1	<1	---
Potassium	ppm	ASTM D5185m	>20	2	0	---
Water		WC Method	>0.1	NEG	NEG	---
Silt	scalar	*Visual	NONE	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	NONE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG	---

FLUID CONDITION

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

Sodium	ppm	ASTM D5185m		3	<1	---
Boron	ppm	ASTM D5185m		0	0	---
Barium	ppm	ASTM D5185m		37	43	---
Molybdenum	ppm	ASTM D5185m		<1	0	---
Manganese	ppm	ASTM D5185m		<1	0	---
Magnesium	ppm	ASTM D5185m		<1	13	---
Calcium	ppm	ASTM D5185m		0	2	---
Phosphorus	ppm	ASTM D5185m		146	165	---
Zinc	ppm	ASTM D5185m		41	28	---
Sulfur	ppm	ASTM D5185m		123	257	---
Acid Number (AN)	mg KOH/g	ASTM D8045	0.14	0.15	0.24	---
Visc @ 40°C	cSt	ASTM D445	46	49.1	44.9	---

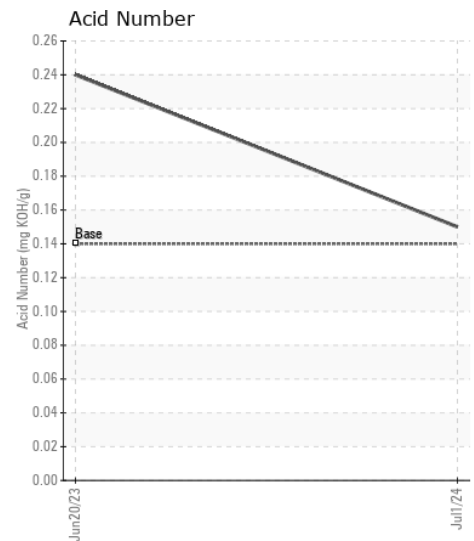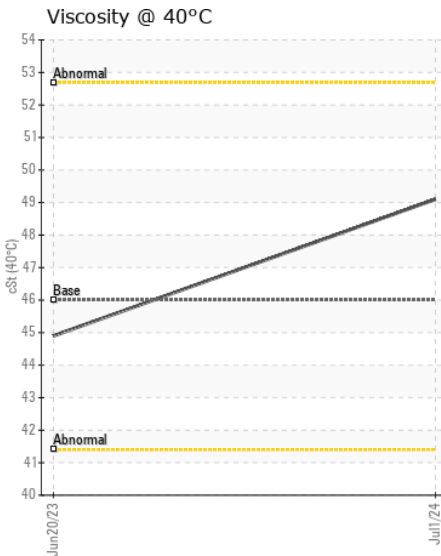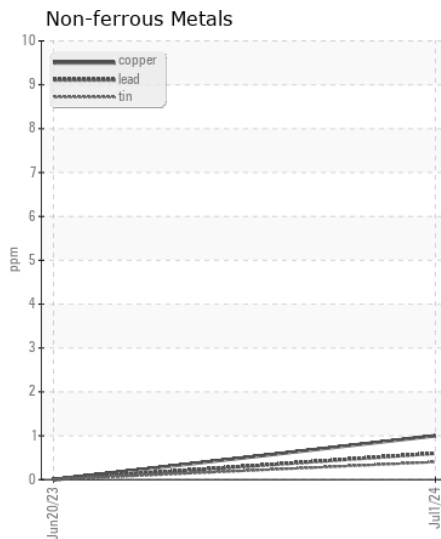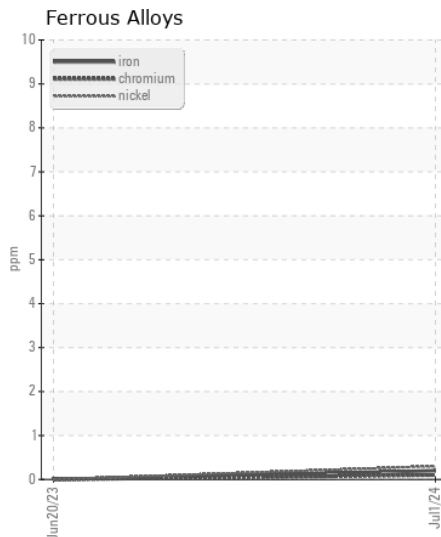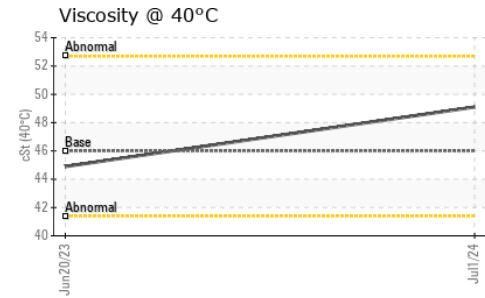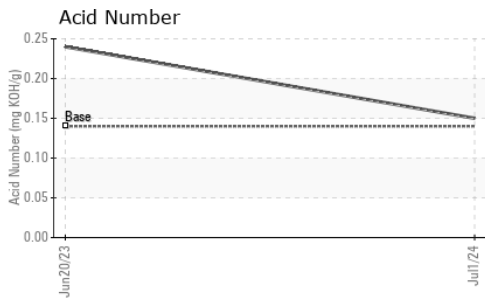

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513

Sample No. : UCS06231543

Lab Number : 06231543

Unique Number : 11115036

Test Package : IND 2

Received : 09 Jul 2024

Tested : 10 Jul 2024

Diagnosed : 10 Jul 2024 - Wes Davis

JEMCO-MAXAIR

WEST FARGO, ND
US 58078

Contact: DALE K
dalek@jemco-maxair.com

T: (701)281-0362

F: x:

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)