



# OIL ANALYSIS REPORT

WEAR	NORMAL
CONTAMINATION	NORMAL
FLUID CONDITION	NORMAL

Area

**DF8**

Machine Id

**KAESER 1037 - PACKAGE CORP OF AMERICA**

Component

**Compressor**

Fluid

**ULTRACHEM OMNILUBE 32/46 (20 GAL)**

## RECOMMENDATION

Resample at the next service interval to monitor.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		WC0924327	---	---
Sample Date		Client Info		29 Jun 2024	---	---
Machine Age	hrs	Client Info		70763	---	---
Oil Age	hrs	Client Info		2996	---	---
Filter Age	hrs	Client Info		2996	---	---
Oil Changed		Client Info		N/A	---	---
Filter Changed		Client Info		Changed	---	---
Sample Status				NORMAL	---	---

## WEAR

All component wear rates are normal.

Iron	ppm	ASTM D5185m	>50	0	---	---
Chromium	ppm	ASTM D5185m	>10	0	---	---
Nickel	ppm	ASTM D5185m	>3	0	---	---
Titanium	ppm	ASTM D5185m	>3	0	---	---
Silver	ppm	ASTM D5185m	>2	0	---	---
Aluminum	ppm	ASTM D5185m	>10	0	---	---
Lead	ppm	ASTM D5185m	>10	0	---	---
Copper	ppm	ASTM D5185m	>50	0	---	---
Tin	ppm	ASTM D5185m	>10	0	---	---
Vanadium	ppm	ASTM D5185m		0	---	---
White Metal	scalar	*Visual	NONE	NONE	---	---
Yellow Metal	scalar	*Visual	NONE	NONE	---	---

## CONTAMINATION







There is no indication of any contamination in the oil.

Silicon	ppm	ASTM D5185m	>25	0	---	---
Potassium	ppm	ASTM D5185m	>20	0	---	---
Water		WC Method	>0.05	NEG	---	---
Silt	scalar	*Visual	NONE	NONE	---	---
Debris	scalar	*Visual	NONE	NONE	---	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---	---
Appearance	scalar	*Visual	NORML	NORML	---	---
Odor	scalar	*Visual	NORML	NORML	---	---
Emulsified Water	scalar	*Visual	>0.05	NEG	---	---

## FLUID CONDITION

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

Sodium	ppm	ASTM D5185m		1	---	---
Boron	ppm	ASTM D5185m	1	0	---	---
Barium	ppm	ASTM D5185m	0.3	<1	---	---
Molybdenum	ppm	ASTM D5185m	0	0	---	---
Manganese	ppm	ASTM D5185m	0	0	---	---
Magnesium	ppm	ASTM D5185m	0	0	---	---
Calcium	ppm	ASTM D5185m	0.5	<1	---	---
Phosphorus	ppm	ASTM D5185m	536	185	---	---
Zinc	ppm	ASTM D5185m	0.2	7	---	---
Sulfur	ppm	ASTM D5185m	649	1036	---	---
Acid Number (AN)	mg KOH/g	ASTM D8045	0.337	0.13	---	---
Visc @ 40°C	cSt	ASTM D445	42.0	43.4	---	---

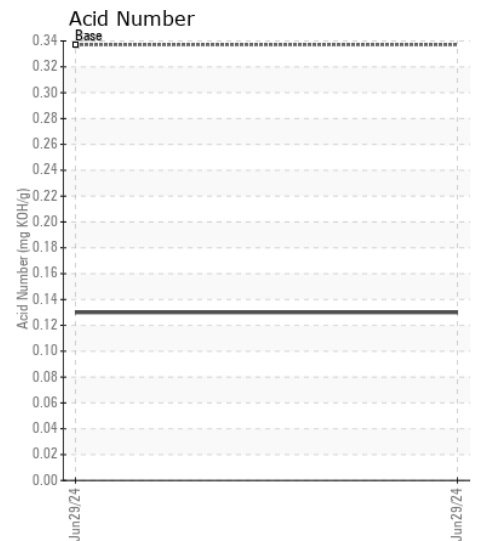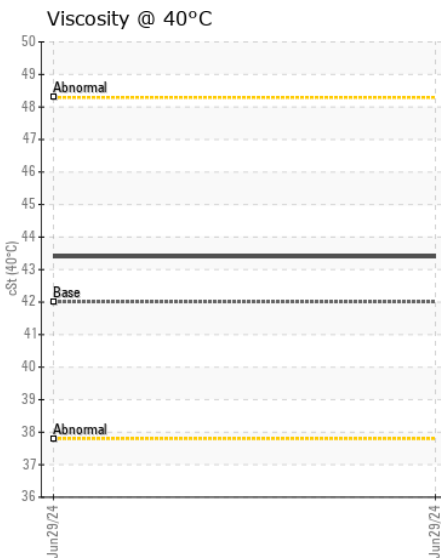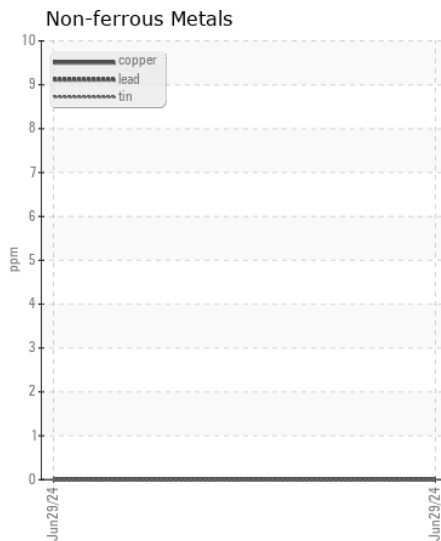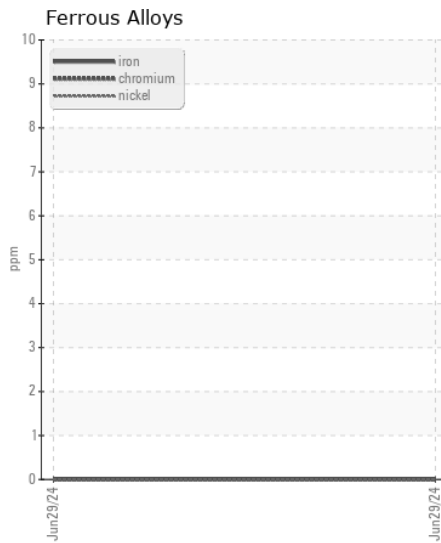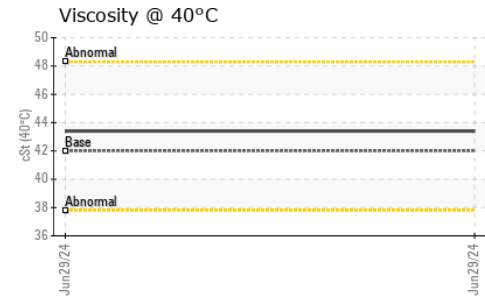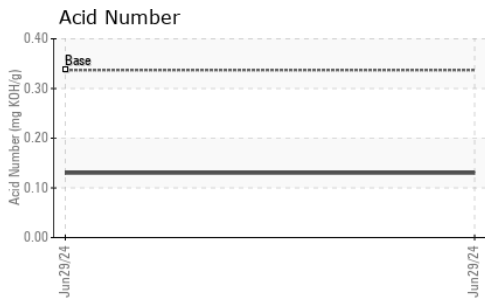

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : WC0924327  
**Lab Number** : 06231569  
**Unique Number** : 11115062  
**Test Package** : IND 2

**Received** : 09 Jul 2024  
**Tested** : 12 Jul 2024  
**Diagnosed** : 12 Jul 2024 - Wes Davis

**DELTA INDUSTRIES - CEDAR RAPIDS**  
 6540 4TH ST SW UNIT A  
 CEDAR RAPIDS, IA  
 US 52404  
 Contact: MICHAEL FERRIS  
 wearcheck@deltaind.net  
 T: (319)862-2500  
 F: (319)862-2501

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)