



OIL ANALYSIS REPORT

| | |
|-----------------|---------------|
| WEAR | NORMAL |
| CONTAMINATION | NORMAL |
| FLUID CONDITION | NORMAL |

Machine Id
55827
 Component
Diesel Engine
 Fluid
DIESEL ENGINE OIL SAE 15W40 (--- GAL)

RECOMMENDATION

Resample at the next service interval to monitor. Please specify the component make and model with your next sample.

| Test | UOM | Method | Limit/Abn | Current | History1 | History2 |
|----------------|-----|-------------|-----------|--------------------|-------------|-------------|
| Sample Number | | Client Info | | DC0036305 | DC0036005 | DC0031795 |
| Sample Date | | Client Info | | 27 Jun 2024 | 10 May 2024 | 08 Nov 2023 |
| Machine Age | hrs | Client Info | | 1047 | 913 | 687 |
| Oil Age | hrs | Client Info | | 150 | 200 | 250 |
| Filter Age | hrs | Client Info | | 0 | 200 | 250 |
| Oil Changed | | Client Info | | Changed | Changed | Changed |
| Filter Changed | | Client Info | | Changed | Changed | Changed |
| Sample Status | | | | NORMAL | NORMAL | NORMAL |

WEAR

All component wear rates are normal.

| | | | | | | |
|--------------|--------|-------------|------|--------------|------|------|
| Iron | ppm | ASTM D5185m | >100 | 5 | 5 | 4 |
| Chromium | ppm | ASTM D5185m | >20 | <1 | 0 | <1 |
| Nickel | ppm | ASTM D5185m | >4 | <1 | <1 | 0 |
| Titanium | ppm | ASTM D5185m | | <1 | 0 | 0 |
| Silver | ppm | ASTM D5185m | >3 | 0 | 0 | 0 |
| Aluminum | ppm | ASTM D5185m | >20 | 2 | 1 | 1 |
| Lead | ppm | ASTM D5185m | >40 | <1 | 0 | 0 |
| Copper | ppm | ASTM D5185m | >330 | 2 | 3 | 5 |
| Tin | ppm | ASTM D5185m | >15 | <1 | <1 | 0 |
| Vanadium | ppm | ASTM D5185m | | <1 | 0 | 0 |
| White Metal | scalar | *Visual | NONE | NONE | NONE | NONE |
| Yellow Metal | scalar | *Visual | NONE | NONE | NONE | NONE |

CONTAMINATION












There is no indication of any contamination in the oil.

| | | | | | | |
|------------------|----------|-------------|-------|----------------|-------|-------|
| Silicon | ppm | ASTM D5185m | >25 | 4 | 4 | 4 |
| Potassium | ppm | ASTM D5185m | >20 | 3 | 3 | 1 |
| Fuel | | WC Method | >5 | <1.0 | <1.0 | <1.0 |
| Water | | WC Method | >0.2 | NEG | NEG | NEG |
| Glycol | | WC Method | | NEG | NEG | NEG |
| Soot % | % | *ASTM D7844 | >3 | 0.1 | 0.1 | 0.1 |
| Nitration | Abs/cm | *ASTM D7624 | >20 | 6.8 | 7.2 | 7.2 |
| Sulfation | Abs/.1mm | *ASTM D7415 | >30 | 16.5 | 17.0 | 17.4 |
| Silt | scalar | *Visual | NONE | NONE | NONE | NONE |
| Debris | scalar | *Visual | NONE | NONE | NONE | NONE |
| Sand/Dirt | scalar | *Visual | NONE | NONE | NONE | NONE |
| Appearance | scalar | *Visual | NORML | NORML | NORML | NORML |
| Odor | scalar | *Visual | NORML | NORML | NORML | NORML |
| Emulsified Water | scalar | *Visual | >0.2 | NEG | NEG | NEG |

FLUID CONDITION

The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.

| | | | | | | |
|------------------|----------|-------------|------|--------------|------|------|
| Sodium | ppm | ASTM D5185m | >158 | 2 | 1 | 1 |
| Boron | ppm | ASTM D5185m | 250 | 3 | 2 | 2 |
| Barium | ppm | ASTM D5185m | 10 | 0 | 0 | 0 |
| Molybdenum | ppm | ASTM D5185m | 100 | 3 | 2 | 1 |
| Manganese | ppm | ASTM D5185m | | <1 | <1 | <1 |
| Magnesium | ppm | ASTM D5185m | 450 | 42 | 54 | 51 |
| Calcium | ppm | ASTM D5185m | 3000 | 2276 | 2399 | 2356 |
| Phosphorus | ppm | ASTM D5185m | 1150 | 869 | 952 | 953 |
| Zinc | ppm | ASTM D5185m | 1350 | 1052 | 1107 | 1145 |
| Sulfur | ppm | ASTM D5185m | 4250 | 3728 | 4261 | 3835 |
| Oxidation | Abs/.1mm | *ASTM D7414 | >25 | 10.0 | 10.2 | 10.6 |
| Base Number (BN) | mg KOH/g | ASTM D2896 | 8.5 | 7.0 | 7.1 | 6.8 |
| Visc @ 100°C | cSt | ASTM D445 | 14.4 | 13.5 | 13.7 | 13.7 |

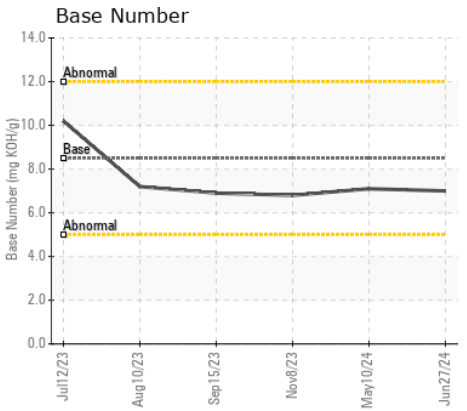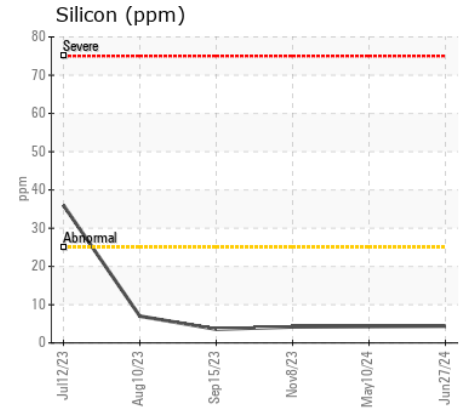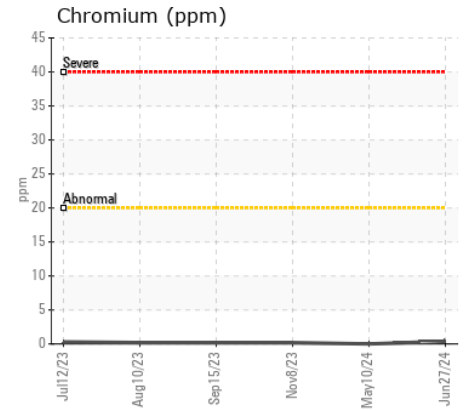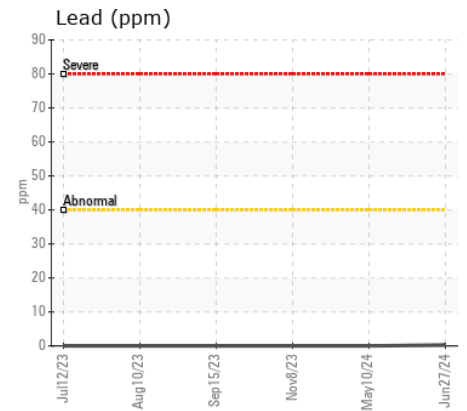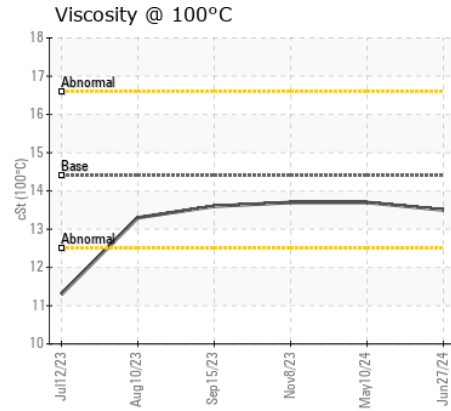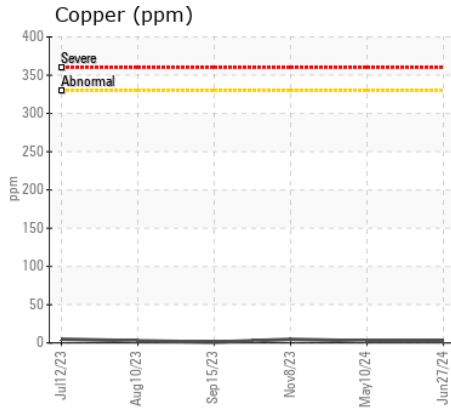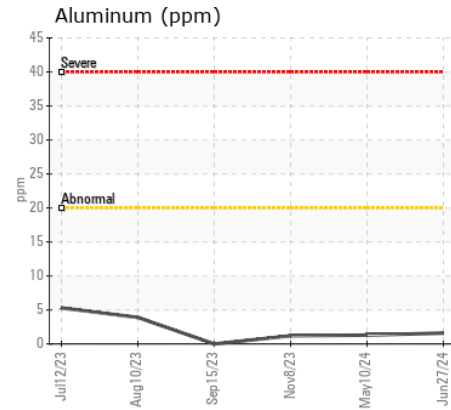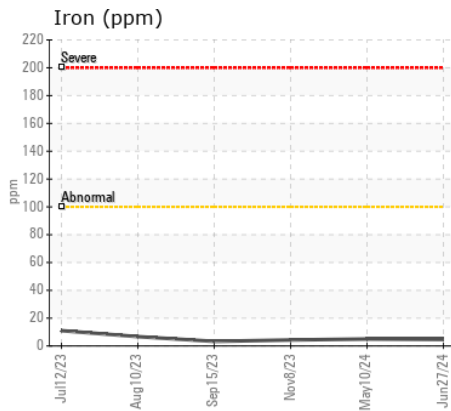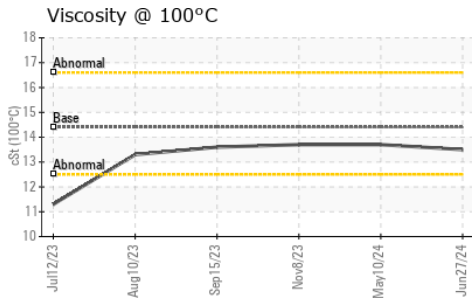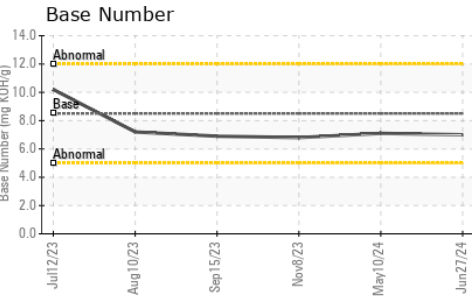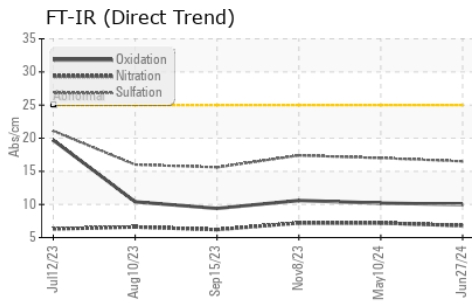

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : DC0036305 **Received** : 10 Jul 2024
Lab Number : 06232106 **Tested** : 11 Jul 2024
Unique Number : 11115599 **Diagnosed** : 11 Jul 2024 - Wes Davis
Test Package : MOB 1 (Additional Tests: TBN)

FRANCIS O DAY
 14900 SOUTHLAWN LN
 ROCKVILLE, MD
 US 20850
 Contact: JAMIE FORESTER

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:
F: