



WEAR	<b>NORMAL</b>
CONTAMINATION	<b>NORMAL</b>
FLUID CONDITION	<b>NORMAL</b>

Area  
**PALASYN 45**  
Machine Id  
**SULLIVAN PALATEK 180919002 - WILSON PALLET NORTH**  
Component  
**Compressor**

### RECOMMENDATION

Resample at the next service interval to monitor.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		<b>UCS06232355</b>	UCS06051066	UCS05618354
Sample Date		Client Info		<b>10 Jul 2024</b>	27 Dec 2023	15 Aug 2022
Machine Age	hrs	Client Info		<b>9210</b>	8049	4759
Oil Age	hrs	Client Info		<b>1000</b>	800	1100
Filter Age	hrs	Client Info		<b>1000</b>	400	1100
Oil Changed		Client Info		<b>Not Changd</b>	Changed	N/A
Filter Changed		Client Info		<b>Changed</b>	Changed	N/A
Sample Status				<b>NORMAL</b>	NORMAL	NORMAL

### WEAR

All component wear rates are normal.

Iron	ppm	ASTM D5185m	>50	<b>&lt;1</b>	0	0
Chromium	ppm	ASTM D5185m	>10	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m		<b>0</b>	0	<1
Titanium	ppm	ASTM D5185m		<b>0</b>	<1	0
Silver	ppm	ASTM D5185m		<b>0</b>	0	<1
Aluminum	ppm	ASTM D5185m	>25	<b>0</b>	0	2
Lead	ppm	ASTM D5185m	>25	<b>0</b>	0	0
Copper	ppm	ASTM D5185m	>50	<b>&lt;1</b>	<1	<1
Tin	ppm	ASTM D5185m	>15	<b>0</b>	<1	<1
Vanadium	ppm	ASTM D5185m		<b>0</b>	<1	0
White Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE

### CONTAMINATION







There is no indication of any contamination in the oil.

Silicon	ppm	ASTM D5185m	>25	<b>1</b>	<1	2
Potassium	ppm	ASTM D5185m	>20	<b>2</b>	0	0
Water		WC Method	>0.1	<b>NEG</b>	NEG	NEG
Silt	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Debris	scalar	*Visual	NONE	<b>NONE</b>	NONE	LIGHT
Sand/Dirt	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Appearance	scalar	*Visual	NORML	<b>NORML</b>	NORML	NORML
Odor	scalar	*Visual	NORML	<b>NORML</b>	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	<b>NEG</b>	NEG	NEG

### FLUID CONDITION

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

Sodium	ppm	ASTM D5185m		<b>1</b>	1	0
Boron	ppm	ASTM D5185m	0.0	<b>0</b>	0	<1
Barium	ppm	ASTM D5185m	0.0	<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m	0	<b>0</b>	0	0
Manganese	ppm	ASTM D5185m	0	<b>0</b>	<1	0
Magnesium	ppm	ASTM D5185m	0.0	<b>&lt;1</b>	0	0
Calcium	ppm	ASTM D5185m	0.0	<b>0</b>	0	0
Phosphorus	ppm	ASTM D5185m	966	<b>283</b>	212	473
Zinc	ppm	ASTM D5185m	0	<b>0</b>	0	0
Sulfur	ppm	ASTM D5185m	1309	<b>1070</b>	310	741
Acid Number (AN)	mg KOH/g	ASTM D8045	0.172	<b>0.064</b>	0.22	0.19
Visc @ 40°C	cSt	ASTM D445	39.9	<b>49.2</b>	48.1	44.2

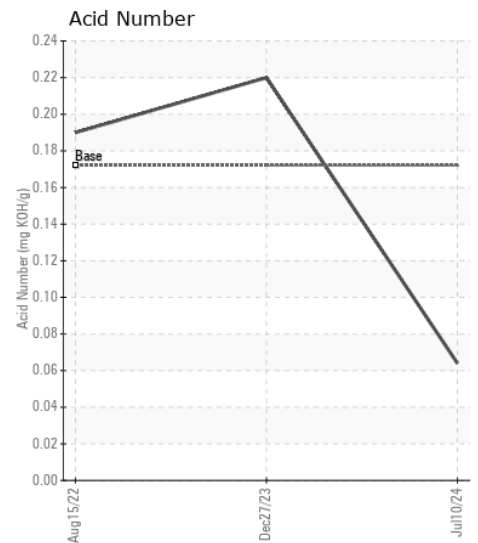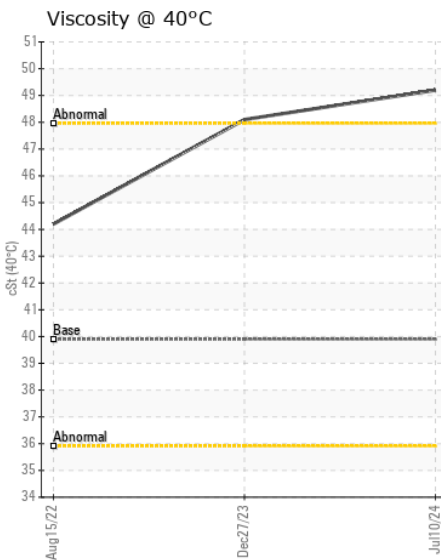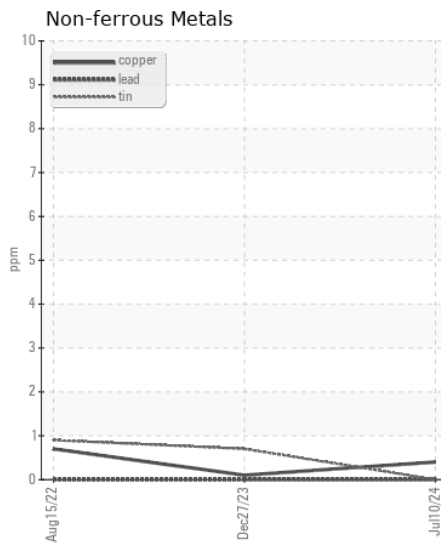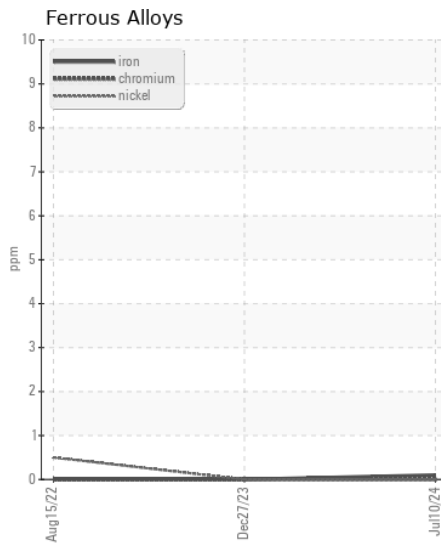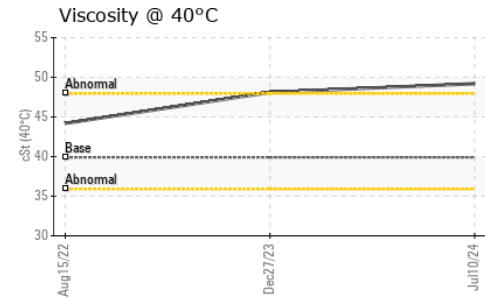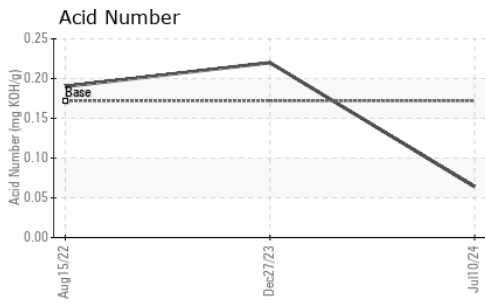

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : UCS06232355 **Received** : 10 Jul 2024  
**Lab Number** : 06232355 **Tested** : 11 Jul 2024  
**Unique Number** : 11115848 **Diagnosed** : 11 Jul 2024 - Sean Felton  
**Test Package** : IND 2

**CENTRAL POWER PRODUCTS**  
 100 N INDUSTRIAL PKWY  
 ARTHUR, IL  
 US 61911  
 Contact: JASON  
 centralpower22@gmail.com  
 T: (217)543-2022  
 F: (217)543-2224

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)