



# OIL ANALYSIS REPORT

WEAR	NORMAL
CONTAMINATION	NORMAL
FLUID CONDITION	NORMAL

Area  
**PLANT PLUS**  
Machine Id  
**1-DRV-1 AF1 - BFP 1A FLUID DRIVE**  
Component  
**Fluid Drive**  
Fluid  
**CHEVRON GST OIL ISO 32 (--- GAL)**

## RECOMMENDATION

Resample at the next service interval to monitor.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		WC0930037	---	---
Sample Date		Client Info		05 Jul 2024	---	---
Machine Age	mls	Client Info		0	---	---
Oil Age	mls	Client Info		0	---	---
Filter Age	mls	Client Info		0	---	---
Oil Changed		Client Info		N/A	---	---
Filter Changed		Client Info		N/A	---	---
Sample Status				NORMAL	---	---

## WEAR

All component wear rates are normal.

PQ		ASTM D8184		13	---	---
Iron	ppm	ASTM D5185m	>100	0	---	---
Chromium	ppm	ASTM D5185m	>10	0	---	---
Nickel	ppm	ASTM D5185m	>10	0	---	---
Titanium	ppm	ASTM D5185m		0	---	---
Silver	ppm	ASTM D5185m		0	---	---
Aluminum	ppm	ASTM D5185m	>25	0	---	---
Lead	ppm	ASTM D5185m	>50	0	---	---
Copper	ppm	ASTM D5185m	>75	0	---	---
Tin	ppm	ASTM D5185m	>10	0	---	---
Vanadium	ppm	ASTM D5185m		0	---	---
White Metal	scalar	*Visual	NONE	NONE	---	---
Yellow Metal	scalar	*Visual	NONE	NONE	---	---

## CONTAMINATION











The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the fluid.

Silicon	ppm	ASTM D5185m	>50	0	---	---
Potassium	ppm	ASTM D5185m	>20	0	---	---
Water	%	ASTM D6304	>0.1	0.002	---	---
ppm Water	ppm	ASTM D6304	>1000	22	---	---
Particles >4µm		ASTM D7647	>10000	1062	---	---
Particles >6µm		ASTM D7647	>2500	292	---	---
Particles >14µm		ASTM D7647	>320	27	---	---
Particles >21µm		ASTM D7647	>80	6	---	---
Particles >38µm		ASTM D7647	>20	0	---	---
Particles >71µm		ASTM D7647	>4	0	---	---
Oil Cleanliness		ISO 4406 (c)	>20/18/15	17/15/12	---	---
Silt	scalar	*Visual	NONE	NONE	---	---
Debris	scalar	*Visual	NONE	NONE	---	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---	---
Appearance	scalar	*Visual	NORML	NORML	---	---
Odor	scalar	*Visual	NORML	NORML	---	---
Emulsified Water	scalar	*Visual	>0.1	NEG	---	---

## FLUID CONDITION

The AN level is acceptable for this fluid. The condition of the fluid is suitable for further service.

Sodium	ppm	ASTM D5185m		<1	---	---
Boron	ppm	ASTM D5185m		0	---	---
Barium	ppm	ASTM D5185m		0	---	---
Molybdenum	ppm	ASTM D5185m		0	---	---
Manganese	ppm	ASTM D5185m		0	---	---
Magnesium	ppm	ASTM D5185m		10	---	---
Calcium	ppm	ASTM D5185m		19	---	---
Phosphorus	ppm	ASTM D5185m		23	---	---
Zinc	ppm	ASTM D5185m		4	---	---
Sulfur	ppm	ASTM D5185m		1057	---	---
Acid Number (AN)	mg KOH/g	ASTM D8045		0.07	---	---
Visc @ 40°C	cSt	ASTM D445	30.4	31.1	---	---

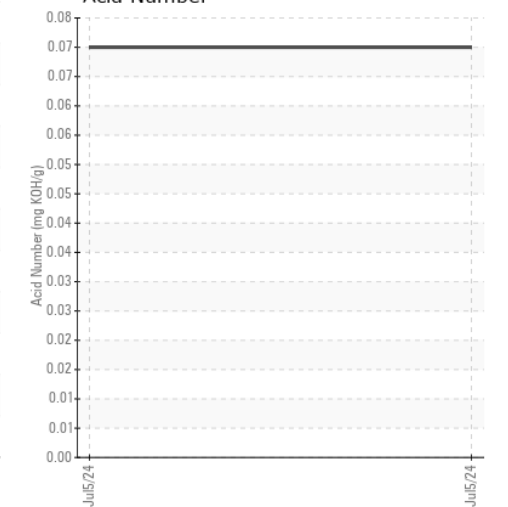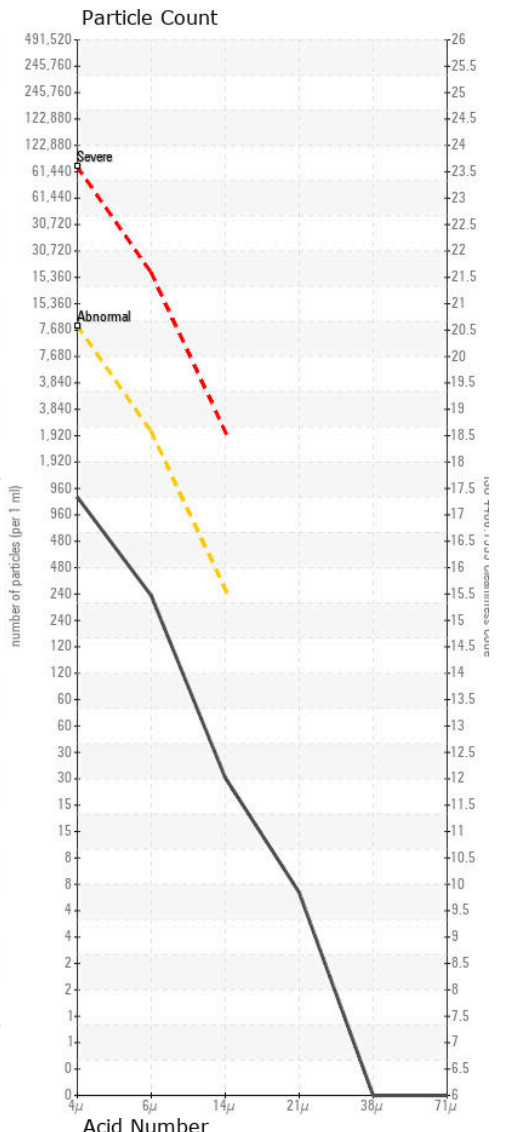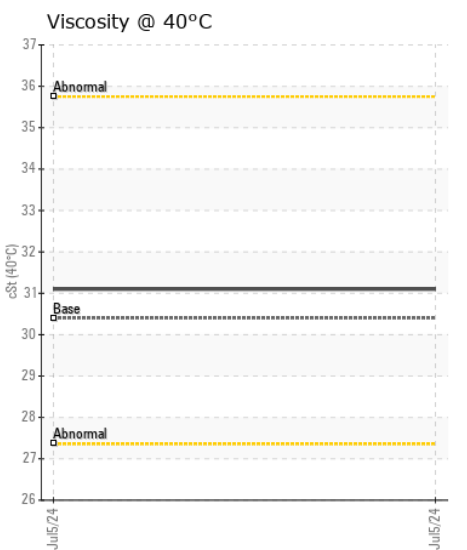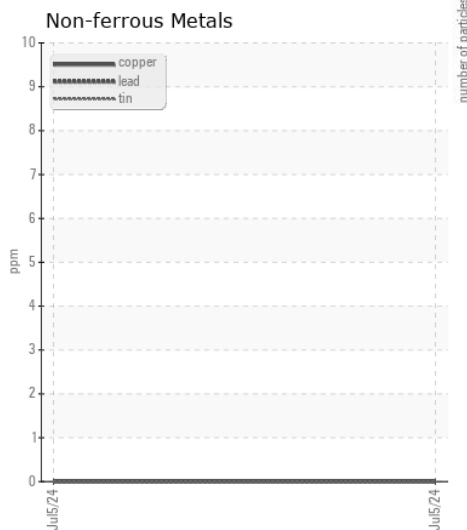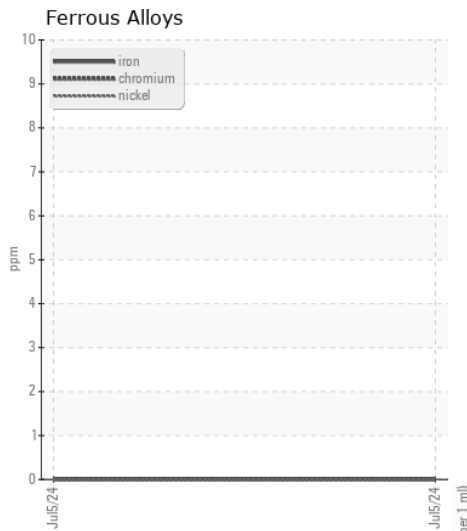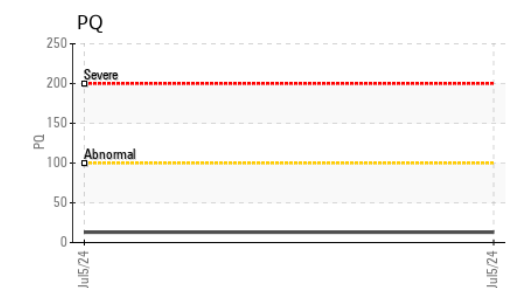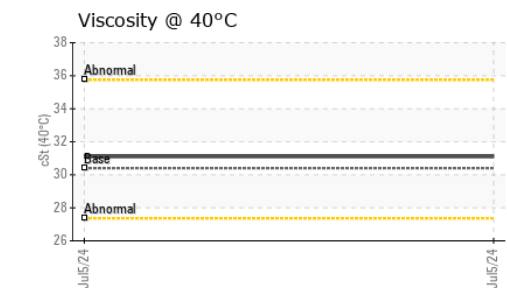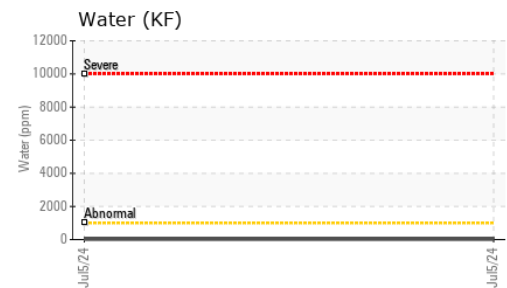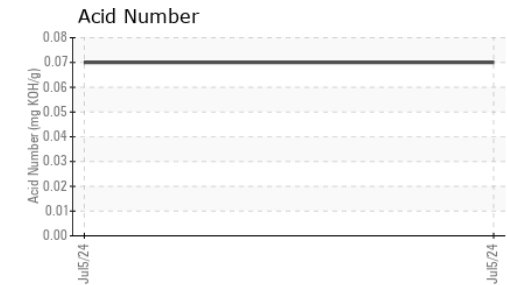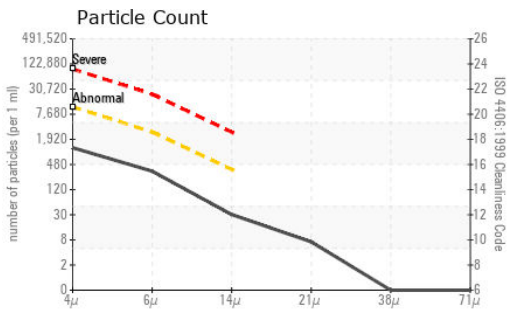

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : WC0930037  
**Lab Number** : 06233253  
**Unique Number** : 11116746  
**Test Package** : PLANT

**Received** : 11 Jul 2024  
**Tested** : 17 Jul 2024  
**Diagnosed** : 17 Jul 2024 - Jonathan Hester

**SRP - Salt River Project**  
 SRP Mail Station POB003, P.O. Box 52025  
 Phoenix, AZ  
 US 85072-2025  
 Contact: Chris Keisling  
 chris.keisling@srpnet.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:  
F: