



OIL ANALYSIS REPORT

WEAR	NORMAL
CONTAMINATION	NORMAL
FLUID CONDITION	NORMAL



Machine Id
CATERPILLAR 3
Component
Biogas Engine
Fluid
CONOCO EL MAR LA4 EXD (150 GAL)

RECOMMENDATION

Resample at the next service interval to monitor.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		WC0747364	WC0747368	WC0747369
Sample Date		Client Info		01 Jul 2024	18 Jun 2024	18 Jun 2024
Machine Age	hrs	Client Info		58810	58510	58510
Oil Age	hrs	Client Info		600	300	300
Filter Age	hrs	Client Info		600	300	300
Oil Changed		Client Info		Not Changd	Not Changd	Changed
Filter Changed		Client Info		Not Changd	Not Changd	N/A
Sample Status				NORMAL	NORMAL	NORMAL

WEAR

All component wear rates are normal.

Iron	ppm	ASTM D5185m	>45	2	2	2
Chromium	ppm	ASTM D5185m	>2	<1	<1	<1
Nickel	ppm	ASTM D5185m	>2	0	0	<1
Titanium	ppm	ASTM D5185m		<1	<1	<1
Silver	ppm	ASTM D5185m	>5	<1	<1	0
Aluminum	ppm	ASTM D5185m	>10	2	2	2
Lead	ppm	ASTM D5185m	>5	<1	<1	2
Copper	ppm	ASTM D5185m	>14	<1	<1	<1
Tin	ppm	ASTM D5185m	>13	2	2	1
Vanadium	ppm	ASTM D5185m		<1	<1	<1
White Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE

CONTAMINATION













There is no indication of any contamination in the oil.

Silicon	ppm	ASTM D5185m	>200	27	24	18
Potassium	ppm	ASTM D5185m	>20	2	2	3
Fuel		WC Method	>4.0	<1.0	<1.0	<1.0
Water		WC Method	>0.1	NEG	NEG	NEG
Glycol		WC Method		NEG	NEG	NEG
Soot %	%	*ASTM D7844		0	0	0
Nitration	Abs/cm	*ASTM D7624	>20	3.6	3.6	3.3
Sulfation	Abs/.1mm	*ASTM D7415	>30	17.7	17.5	16.7
Silt	scalar	*Visual	NONE	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG	NEG

FLUID CONDITION

The BN result indicates that there is suitable alkalinity remaining in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

Sodium	ppm	ASTM D5185m		0	0	2
Boron	ppm	ASTM D5185m		<1	<1	1
Barium	ppm	ASTM D5185m		0	0	0
Molybdenum	ppm	ASTM D5185m		1	1	1
Manganese	ppm	ASTM D5185m		0	0	<1
Magnesium	ppm	ASTM D5185m		6	6	6
Calcium	ppm	ASTM D5185m	1500	1610	1557	1687
Phosphorus	ppm	ASTM D5185m	280	302	290	315
Zinc	ppm	ASTM D5185m	330	397	378	394
Sulfur	ppm	ASTM D5185m		3260	3076	4046
Oxidation	Abs/.1mm	*ASTM D7414	>25	10.1	10.0	9.6
Acid Number (AN)	mg KOH/g	ASTM D8045	0.11	0.87	0.71	0.60
Base Number (BN)	mg KOH/g	ASTM D2896	5.5	3.61	3.77	4.30
Visc @ 100°C	cSt	ASTM D445	13.9	13.6	13.6	13.4

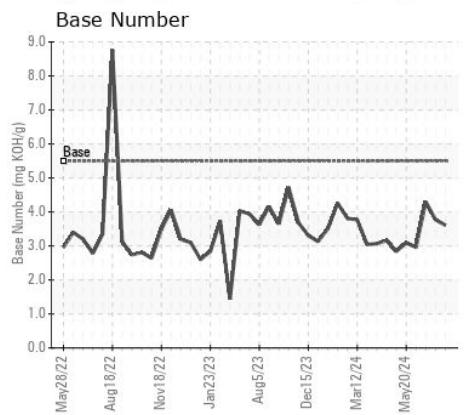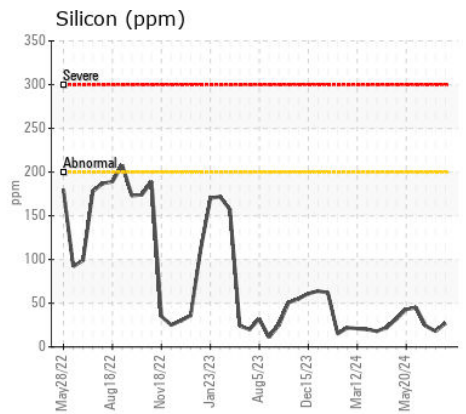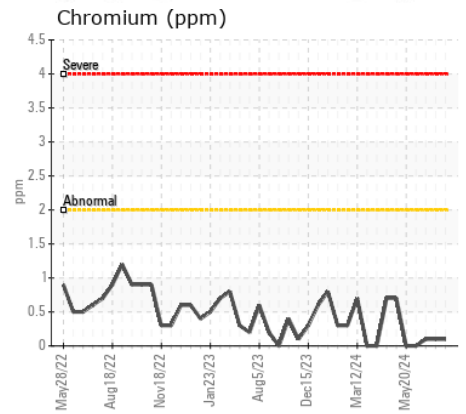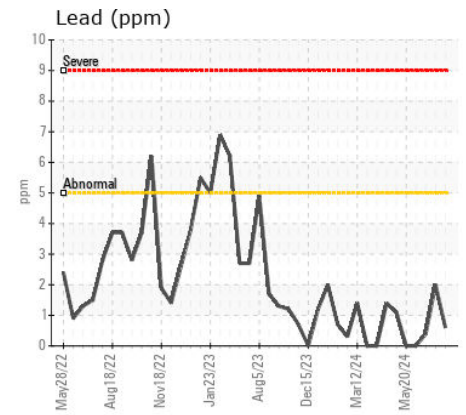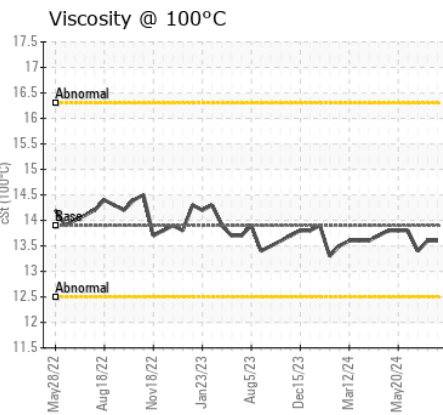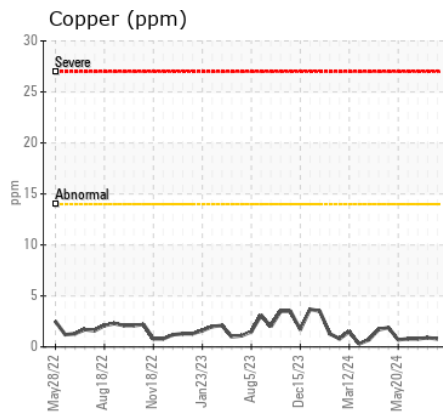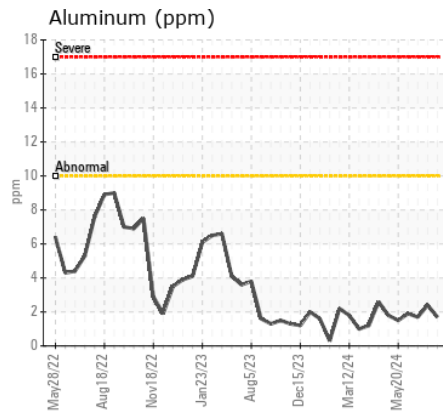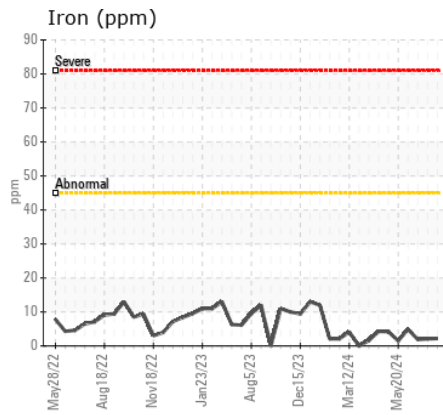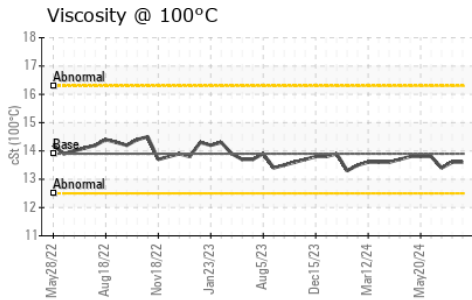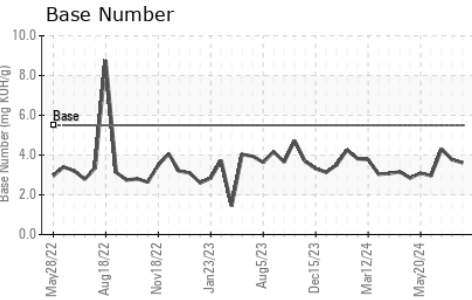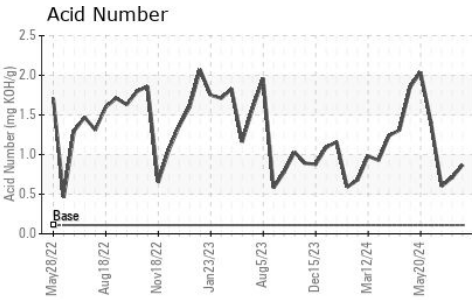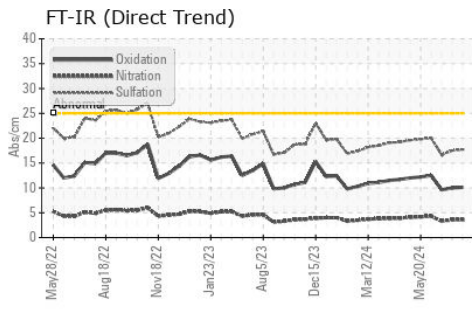

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WC0747364
Lab Number : 06234014
Unique Number : 11122848
Test Package : MOB 2
Received : 11 Jul 2024
Tested : 12 Jul 2024
Diagnosed : 13 Jul 2024 - Don Baldridge

SANTEE COOPER - RICHLAND LANDFILL
 1445 SCREAMING EAGLE ROAD
 ELGIN, SC
 US 29405
 Contact: BRIAN PEAKE
 brian.peake@santeecooper.com
 T: (843)248-7235
 F: (843)357-7173

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)