

Area PALASYN 45 Machine Id SULLIVAN PALATEK 21LE002670 - MALDON Component Compressor

RECOMMENDATION	Test	UOM	Method	Limit/Abn	Current	History1	History2
Resample at the next service interval to monitor.	Sample Number		Client Info		UCS06235074	UCS06073010	UCS05886814
···· P····· · · · · · · · · · · · · · ·	Sample Date		Client Info		24 Jun 2024	12 Dec 2023	19 Jun 2023
	Machine Age	hrs	Client Info		9803	8540	7251
	Oil Age	hrs	Client Info		1980	1289	1284
	Filter Age	hrs	Client Info		1980	1289	1284
	Oil Changed		Client Info		Changed	Changed	Changed
	Filter Changed		Client Info		Changed	Changed	Changed
	Sample Status				NORMAL	NORMAL	NORMAL
WEAR	Iron	ppm	ASTM D5185m	>50	<1	0	0
All component wear rates are normal.	Chromium	ppm	ASTM D5185m	>10	0	0	0
	Nickel	ppm	ASTM D5185m		0	0	<1
	Titanium	ppm	ASTM D5185m		0	<1	0
	Silver	ppm	ASTM D5185m		0	0	0
	Aluminum	ppm	ASTM D5185m	>25	<1	0	<1
	Lead	ppm	ASTM D5185m	>25	0	0	0
	Copper	ppm	ASTM D5185m	>50	0	<1	<1
	Tin	ppm	ASTM D5185m	>15	<1	0	0
	Vanadium	ppm	ASTM D5185m		0	0	0
	White Metal	scalar	*Visual	NONE	NONE	NONE	NONE
	Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE
CONTAMINATION	Silicon	ppm	ASTM D5185m	>25	2	<1	2
There is no indication of any contamination in the oil.	Potassium	ppm	ASTM D5185m	>20	<1	0	<1
	Water		WC Method	>0.1	NEG	NEG	NEG
	Silt	scalar	*Visual	NONE	NONE	NONE	NONE
	Debris	scalar	*Visual	NONE	NONE	NONE	NONE
	Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
	Appearance	scalar	*Visual	NORML	NORML	NORML	NORML
	Odor	scalar	*Visual	NORML	NORML	NORML	NORML
	Emulsified Water	scalar	*Visual	>0.1	NEG	NEG	NEG
FLUID CONDITION	Sodium	ppm	ASTM D5185m		0	0	0
The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.	Boron	ppm	ASTM D5185m	0.0	0	0	0
	Barium	ppm	ASTM D5185m	0.0	0	0	0
	Molybdenum	ppm	ASTM D5185m	0	0	0	0
	Manganese	ppm	ASTM D5185m	0	0	0	<1
	Magnesium	ppm	ASTM D5185m	0.0	0	0	<1
	Calcium	ppm	ASTM D5185m	0.0	0	0	<1
	Phosphorus	ppm	ASTM D5185m	966	528	522	456
	Zinc	ppm	ASTM D5185m	0	0	0	0
	Sulfur	ppm	ASTM D5185m	1309	1238	910	806
	A 1151 1 (210	1/01:1	LOTIL DOC	0 1 7 6		0.10	0.00

Contact/Location: NICK ZAMBON - UCASCCAM

0.16

44.1

0.14


44.3

Acid Number (AN) mg KOH/g ASTM D8045 0.172

Visc @ 40°C cSt ASTM D445 39.9

0.29

45.5

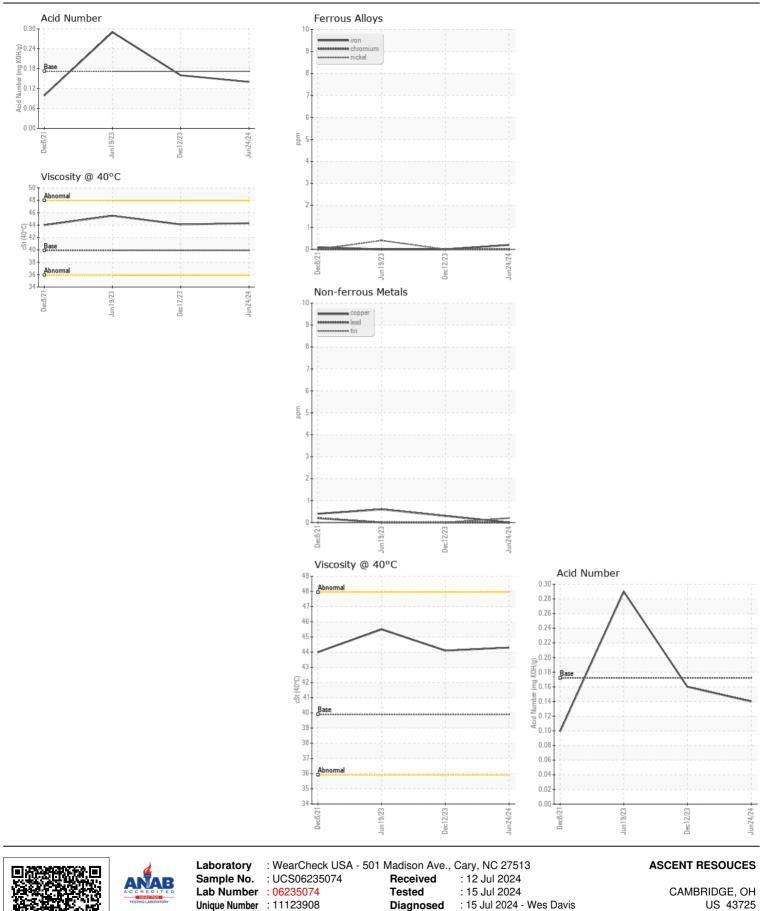

Test Package : IND 2 Contact: NICK ZAMBON Certificate L2367 To discuss this sample report, contact Customer Service at 1-800-237-1369. nick.zambon@ascentresources.com * - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Contact/Location: NICK ZAMBON - UCASCCAM Page 2 of 2

Т:

F: