



# OIL ANALYSIS REPORT

WEAR	<b>NORMAL</b>
CONTAMINATION	<b>NORMAL</b>
FLUID CONDITION	<b>NORMAL</b>

Area  
**AAAB IRAQ**  
 Machine Id  
**2000-4034**  
 Component  
**Genset**  
 Fluid  
**VALVOLINE PREMIUM BLUE (380 LTR)**

## RECOMMENDATION

Resample at the next service interval to monitor.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		<b>WC0860696</b>	WC0860679	WC0860667
Sample Date		Client Info		<b>27 Jun 2024</b>	08 Jun 2024	17 May 2024
Machine Age	hrs	Client Info		<b>28043</b>	0	27586
Oil Age	hrs	Client Info		<b>250</b>	257	287
Filter Age	hrs	Client Info		<b>250</b>	257	287
Oil Changed		Client Info		<b>Changed</b>	Changed	Changed
Filter Changed		Client Info		<b>Changed</b>	Changed	Changed
Sample Status				<b>NORMAL</b>	NORMAL	NORMAL

## WEAR

All component wear rates are normal.

Iron	ppm	ASTM D5185m	>50	<b>4</b>	0	2
Chromium	ppm	ASTM D5185m	>4	<b>0</b>	0	<1
Nickel	ppm	ASTM D5185m	>2	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m		<b>0</b>	0	<1
Silver	ppm	ASTM D5185m	>5	<b>&lt;1</b>	0	0
Aluminum	ppm	ASTM D5185m	>12	<b>2</b>	<1	4
Lead	ppm	ASTM D5185m	>17	<b>4</b>	0	3
Copper	ppm	ASTM D5185m	>70	<b>1</b>	0	<1
Tin	ppm	ASTM D5185m	>15	<b>0</b>	0	<1
Vanadium	ppm	ASTM D5185m		<b>0</b>	0	0
White Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE

## CONTAMINATION

There is no indication of any contamination in the oil.


Silicon	ppm	ASTM D5185m	>25	<b>6</b>	5	6
Potassium	ppm	ASTM D5185m	>20	<b>2</b>	0	2
Fuel		WC Method	>4.0	<b>&lt;1.0</b>	<1.0	<1.0
Water		WC Method	>0.1	<b>NEG</b>	NEG	NEG
Glycol		WC Method		<b>NEG</b>	NEG	NEG
Soot %	%	*ASTM D7844		<b>0.1</b>	0.1	0.1
Nitration	Abs/cm	*ASTM D7624	>20	<b>8.3</b>	7.7	7.9
Sulfation	Abs/.1mm	*ASTM D7415	>30	<b>18.1</b>	16.9	17.4
Silt	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Debris	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Appearance	scalar	*Visual	NORML	<b>NORML</b>	NORML	NORML
Odor	scalar	*Visual	NORML	<b>NORML</b>	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	<b>NEG</b>	NEG	NEG

## FLUID CONDITION


The BN result indicates that there is suitable alkalinity remaining in the oil. The condition of the oil is suitable for further service.

Sodium	ppm	ASTM D5185m		<b>2</b>	0	0
Boron	ppm	ASTM D5185m	2.9	<b>62</b>	59	70
Barium	ppm	ASTM D5185m	0.1	<b>0</b>	0	1
Molybdenum	ppm	ASTM D5185m	0.0	<b>35</b>	30	37
Manganese	ppm	ASTM D5185m		<b>&lt;1</b>	0	0
Magnesium	ppm	ASTM D5185m	18	<b>20</b>	19	23
Calcium	ppm	ASTM D5185m	2936	<b>3508</b>	3427	3612
Phosphorus	ppm	ASTM D5185m	998	<b>886</b>	909	881
Zinc	ppm	ASTM D5185m	1095	<b>1024</b>	1085	1073
Sulfur	ppm	ASTM D5185m	5469	<b>4171</b>	4563	4131
Oxidation	Abs/.1mm	*ASTM D7414	>25	<b>13.1</b>	11.8	12.1
Base Number (BN)	mg KOH/g	ASTM D2896	10.0	<b>9.1</b>	8.8	9.3
Visc @ 40°C	cSt	ASTM D445	118	<b>112</b>	111	114
Visc @ 100°C	cSt	ASTM D445	15.2	<b>14.3</b>	14.3	14.6
Viscosity Index (VI)	Scale	ASTM D2270	134	<b>129</b>	130	130


**FT-IR (Direct Trend)**

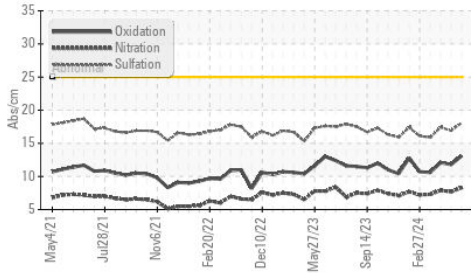


**Viscosity @ 100°C**

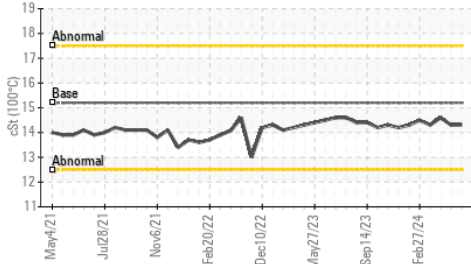


**Viscosity @ 40°C**

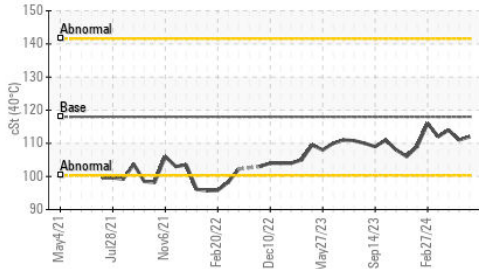


**Base Number**

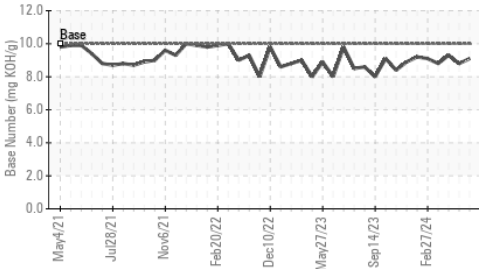


**Ferrous Alloys**

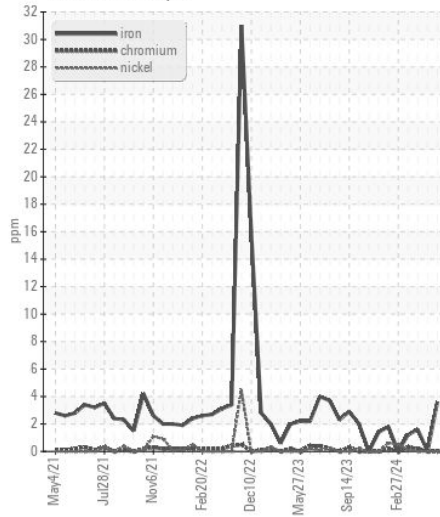


**Non-ferrous Metals**

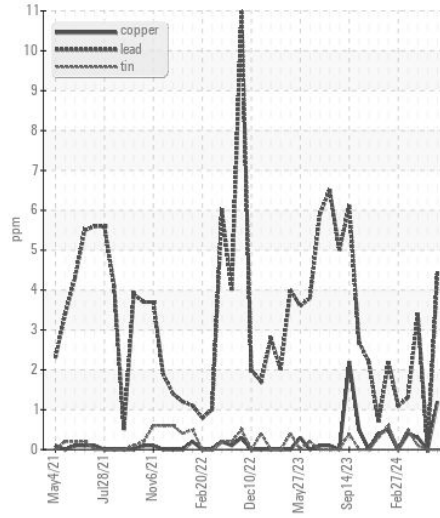

**Viscosity @ 100°C**

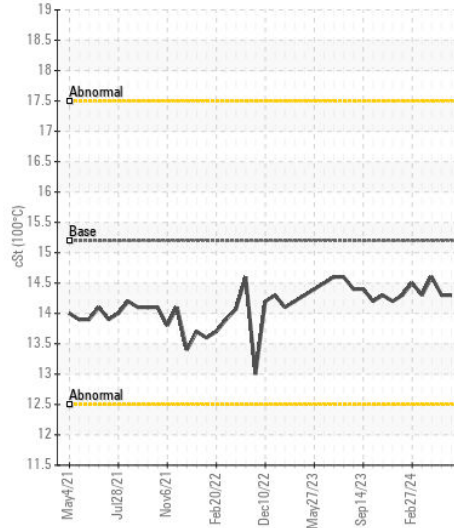

**Base Number**

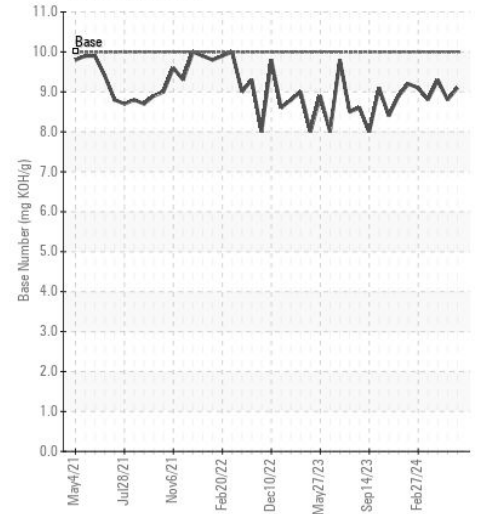

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : WC0860696 **Received** : 15 Jul 2024  
**Lab Number** : 06235322 **Tested** : 15 Jul 2024  
**Unique Number** : 11124156 **Diagnosed** : 15 Jul 2024 - Sean Felton  
**Test Package** : FLEET ( Additional Tests: KV40, VI )

**CUMMINS - PRIME POWER & IPP STRATEGIC ACCOUNTS**

3850 N VICTORIA ST  
 SHOREVIEW, MN  
 US 55126

Contact: Harsha Padigae  
 hpadigae@louisberger.com

T: (964)780-7579134

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

F: x: