



WEAR	<b>NORMAL</b>
CONTAMINATION	<b>NORMAL</b>
FLUID CONDITION	<b>NORMAL</b>

Machine Id  
**62 REDUCTION (S/N NO OTHER INFO GIVEN)**

Component  
**Gearbox**

Fluid  
**PETRO CANADA ENDURATEX EP 150 (15 GAL)**

**RECOMMENDATION**

Resample at the next service interval to monitor.

Test	UOM	Method	Limit/Abn	Current	History1	History2
Sample Number		Client Info		PCA0116769	---	---
Sample Date		Client Info		08 Jul 2024	---	---
Machine Age	hrs	Client Info		0	---	---
Oil Age	hrs	Client Info		0	---	---
Filter Age	hrs	Client Info		0	---	---
Oil Changed		Client Info		N/A	---	---
Filter Changed		Client Info		N/A	---	---
Sample Status				<b>NORMAL</b>	---	---

**WEAR**

All component wear rates are normal.

PQ		ASTM D8184		31	---	---
Iron	ppm	ASTM D5185m	>200	30	---	---
Chromium	ppm	ASTM D5185m	>15	0	---	---
Nickel	ppm	ASTM D5185m	>15	0	---	---
Titanium	ppm	ASTM D5185m		<1	---	---
Silver	ppm	ASTM D5185m		0	---	---
Aluminum	ppm	ASTM D5185m	>25	0	---	---
Lead	ppm	ASTM D5185m	>100	0	---	---
Copper	ppm	ASTM D5185m	>200	0	---	---
Tin	ppm	ASTM D5185m	>25	0	---	---
Vanadium	ppm	ASTM D5185m		0	---	---
White Metal	scalar	*Visual	NONE	NONE	---	---
Yellow Metal	scalar	*Visual	NONE	NONE	---	---

**CONTAMINATION**









There is no indication of any contamination in the oil.

Silicon	ppm	ASTM D5185m	>50	7	---	---
Potassium	ppm	ASTM D5185m	>20	0	---	---
Water		WC Method	>0.2	NEG	---	---
Silt	scalar	*Visual	NONE	NONE	---	---
Debris	scalar	*Visual	NONE	LIGHT	---	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---	---
Appearance	scalar	*Visual	NORML	NORML	---	---
Odor	scalar	*Visual	NORML	NORML	---	---
Emulsified Water	scalar	*Visual	>0.2	NEG	---	---

**FLUID CONDITION**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

Sodium	ppm	ASTM D5185m		1	---	---
Boron	ppm	ASTM D5185m	55	32	---	---
Barium	ppm	ASTM D5185m	0	0	---	---
Molybdenum	ppm	ASTM D5185m	0	0	---	---
Manganese	ppm	ASTM D5185m	0	0	---	---
Magnesium	ppm	ASTM D5185m	2	2	---	---
Calcium	ppm	ASTM D5185m	6	<1	---	---
Phosphorus	ppm	ASTM D5185m	250	443	---	---
Zinc	ppm	ASTM D5185m	3	0	---	---
Sulfur	ppm	ASTM D5185m	7500	6535	---	---
Acid Number (AN)	mg KOH/g	ASTM D8045	0.5	1.52	---	---
Visc @ 40°C	cSt	ASTM D445	150.0	147	---	---

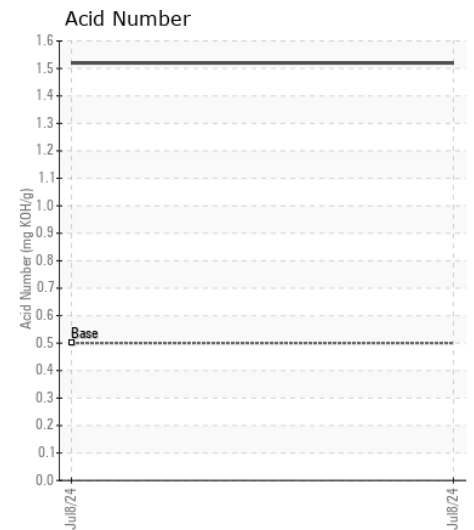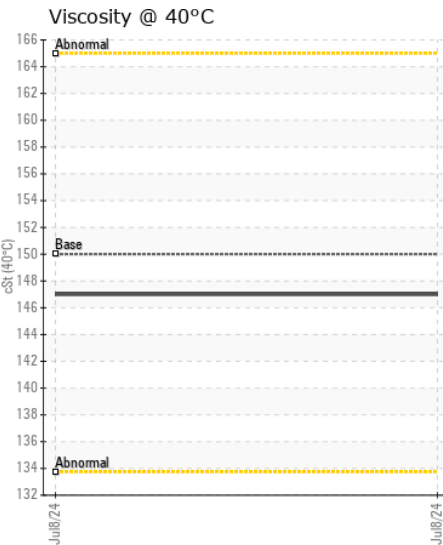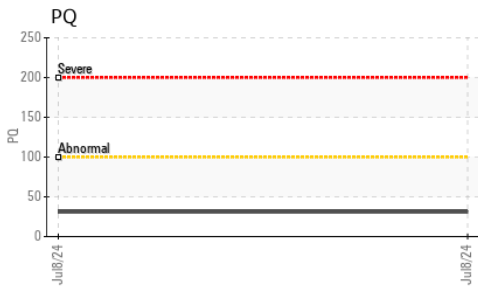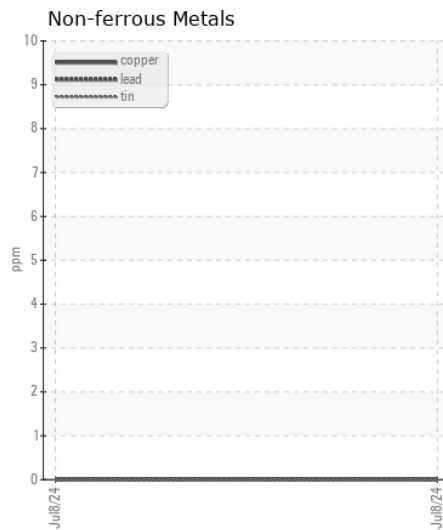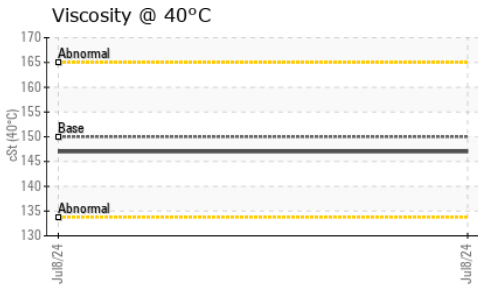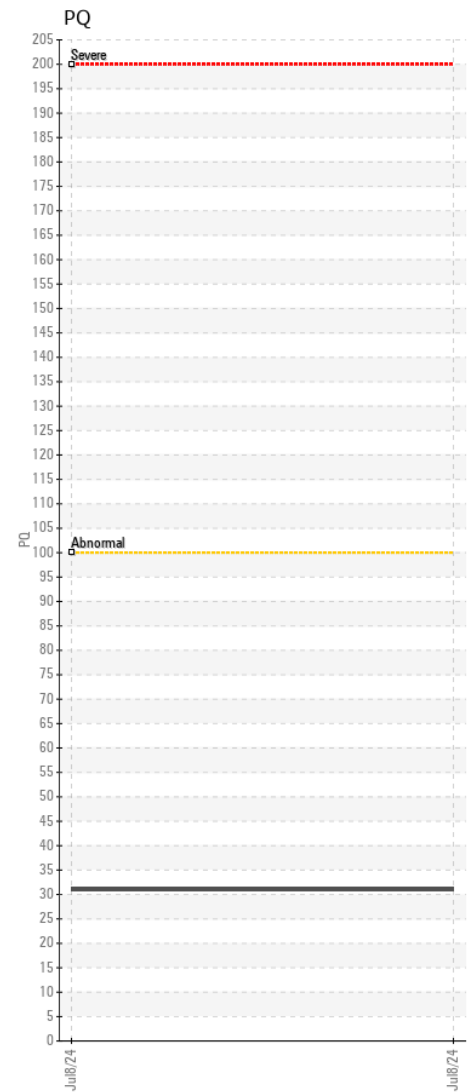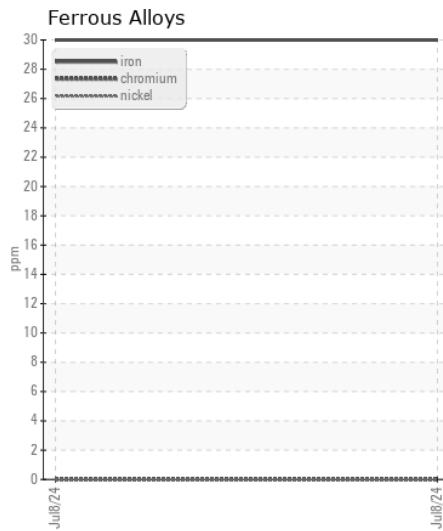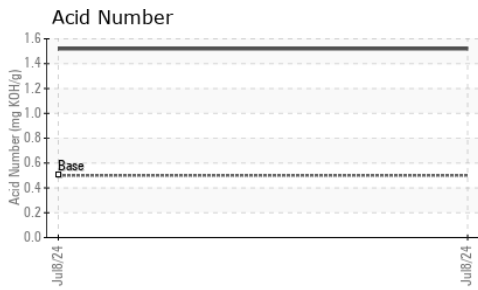

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : PCA0116769  
**Lab Number** : 06236202  
**Unique Number** : 11125036  
**Test Package** : PLANT

**CERTAINTED VINYL PLANT**  
 2651 PENNY RD  
 CLAREMONT, NC  
 US 28613  
 Contact: BRUCE JAMES  
 bruce.a.james@saint-gobain.com  
 T: (828)459-3320  
 F: (828)459-3329

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)