

[PMI3283677] Machine Id P110811009

Tank Diesel Fuel

No.2 DIESEL FUEL (ULTRALOW SULPHUR) (--- GAL)

RECOMMENDATION

All laboratory tests indicate that this sample meets specifications for No.2 ultra-low-sulfur diesel fuel.

CORROSION

All metal levels are normal indicating no corrosion in the system.


CONTAMINANTS

The water content is negligible. There is no bacteria or fungus (yeast and/or mold) indicated in the sample. The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the fuel.

G/							
Te	est	UOM	Method	Limit/Abn	Current	History1	History2
Sa	ample Number		Client Info		DC0037838		
Sa	ample Date		Client Info		26 Jun 2024		
M	achine Age	hrs	Client Info		1580		
Sa	ample Status				NORMAL		
 ۱۸	uminum		ASTM D5185m	<0.1	0		
	ickel	ppm	ASTM D5185m	<0.1	0		
	ead	ppm ppm	ASTM D5105m	<0.1	0		
	anadium		ASTM D5185m	<0.1	0		
Irc		ppm	ASTM D5185m	<0.1	0		
		ppm	ASTIVI D5105III		•••••		
Si	licon	ppm	ASTM D5185m	<1.0	<1		
So	odium	ppm	ASTM D5185m	<0.1	2		
Po	otassium	ppm	ASTM D5185m	<0.1	<1		
W	ater	%	ASTM D6304	<0.05	0.003		
pp	om Water	ppm	ASTM D6304	<500	33		
Pa	articles >4µm		ASTM D7647	>2500	1515		
Pa	articles >6µm		ASTM D7647	>640	570		
Pa	articles >14µm		ASTM D7647	>80	78		
Pa	articles >21µm		ASTM D7647	>20	29		
Pa	articles >38µm		ASTM D7647	>4	2		
Pa	articles >71µm		ASTM D7647	>3	0		
Oi	il Cleanliness		ISO 4406 (c)	>18/16/13	18/16/13		
%	Gasoline	%	*In-House	<0.50	0.0		
%	Biodiesel	%	*In-House	<20.0	0.0		
Ca	alcium	ppm	ASTM D5185m	<0.1	0		
M	agnesium	ppm	ASTM D5185m	<0.1	0		
Pł	nosphorus	ppm	ASTM D5185m	<0.1	0		
Zi	nc	ppm	ASTM D5185m	<0.1	0		
AS	STM Color	scalar	*ASTM D1500		L3.0		
	sc @ 40°C	cSt	ASTM D445	3.0	2.46		
	ulfur	ppm	ASTM D5185m	10	0		
	ulfur (UVF)	ppm	ASTM D5453		11		
	PI Gravity		ASTM D7777	37.7	34.7		
					<hr/>		

FUEL CONDITION

Sulfur value derived by ASTM D5453 method for ULSD validation. Sulfur level is acceptable for ULSD specification.

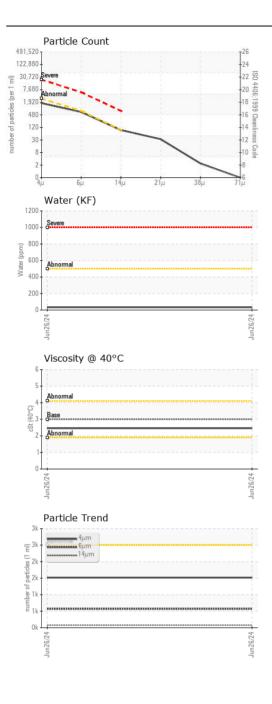



10

-10

Jun26/24

Laboratory	: WearCheck USA	 501 Madison Ave., 	Cary, NC 27513	KELLY GENERATOR & EQUIPMENT INC
Sample No.	: DC0037838	Received	: 15 Jul 2024	1955 DALE LN
Eabilitatilibo	r : 06236716	Tested	: 18 Jul 2024	OWINGS, MD
Unique Numbe	r :11125550	Diagnosed	: 18 Jul 2024 - Doug Bogar	t US 20736
Certificate L2367 Test Package	e : DF-5 (Additional ⁻	Tests: API, Cetane,	Fuel, PrtCount, Screen)	Contact: LESLIE SNURR
To discuss this sample repo	rt, contact Customer S	Service at 1-800-237	LSNURR@KGE.COM	
* - Denotes test methods that	ccreditation.	T: (410)257-5225		
Statements of conformity to	specifications are bas	ed on the simple ac	ceptance decision rule (JC	<i>CGM 106:2012)</i> F: (410)257-5227

Contact/Location: LESLIE SNURR - KELOWI Page 2 of 2

Pensky-Martens Flash Point (°C)

Jun26/24 -